

Pressure

Pressure switches · Pressure transmitters

CERTIFIED
ISO 9001
ISO 14001

DVGW
TÜV



Contents

PRESSURE SWITCHES	5
Electronic pressure switches / pressure transmitters Smart Press PST/PST-R	6
Applications, technical data	6
Product Summary	7
Definitions	8/9
Electrical connection	10
Switch outputs, analogue output and relay output	11
Indicators and display	12
Settings at user level	13
Settings at expert level	14
Overview of adjustable parameters	15
Dimensioned drawings	16/17
Mechanical pressure switches	18
Technical features (sectional drawing)	18
Definitions	19/20
General information about explosion protection	21/23
Pressure monitoring in areas at risk of explosion	24
10 selection criteria	25
Pressure switches – General Description	26
General technical data – valid for all pressure switches	27
"ZF" additional functions for pressure switches and pressure monitors	28/29
Setting instructions	30
Pressure switch with switching state interlock (reclosing lockout)	31
Explanation of type designations – type codes	32
DCM pressure switches and pressure monitors for overpressure	33
VCM vacuum switches	34
DNM pressure switches free of non-ferrous metal	35
DNS pressure switches with stainless steel sensor system	36
DDCM differential pressure switches	37
DPS differential pressure switches for ventilation and air-conditioning systems	38
HCD pressure and differential pressure switches for neutral gases (DVGW-tested)	39
Pressure switches with 2 microswitches – technical data, switching intervals	40/41
Switching schemes for ZF (additional function) 217	42
Examples of use for two-stage pressure switches	43
Pressure switches "of special construction"	44/45
Definitions and information	44/45
Safety analysis for maximum pressure monitoring	46
Further observations and summary	47
Standards – Directives – Component tests	48
Selection according to function and application, equipment of a boiler	49
DA pressure monitors and limiters for maximum pressure monitoring	50
DWR pressure monitors for steam and hot water, fuel gases and liquid fuels	51/52
FD safety-engineered maximum pressure limiters for liquid gas installations	53
DBS series pressure monitors and pressure limiters for particularly safety-critical applications	54
Safety-engineered maximum pressure monitors	55
Safety-engineered minimum pressure monitors	56
Features of safety-engineered pressure monitors and pressure limiters	56
Mechanical pressure switches, pressure monitors for fuel gases (DVGW-tested)	57
Dimensioned drawings for switch housings and pressure sensors	58/59
Accessories	60
EX 011, EX041 series isolating amplifiers	60/61
Pressure mediators attached to pressure switches	62
Siphons, NPT adapters	63
Threaded joints and valve combinations	63
Specifications for pressure switches and isolating amplifiers	64


PRESSURE SWITCHES

65

Product overview	66
Pressure transmitters, pressure regulators, mechanical-inductive F type series	67
Pressure transmitters with terminal connection type series F... + ED1	68
Pressure transmitters with plug connection type series F ... + ED3	69
Technical data	70
Setting, operation and testing	71/72
Dimensioned drawings	73
Pressure transmitters; piezoresistive, 3-conductor system SN 3	74
Pressure transmitters; piezoresistive, 2-conductor system SN 2	75
Operator interface / operating ranges	76
Setting and testing	77
Dimensioned drawings	78
DPT type series differential pressure transmitters for gaseous, non-aggressive media	79
AZ type series plug-in digital display	80
GT type series signal separator	81
AP type series programmable digital display	82
Specifications for pressure transmitters	83

Alphabetical type index

Type	Page	Type	Page
APT	82	GT	81
APV	82	HCD	39
AZ 331	80	K 430 D/480 D	63
DCM	33	MAU8	63
DDCM	37	NPT1	63
DGM	57	PST	7
DMW	63	PST ...-R	7
DNM	35	SDBAM	50
DNS	36	SN2	75
DPS	38	SN3	74
DPT	79	ST 12	10
DWAM	50, 55	STA 12	10
DWAMV	50	U 430 B/480 B	63
DWR	51/52	VCM ...	34
EX 041	61	VCMV ...	34
EX 011	60	VKD	63
Ex – DCM	33	VNM	34
Ex – DDCM	37	VNMV	34
Ex – DGM	57	VNS	36
Ex – DNM	35	ZF	28/29
Ex – DNS	36	ZFV ...	62
Ex – DWR	51		
Ex – VCM	34		
Ex – VNM	34		
Ex – VNS	36		
FD	53		
FHBN ...	68/69		
FN	68/69		
FVN ...	68, 69		



Pressure switches



PST, PST...R

Smart Press

Electronic pressure switches / pressure transmitters
PST, PST...-R

Applications

Honeywell Fema PST and PST...-R series pressure switches are highly flexible and can be adjusted and configured in two modes, namely user mode and expert mode, and are used for fine adjustment and monitoring of system pressures in plant engineering, fluidics, process engineering and pneumatics, and for monitoring and control of pumps and compressors.

Self-monitored versions are used in manufacturing lines in the automotive industry and in many areas of mechanical and special-purpose engineering. With an overall accuracy of 0.5% of full scale, these pressure switches/transmitters are also suitable for measurement monitoring in many laboratory applications.

Technical data

Housing and cover

Ambient temperature

Storage temperature

Medium temperature

Relative humidity

Total accuracy

Medium temperature drift

Weight

Parts in contact with medium

Process connection

Pressure gauge connection

Flush connection

Polybutylene terephthalate (PBT)

-20 to + 60°C, from 36 V DC...50 °C

-35 to + 80°C

-20 to + 100°C

0 to 95%, non-condensing

0.5% of final value, 1...600 bar

1% of final value, 250...1000 mbar

0.3% per 10 K

380 grams

1.4571 + 1.4542 (high pressure)

1.4571 + 1.4435 (low-pressure/flush)

G 1/2" external thread

G 3/4" external thread

Electrical connection

PST versions

PST...-R version

Protection class

Degree of protection

Climate class

Power supply

EMC

5-prong M12 plug, A-coded as per DIN IEC 60947-5-2

Extra 3-prong M12 plug

II as per EN 60335-1

IP65 according to EN 60529

C as per DIN EN 60654

14...36 V DC, max. 100 mA

compatible as per EN61326/A1

Electronic switch outputs (all versions)

Outputs

2, configurable as high/low side or push-pull switches, 14...36 V DC, max. 250 mA

Reaction time

30 ms

Switching differential (SP/RP)

selectable via software

Minimum Switching differential

△ resolution of the display

Relay outputs (PST...-R series)

Contact type

1 switch-over contact (1 x UM)

Min. electrical lifetime

250,000 switching cycles

Switching capacity

AC1 (resistive load)

1.5VA (24 VDC/60 mA, 230 VAC/6.5 mA)

Gold contacts (AgSnO2+Au [5 µm])

AC15 (inductive load)

unsuitable

Max. switching capacity

60 mA for < 5 ms

Min. switching capacity

50 mW (>5 V or >2 mA)

Switching capacity Silver contacts (AgSnO2)

AC1 (resistive load)

690 VA (230 V AC / 3 A)

AC15 (inductive load)

230 VA (230 V AC / 1 A)

Max. switching capacity

30 A for < 5 ms

Min. switching capacity

500 mW (>12 V or >10 mA)

Diagnostic output

Output configuration

"WARN" output (plug 2) max. 20 mA, 14...36 V DC

Transmitter output (analogue output)

Voltage/current

0...10 V and 4...20 mA, configurable in expert mode

Range limitation

Measuring range can be limited by up to 50% FS

Step response

approx. 300 ms

Simulation mode

System pressure simulation

via pressure range


Reaction test on sensor

signals

4 x/sec...1 x/16 sec



Product Summary

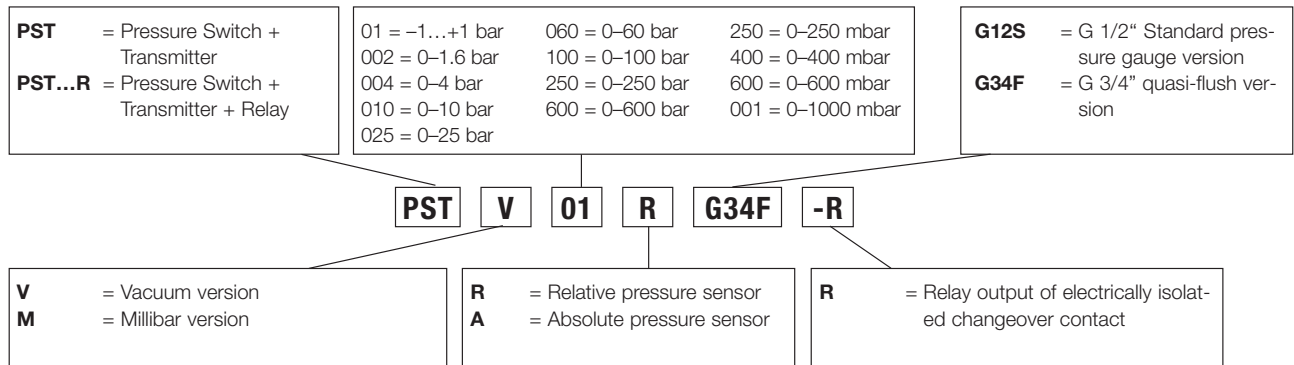

Ordering data

Smart Press with 2 electronic switching channels + transmitter output

Smart Press with 2 electronic switching channels + transmitter output and relay output

Order no.	Pressure in bar
PSTM250RG12S	0...250 mbar
PSTM400RG12S	0...400 mbar
PSTM600RG12S	0...600 mbar
PSTV01RG12S	-1...+1
PST001RG12S	0...1
PST002RG12S	0...1.6
PST004RG12S	0...4
PST010RG12S	0...10
PST025RG12S	0...25
PST060RG12S	0...60
PST100RG12S	0...100
PST250RG12S	0...250
PST600RG12S	0...600

Order no.	Pressure in bar
PSTM250RG12S-R	0...250 mbar
PSTM400RG12S-R	0...400 mbar
PSTM600RG12S-R	0...600 mbar
PSTV01RG12S-R	-1...+1
PST001RG12S-R	0...1
PST002RG12S-R	0...1.6
PST004RG12S-R	0...4
PST010RG12S-R	0...10
PST025RG12S-R	0...25
PST060RG12S-R	0...60
PST100RG12S-R	0...100
PST250RG12S-R	0...250
PST600RG12S-R	0...600

Max. permissible pressure in bar	Bursting pressure in bar	Dimensioned drawing Page	Fig.
1	>= 1.6	16	30+31
2	>= 3.2		
2	>= 3.2		
6	>= 10		
6	>= 10		
6	>= 10		
12	>= 20		
30	>= 50	16	32+33
75	>= 125		
180	>= 300		
300	>= 500		
500	>= 1600		
1000	>= 1800		

PSTM250RG34F	0...250 mbar
PSTM400RG34F	0...400 mbar
PSTM600RG34F	0...600 mbar
PSTV01RG34F	-1...+1
PST001RG34F	0...1
PST002RG34F	0...1.6
PST004RG34F	0...4
PST010RG34F	0...10
PST025RG34F	0...25

PSTM250RG34F-R	0...250 mbar
PSTM400RG34F-R	0...400 mbar
PSTM600RG34F-R	0...600 mbar
PSTV01RG34F-R	-1...+1
PST001RG34F-R	0...1
PST002RG34F-R	0...1.6
PST004RG34F-R	0...4
PST010RG34F-R	0...10
PST025RG34F-R	0...25

1	>= 1.6	17	34+35
2	>= 3.2		
2	>= 3.2		
6	>= 10		
6	>= 10		
6	>= 10		
12	>= 20		
30	>= 50	16	30+31
75	>= 125		

PST002AG12S	0...2
PST010AG12S	0...10

PST002AG12S-R	0...2
PST010AG12S-R	0...10

6	>= 10	16	30+31
30	>= 50		


PST002AG34F	0...2
PST010AG34F	0...10

PST002AG34F-R	0...2
PST010AG34F-R	0...10

6	>= 10	17	32+33
30	>= 50		

Definitions

Maximum pressure monitoring

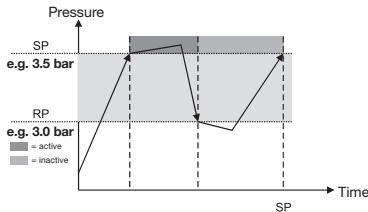


Maximum pressure monitoring

If an output is configured as a maximum detector, the electronic pressure switch monitors a programmed **upper pressure limit**. A switching process is triggered as soon as the pressure exceeds this limit.

Minimum pressure monitoring

If an output is configured as a minimum detector, the electronic pressure switch monitors a programmed **lower pressure limit**. A switching process is triggered as soon as the pressure falls below this limit.

Minimum pressure monitoring

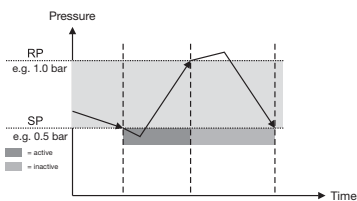

Window monitoring

If an output is configured for pressure window monitoring, the electronic pressure switch monitors a programmed **pressure window**, i.e. the **range between a defined lower limit and a defined upper limit**. A switching process is triggered as soon as the pressure falls below the lower pressure limit or exceeds the upper pressure limit.


Electronic pressure switch

PST and PST...-R series electronic pressure switches consist of an electronic, piezoresistive pressure sensor and a downstream analyser with 2 independently programmable switching channels, an analogue output and an optionally configurable relay output.

Switching differential

In contrast to mechanical pressure switches, where the switching differential is essentially determined by the design, with electronic pressure switches any switching differential may be chosen. The difference between the switching point and the reset point (the switching differential) is defined at user level by entering and saving the switching and reset points via the software. The smallest definable switching differential corresponds to the display resolution.

Window monitoring

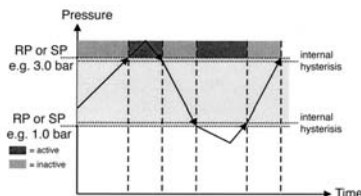

Switching point and reset point

Any switching point (SP) and reset point (RP) across the entire nominal pressure range of the electronic pressure switch can be selected at user level via the software.

Switching point deviation

Illegal settings are automatically detected by the software. The value most recently set has priority over the value first set. If the electronic pressure switch is configured as a **maximum detector**, for example, the switching point (SP) must lie above the reset point (RP). If the reset point is above the switching point, or the switching point is below the reset point, no error will be displayed, but the switching points will be shifted accordingly until they are finally saved.

Time Out function

"Time Out" refers to the time window in which values can be entered without the display automatically reverting to pressure display mode. For all settings at **user level** the setting window is **1 minute**. This means that if the user does not enter anything for one minute during the setting process, the unit automatically reverts to display mode and shows the current pressure in the display, disregarding any values that have been entered but not saved. However, when the unit is in setting mode at expert level, this "Time Out" function is turned off. In other words, the display (and thus the unit) remain in setting mode until the settings are saved in expert mode.

Escape function

After entering a valid 4-digit code, the user is able to parameterise and configure the unit at user or expert level. However, the unit automatically reverts to the locked state if no adjustment activity takes place within 60 seconds. Any manipulation of the rotary/push button extends the setting time by a further 60 seconds. On returning to the locked state, the word "CODE" (instead of "EXP") appears in the corresponding screen. Once the correct code has been entered, the settings can be changed both in user mode and in expert mode.

In expert mode it is also possible to change the code. While the unit is in expert mode, if values or settings are changed but not saved (with "SAVE"), the unit will remain in expert mode until a defined state is chosen with "SAVE" or "REST" (restore data). If the code is set to "0000" in expert mode and this state is saved (with "SAVE"), the unit remains in the unlocked condition. In this case the "Escape" function is disabled.

Simulation

To check the connection configuration or the reaction of the system to output signals, the "SIM" setting can be used to simulate the pressure for which the unit is designed. The pressure can be varied from 0-100% of the total value with a rotary switch.

To show the reaction limits of the system it is also possible to set an alternating output signal with a variable pulse frequency (0 - 100% = 4x/sec ... 1x/16 sec). If simulation mode is not used for 30 minutes, the unit automatically reverts to display mode.

Electronic slave pointer

Smart Press allows you to trace a failure event back in time. The hours are counted, starting from the failure event until the readout date. This enables the system operator to determine when the failure occurred and so draw conclusions about any plant errors.

Zero adjustment

Zero adjustment is used to compensate any drift error of the sensor, which is liable to occur on all sensors during the lifecycle of the product. With zero adjustment, SmartPress allows you to set the display precisely to zero at zero pressure. The position of the adjustment curve is simply moved in parallel. The basic adjustment of the sensor is not changed. Zero adjustment is only possible within a range of +/- 2% of the overall pressure range. Therefore a position error, which is particularly liable to occur on sensors in the range of 0-1 bar, can easily be compensated. As the setting range is very small, it is virtually impossible for the sensor to be accidentally zeroed on pressurization.

Push/pull output

In expert mode the switch outputs can be configured as traditional open collector or **push/pull outputs**. The outputs always assume defined states (e.g.: unswitched: minus potential, switched: plus potential). If the outputs are applied to the input of a PLC, any **pull-down resistors** that would otherwise be necessary can be dispensed with.

Adjustment dynamics


The bit generator of the SmartPress has been redesigned. The time-consuming job of "scanning" with the adjusting knob has given way to a convenient, dynamic setting strategy.

This allows the user to find the desired setting with just a few turns of the handwheel.

Electrical connection

Electrical connection and contact assignment

Electrical connection is via M12 plugs on the back of the unit. Depending on the version, either 2 (PST) or 3 (PST...-R) M12 connector plugs are available (not supplied with the unit).

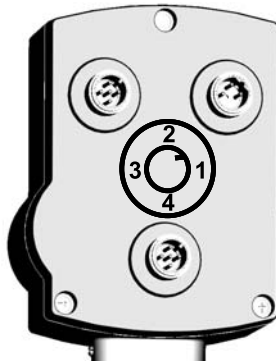

Contact assignment on plug 1

- Pin 1: Supply voltage 14...36 VDC
- Pin 2: OUT 2 (output 2) open collector output
- Pin 3: 0 volt (ground)
- Pin 4: OUT 1 (output 1) open collector output
- Pin 5: Serial interface (locked for calibration)

Special characteristic of open collector outputs:

Depending on the design, the output voltage at open collector outputs can be up to 2.5 V lower than the applied supply voltage.

Example: Supply voltage 14 V... output voltage OUT 1 approx. 11.5 V.

Contact assignment on plug 2

All versions of series PST and PST...-R are also equipped with an A-coded M 12 plug.

- Pin 1: Supply voltage 14...36 VDC
- Pin 2: WARN (warning output max. 20 mA)
- Pin 3: 0 V (ground)
- Pin 4: Analogue output AOUT
- Pin 5: Serial interface (for factory calibration only)

Units of the PST series can be powered both via plug 1 and via plug 2. If the PST is used purely as a transmitter, only one connection via plug 2 is needed, because the supply voltage can be connected here too (see "Contact assignment on plug 1").

Contact assignment on plug 3

All versions of series PST...R are also equipped with a B-coded M 12 plug.

Suitable cable sockets should be ordered at the same time for the electrical connection.

Optional accessories

Cable socket

- | | | |
|--------|----------|------------------------------------|
| 5-pole | ST12-5-G | straight version |
| 5-pole | ST12-5-A | right-angle version |
| 4-pole | ST12-4-G | straight version with 2 m cable |
| 4-pole | ST12-4-A | right-angle version with 2 m cable |

Plug protection cap


IP67 STA12

NB – For IP65 special plug protection cap STA12 is required


Observance of IP65 water and dust proofing requires the secure sealing of electrical connections not closed with plugs.

The soft rubber dust caps fitted for shipping do not fulfil this requirement. A reliable seal can only be achieved by the **STA12** protection cap.



Switch outputs

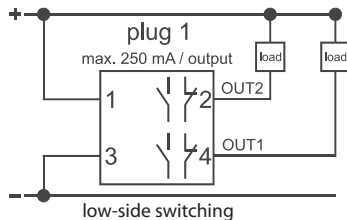



low-side switching

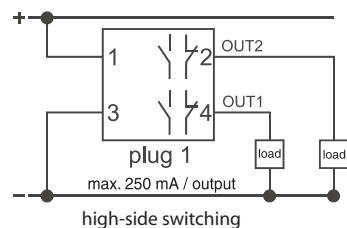

high-side switching

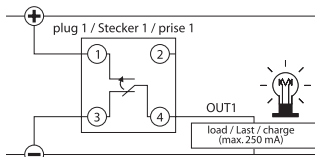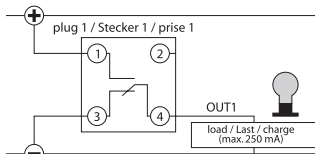

High-side switching push/pull outputs

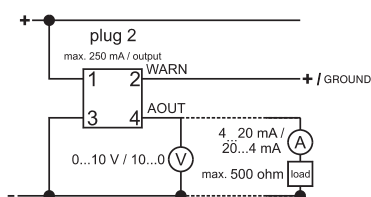

Switch output OUT1 and OUT2:

The switch outputs can be configured via the software (at expert level) both as normally closed / normally open, and as high-side and low-side switching.

- In **normally closed configuration**, the selected voltage potential (ground or supply voltage) occurs at the output in the **unswitched** state.
- In **normally open configuration**, the selected voltage potential (ground or supply voltage) occurs at the output in the **switched** state.
- In the **low-side switching configuration**, the outputs switch the voltage potential 0V (ground) with respect to a consumer connected to OUT1 or OUT2.
- In the **high-side switching configuration**, the outputs switch the supply voltage potential (minus approx. 2V) with respect to a consumer connected to OUT1 or OUT2.

If the power supplies of the pressure switch and connected load are independent of one another, the following must be taken into account: The potential difference between OC output and ground and OC output and supply voltage must not exceed 36 VDC. If the unit is configured for low-side switching, the external supply voltage must have the same ground reference as the unit itself. If the unit is defined as high-side switching, the external supply voltage must be linked to the supply voltage of the unit. It is important to note that the voltage drop in the through-connected state can be as much as 2 V. The maximum permitted current at the OC is 250 mA per switch output (OUT1, OUT2). A maximum switching current of 250 mA may flow through each channel.

The switching channels are short-circuit-proof and they are monitored for current and temperature.

Where current limiting is used and on overheating, both LEDs light up red (WARN function).

The freely configurable outputs can connect both the supply voltage (+ potential) itself and the ground (– potential) of the supply voltage to the output. If plus potential exists at the output, ground minus potential occurs after switching over.

If ground minus potential exists at the output, plus potential occurs after switching over.

Advantage: The output behaves like a mechanical changeover contact which emits either plus or minus potential. In other words, the open output is never electrically undefined, as is the case with an open collector output. Pull-up resistors are therefore unnecessary.

Analogue output and relay output

Analogue output AOUT:

The analogue output (AOUT) is available in versions PST and PST...-R. In expert mode it is configurable both as a 0–10 V/10–0 V, and as a 4–20 mA/20–4 mA output. The unit is supplied with the output configured for 0–10 V. The input impedance of the connected consumer **must not exceed 500 ohms**.

Relay output REL:


The relay output is available in version PST...-R. In expert mode the analogue output can be coupled via the software with output 1 (OUT1) and output 2 (OUT2), and with the WARN function. This means that the user can choose a potential-free output for these 3 important functions. The changeover contact of the relay is designed for a maximum resistive load of 4 A and an inductive load of 200 VA. At the lower end the 5 µ gold-plated silver contacts are designed for a minimum load of 50 mW. (5 V at 10 mA).

It should always be remembered that after a one-off maximum load, use at minimum load is no longer possible.

Indicators and display

The indicators in the display have the following meanings:

ATT	Attenuation (for setting a filter)
EXPERT	Expert mode (allows the user to configure the unit, e.g. as maximum detector or minimum detector or for window monitoring)
WARN	Warning function / alarm
WIN	Window monitoring (for monitoring a pressure window to detect exceeding or falling below a selected pressure window)
OUT1	Switch output OC 1
OUT2	Switch output OC 2
SP	Switching point
RP	Reset point Switch contact configured as normally open Switch contact configured as normally closed
AOUT	Analogue output (if the current pressure is outside the currently set range, the "AOUT" symbol is not visible).
ZERO	Zero point display for the analogue output or display symbol if output 1 or output 2 defined as low-side switching (unit switches power supply plus to the output). Combined with "FSO" in the switch configuration menu as indicator for the push/pull function.
FSO	Upper limit of the selected analogue display range or display symbol if output 1 or 2 defined as high-side switching. (unit switches power supply minus to the output). Combined with "ZERO" in the switch configuration menu as indicator for the push/pull function.
INV	Inversion of the analogue signal (i.e. "INV" appears if, instead of a standard analogue signal 0...10 V or 4...20 mA, the analogue signal output is set to 10...0 V or 20...4 mA).

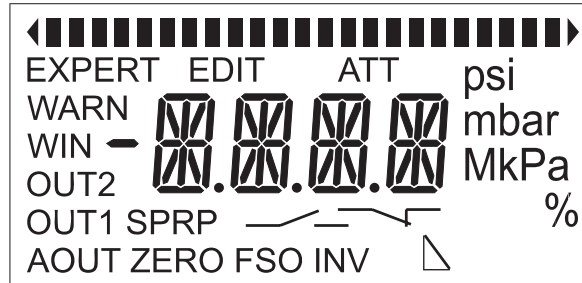

Display

The unit has a 4-place digital display with 3 decimal points and a minus sign. There are also other symbols for the different settings and configurations.

The display also includes a **bar graph**. This is at the top of the display and consists of a row of separately addressable individual segments with arrow symbols at either end.

As soon as the unit is powered up, all symbols appear on the display for 1 second as a test and the two LEDs light up briefly. The unit then goes into display mode, showing the current system pressure and the selected unit (bar, PSI or Pa). In addition the pressure trend (falling or rising) is indicated by an arrow at the left (falling) or right (rising) end. The "AOUT" indicator tells the user that the pressure is currently in the predefined pressure range for the analogue signal.

Meaning of LED colours

LED status		Meaning	
LED 1 lit	LED 2 lit	Output 1 Status	Output 2 Status
green	green	inactive	inactive
green	orange	inactive	active
orange	green	active	inactive
orange	orange	active	active
red	red	SP/RP implausible	
red	red	error	

Status LEDs

The current status of the switch outputs is displayed by 2 LEDs located beneath the display (LED 1 and LED 2). The two 3-colour LEDs indicate the switching status of the corresponding output and the warning function.

- Orange: the output is **ACTIVE**
- Green: the output is **INACTIVE** (if defined as WARN output, likewise INACTIVE)
- During input of the switching points, only the LED of the switching channel currently being modified is active. When switching points are entered, if an implausible entry is made for the maximum detector, e. g. SP < RP, the relevant channel LED lights up red.
- Both status LEDs light up red as soon as a WARN state occurs (e. g. electronics faulty and unit overheating).

Warning with both LEDs RED and WARN output active

Display indication		Display indication	
- on sensor failure	-***1	- overload output 1	-1***
- under-voltage	-**1*	- overload output 2	-2***
- under-temperature	-*1**	- overload output 1 and 2	-3***
- over-temperature	-*2**		

Settings at user level



Switch output OUT 1 and OUT 2

At user level, the switching point (SP) and reset point (RP) can be set across the entire nominal pressure range.

When the DIG (digital incremental sensor) is turned by one notch in the clockwise direction, the symbol "OUT 1" and "SP" appears. When the DIG is pressed, the EDIT "symbol" appears.

After that, any switching point can be selected by turning the DIG clockwise or anticlockwise. When you press the DIG again, "SAVE" is displayed. Press the DIG again to confirm. The chosen switching point is now permanently saved.

Turn it clockwise again to display the reset point (RP) symbol. The reset point (RP) is set in the same way as the switching point (SP).

Analogue output (AOUT)

Turning the DIG clockwise again opens the analogue output (AOUT) window. The screen displays the lower pressure value set (AOUT ZERO). Press the DIG to enter "EDIT" mode and then "SAVE" to save the lower reference value permanently.

Turn the DIG again to set "AOUT" "FSO". Here you can alter the upper reference value. The pressure value can be changed in the way described above.

Filter setting (attenuation)

To make the pressure switch insensitive to pressure peaks and to avoid distorting the measured value due to pressure peaks, a filter value of 0...95% can be set. After setting the switching points of OUT 2, turn the DIG again to open the "ATT" window. After pressing the DIG the user can change the value in edit mode (EDIT) or turn the filter off completely (OFF). Save the selected filter value with "SAVE". It is now permanently stored in the memory. The currently measured pressure is compared with the pressure measured previously. The currently measured pressure is then attenuated depending on the selected degree of filtering. This attenuation affects all outputs, i. e. all open collector outputs and relay outputs as well as the analogue output, as the attenuation has a direct influence on the incoming sensor signal. The previously measured pressure and the currently measured pressure (internally offset against each other) always produce a weight of 100%. The filter attenuation (effect) can be mathematically expressed as follows:

$$R[x] = M[x] * (100\% - F) + R[x - 1] * F$$

where:

"F" is the selected attenuation in %,


"M[x]" is the measured value as a function of a defined time "x",

"R[x - 1]" is the previously displayed and output (calculated) measured value "x - 1", and

"R[x]" is the displayed and output (calculated) measured value in the time "x".

Electronic slave pointer

Before you exit user mode, the Smart Press shows the **extreme states in the past** by means of **right/left bar graph arrows** and maximum values in the vacuum/overpressure range. Press DIG once to enter "EDIT" mode and turn the knob to see how much time has passed since the event occurred.

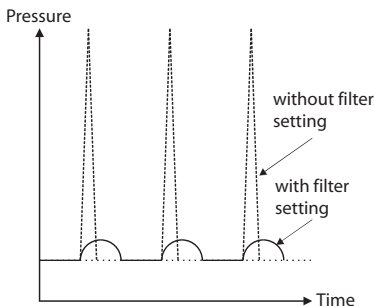

Settings at expert level

Configuration of OUT 1 and OUT 2

The last menu item in user mode (EXP) allows you to enter expert mode (after entering a code if necessary). The screen shows the configuration of OUT 1 (e.g. as WIN monitor for pressure window monitoring). Press the DIG to enter edit mode (EDIT). Output 1 can be configured as a minimum detector (left arrow), maximum detector (right arrow) or for pressure window monitoring (WIN) and as a push/pull output. Press to confirm your selection and open the function screen (FCT 1) of output 1. Press to enter edit mode (EDIT) and configure output 1 as normally open (NO), normally closed (NC), high-side or low-side switching or as a push/pull output. OUT 2 is configured in the same sequence, but note that output 2 can also be configured as a WARN output.

Configuration of analogue output (AOUT)

Turn the DIG clockwise again to open the configuration menu (AOUT). The screen shows either FCTA (current output) or FCTV (voltage output). In EDIT mode the analogue output can be configured as current or voltage output, or inverted.

Allocation of relay contact (on PST...-R versions only)

Turn the DIG clockwise again to enter the relay output configuration mode (REL). Press to switch to EDIT mode. Turn to apply the relay function to OUT 1, OUT 2 or WARN. The OC outputs are not affected by this. That is to say, the relay function should always be regarded as parallel to the corresponding output.

Setting pressure units to bar, Pascal or PSI

Turn the DIG clockwise again to enter the "UNIT" menu. Press and turn to select and confirm the desired pressure unit.

Setting the display background lighting

Select the menu option **LED+** at expert level and "EDIT", then choose **LED+** (permanently lit) or **LED-** (switching off automatically).

Simulation mode

Smart Press allows you to simulate various system states for checking connections and functions. Select menu option **SIM1** to take the system pressure through 0-100% according to the sensor specification. Selected switching points and the analogue output can be checked during this process. The menu option **SIM2** allows you to initiate an alternating square wave signal with a variable pulse frequency. In this way you can test the system's ability to react to sensor signals. If the display shows **SIM--**, simulation mode is turned off.

Setting a four-digit locking code

Turn the DIG clockwise again to enter the "CODE" menu. Press to enter EDIT mode, where you can enter and confirm a four-digit code between 0001 and 9999. 0000 is not a code.

Exiting expert level via the EXIT menu

Turn the DIG clockwise again to enter the "EXIT" menu. Press to go directly to display mode or to the SAVE menu (if any value has been modified). Here you can either confirm the new state with SAVE, or go back to the previous state (which existed before the modification) with REST (Restore).





Overview of adjustable parameters



Activity / Situation	Indications in LCD display		Parameters modifiable in	
	Symbols	Digital values/text	User mode	Expert mode
Current pressure is displayed*				
Current pressure	■■■■■■■■■■■■■■■■■■■■ relevant unit	relevant digital value	–	–
Output OUT 1 active	OUT 1	–	–	–
Output OUT 2 active	OUT 2	–	–	–
AOUT (pressure between ZERO and FSO)	AOUT	–	–	–
Rising pressure	►	–	–	–
Falling pressure	◄	–	–	–
Alarm (sensor, power supply etc.)	WARN	***1, **1* etc.	No	No
Parameterisation of outputs OUT 1 (and OUT 2)*				
SP	■, OUT1 (OUT2), SP	digital value	Yes	No
RP	■, OUT1 (OUT2), RP	digital value	Yes	No
1. Window (WIN) setting	■, OUT1 (OUT2), SP	digital value	Yes	No
2. Window (WIN) setting	■, OUT1 (OUT2), RP	digital value	Yes	No
Configuration of outputs OUT 1 (and OUT 2)				
Maximum pressure monitor (SP>RP)	EXPERT, SP, RP, ■■■►	OUT1 (OUT2)	No	Yes
Minimum pressure monitor (SP<RP)	EXPERT, SP, RP, ◄■■■	OUT1 (OUT2)	No	Yes
Pressure window monitoring (WIN)	EXPERT, WIN	OUT1 (OUT2)	No	Yes
Output 2 as "WARN" output	EXPERT, WARN	OUT2	No	Yes
Normally closed, low-side OUT 1 (2)	EXPERT, —, ZERO	FCT1 (FCT2)	No	Yes
Normally open, low-side OUT 1 (2)	EXPERT, —, ZERO	FCT1 (FCT2)	No	Yes
Normally closed, high-side OUT 1 (2)	EXPERT, —, FSO	FCT1 (FCT2)	No	Yes
Normally open, high-side OUT 1 (2)	EXPERT, —, FSO	FCT1 (FCT2)	No	Yes
Push-pull OUT 1 (2)	EXPERT, —, ZERO, FSO	FCT1 (FCT2)	No	Yes
Inverted push-pull OUT 1 (2)	EXPERT, —, ZERO, FSO	FCT1 (FCT2)	No	Yes
Parameterisation of analogue output*				
Starting point (ZERO)	■, AOUT, ZERO	relevant digital value	Yes	No
Full-scale output (FSO)	■, AOUT, FSO	relevant digital value	Yes	No
Configuration of the analogue output				
0...10 V voltage output	EXPERT, AOUT	FCTV	No	Yes
10...0 V voltage output	EXPERT, AOUT, INVA	FCTV	No	Yes
4...20 mA current output	EXPERT, AOUT	FCTA	No	Yes
20...4 mA current output	EXPERT, AOUT, INVA	FCTA	No	Yes
Configuration of the relay output				
Relay coupled with OUT1	EXPERT, OUT1	REL	No	Yes
Relay coupled with OUT2	EXPERT, OUT2	REL	No	Yes
Relay with alarm output	EXPERT, WARN	REL	No	Yes
Configuration units				
Unit	EXPERT, Pa/bar/psi	UNIT	No	Yes
Display background lighting				
Lighting permanently on	EXPERT	LED+	No	Yes
Lighting set to automatic	EXPERT	LED–	No	Yes
Simulation				
Pressure simulation, nominal pressure range	EXPERT	SIM1	No	Yes
Switching simulation, alternating	EXPERT	SIM2	No	Yes
OFF simulation	EXPERT	SIM--	No	Yes
Electronic slave pointer				
Lowest occurring pressure	◄■■■	digital pressure value	Yes	No
Highest occurring pressure	■■■►	digital pressure value	Yes	No
Read out time for lowest pressure	EDIT, ◄■■■, h	digital pressure value in h	Yes	No
Time value (min) not available	EDIT, ◄■■■, h	NAVL	Yes	No
Read out time for highest pressure	EDIT, ■■■►, h	digital pressure value in h	Yes	No
Time value (max) not available	EDIT, ■■■►, h	NAVL	Yes	No
Reset slave pointer	EDIT	Rset	Yes	No
Zero adjustment				
X X X X X X	X X X X X X		No	Yes
Parameterisation of a filter				
Filter attenuation	■, ATT, %	digital value/OFF	Yes	No
Locking/unlocking the unit with a code (user and expert level)				
Unlocked (code = 0000)	–	EXP	Yes	No
Locked (code ≠ 0000)	–	CODE, digital value	Yes	No
Changing a code				
Unit is locked	EXPERT	LOCK	No	Yes
Unit is unlocked	EXPERT	CODE	No	Yes
Locking/unlocking the unit with a code (expert level only) Described separately in the instruction manual.				

* The same symbols that appear in expert mode are visible in user mode and show the current output configuration.
 Exceptions: if output is configured as max./min. detector, in user mode instead of ■■■► or ◄■■■, only ► or ◄ is displayed.




Dimensioned drawings

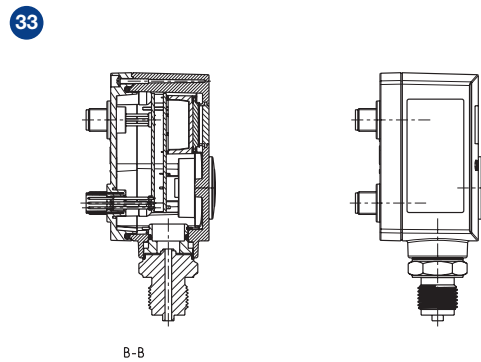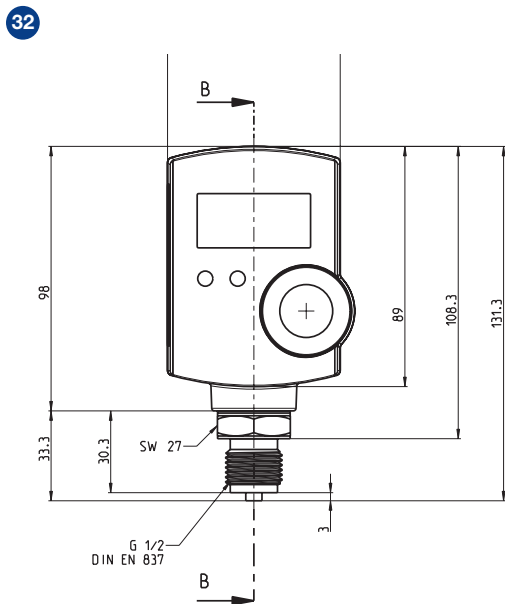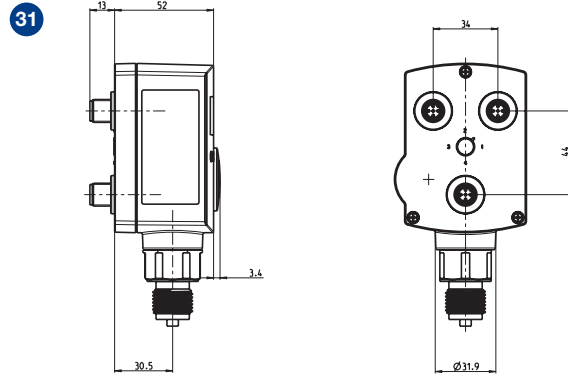
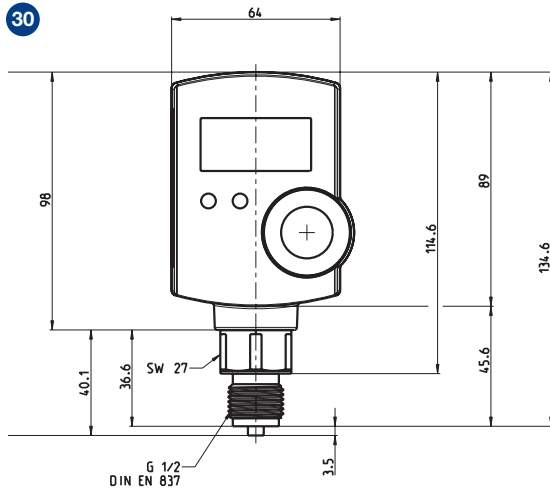


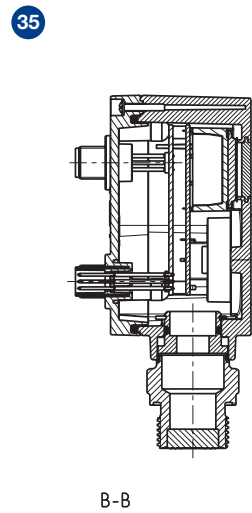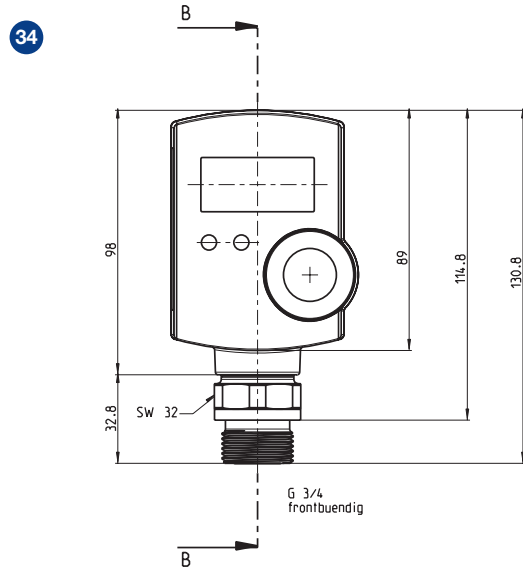

Mechanical pressure switches

Technical features / Advantages

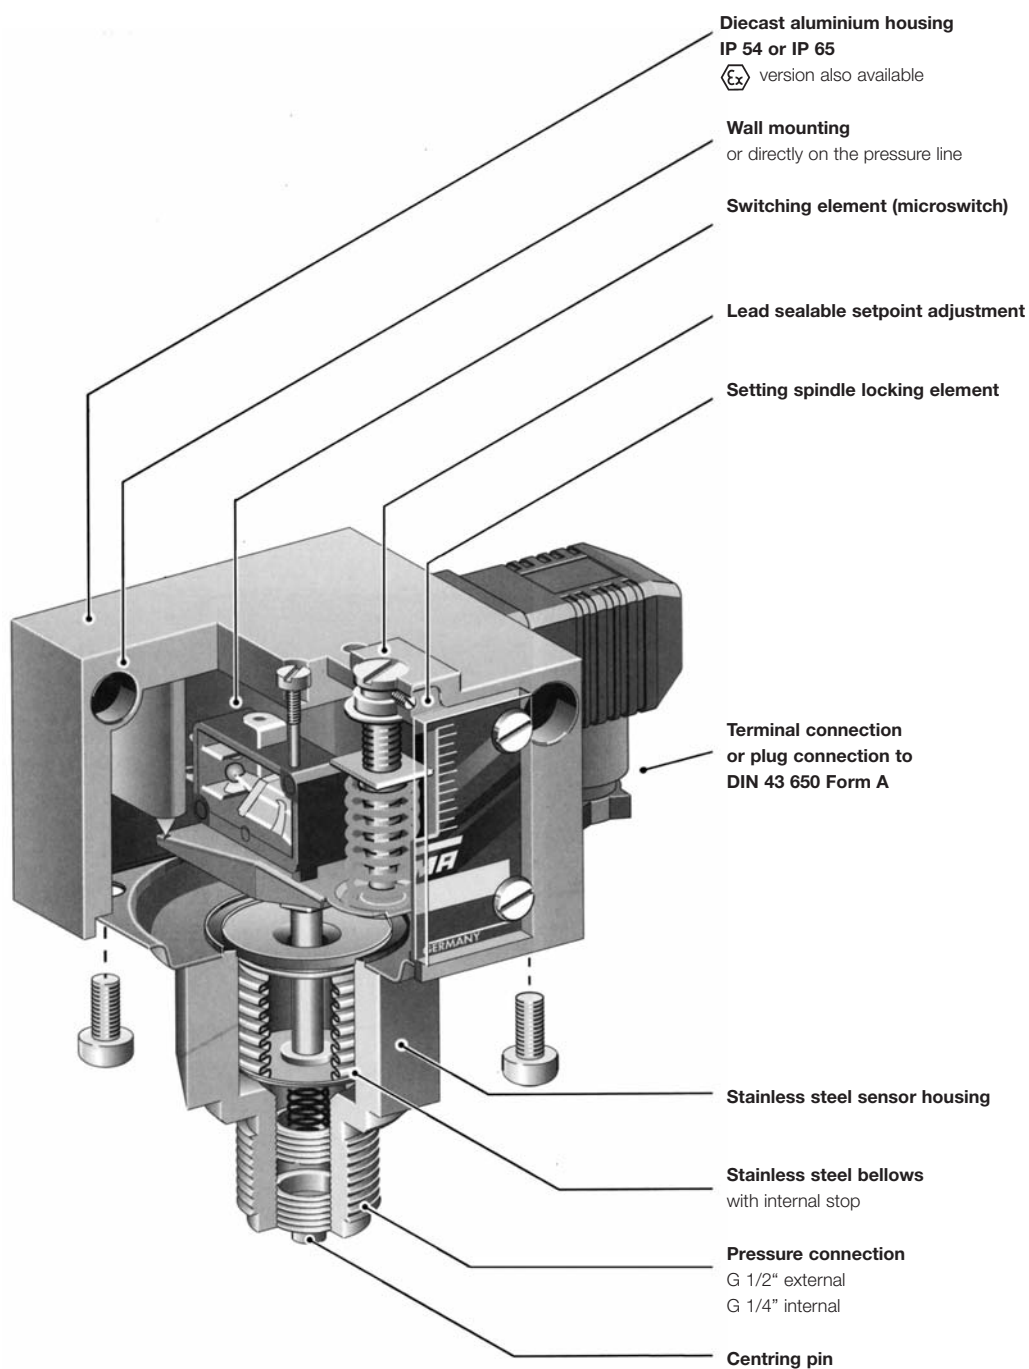

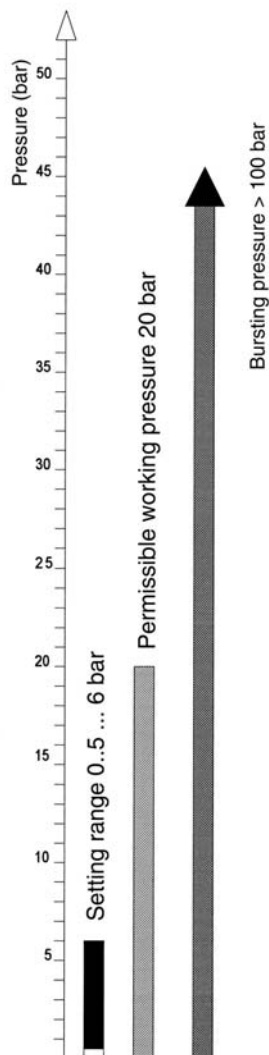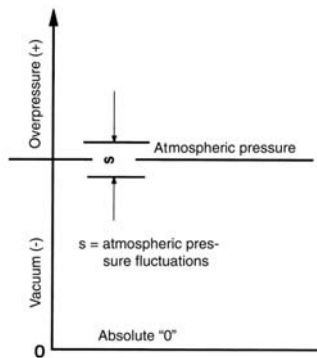

Pressure data for a pressure switch based on the example of DWR 625:

Setting range: 0.5–6 bar
Perm. working pressure: 20 bar
Bursting pressure: >100 bar

Definitions

Pressure data

Overpressure Pressure **over** atmospheric pressure. The reference point is atmospheric pressure.

Vacuum Pressure **under** atmospheric pressure. The reference point is atmospheric pressure.

Absolute pressure Pressure relative to absolute vacuum.

Differential pressure Difference in pressure between 2 pressure measuring points.

Relative pressure Overpressure or vacuum relative to atmospheric pressure.

Pressure data in all FEMA documents refer to relative pressure.

That is to say, they concern pressure differentials relative to atmospheric pressure. Overpressures have a positive sign, vacuums a negative sign.

Permissible bursting pressure (maximum permissible pressure)

The maximum working pressure is defined as the upper limit at which the operation, switching reliability and water tightness are in no way impaired (for values see Product Summary).

Bursting pressure (test pressure)

Type-tested products undergo a pressure test certified by TÜV affirming that the bursting pressure reaches at least the values mentioned in the Product Summary. During the pressure tests the measuring bellows are permanently deformed, but the pressurized parts do not leak or burst. The bursting pressure is usually a multiple of the permissible working pressure.

Setting range

Pressure range in which the cutoff pressure can be set with the setting spindle.

Pressure units

Unit	bar	mbar	Pa	kPa	MPa	(psi) lb/m ²
1 bar	1	1000	10 ⁵	100	0.1	14,5
1 mbar	0.001	1	100	0.1	10 ⁻⁴	0.0145
1 Pa	10 ⁻⁵	0.01	1	0.001	10 ⁻⁶	1.45 · 10 ⁻⁴
1 kPa	0.01	10	1000	1	0.001	0.145
1 MPa	10	10 ⁴	10 ⁶	1000	1	145
1 psi	0.069	68.94	6894	6.894	0.00689	1

In FEMA documents pressures are stated in **bar** or **mbar**.


Important:

All pressure data are overpressures or vacuums relative to atmospheric pressure. Overpressures have a positive sign, vacuums a negative sign.

Definitions


Maximum pressure monitoring

$$RSP = SP - xd$$


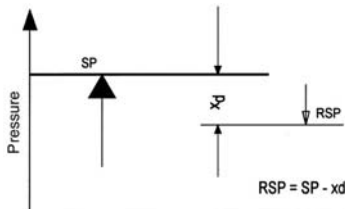


Minimum pressure monitoring

$$RSP = SP + xd$$

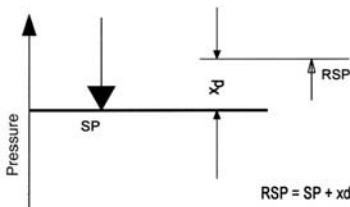

SP = switching point RSP = reset point
xd = switching differential (hysteresis)

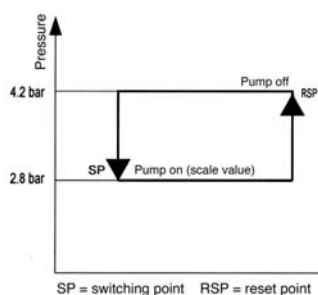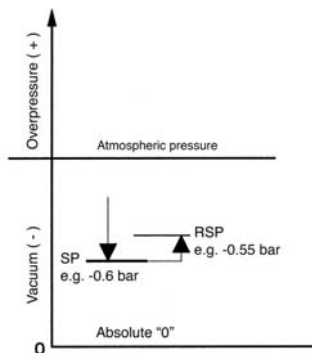

Switching differential

The switching differential (hysteresis) is the difference in pressure between the **switching point (SP)** and the **reset point (RSP)** of a pressure switch. Switching differential tolerances occur due to tolerances in the microswitches, springs and pressure bellows. Therefore the data in the Product Summaries are always average values. In the case of limiter functions the switching differential has no significance, as one is only interested in the switching point at which cutoff occurs, not the reset point. For a **controller function**, i.e. in the case of pressure switches used to switch a burner, pump etc. **on and off**, a pressure switch with an **adjustable switching differential** should be chosen. The switching frequency of the burner or pump can be varied by changing the switching differential.

Adjustable switching differential / Calibration

In the case of pressure switches with adjustable switching differential, the hysteresis can be set within the specified limits. The switching point (SP) and reset point (RSP) are precisely definable. When setting the pressure switch, the switching differential situation and the type of factory calibration must be taken into account. Some pressure switches (e.g. minimum pressure monitors of the DCM series) are calibrated under "falling" pressure, i.e. switching under falling pressure takes place at the scale value with the switching differential lying above it. The device switches back at scale value + switching differential. If the pressure switch is calibrated under rising pressure, switching takes place at the scale value and the device switches back at scale value — switching differential (see direction of action). The calibration method is indicated in the data sheets.

Direction of action

In principle, any pressure switch can be used for both maximum pressure and minimum pressure monitoring. This excludes pressure limiters, whose direction of action (maximum or minimum) is predefined. The only thing to remember is that the scale reading may deviate by the amount of the switching differential. See example at bottom left: The scale value is 2.8 bar.

Maximum pressure monitoring

With rising pressure, switching takes place once the preset switching pressure is reached (SP). The reset point (RP) is lower by the amount of the switching differential.

Minimum pressure monitoring

With falling pressure, switching takes place once the preset switching pressure is reached (SP). The reset point (RP) is higher by the amount of the switching differential.

Direction of action in vacuum range

It is particularly important to define the direction of action in the vacuum range.

Rising does not mean a rising vacuum, but rising pressure (from the point of view of absolute "0").

"Falling" pressure means a rising vacuum.

Example: Vacuum switch set to -0.6 bar falling means: Switching (SP) takes place under falling pressure (rising vacuum) at -0.6 bar. The reset point is higher by the amount of the switching differential (e.g. at -0.55 bar).

Setting a pressure switch

To define the switching point of a pressure switch exactly, in addition to the pressure it is also necessary to determine the direction of action. "Rising" means that switching takes place at the set value when the pressure rises.

The reset point is then lower by the amount of the switching differential. "Falling" means exactly the opposite.

Please note when specifying the setting of a pressure switch:

In addition to the switching point it is also necessary to specify the direction of action (falling or rising).

Example for selection of a pressure switch:

A pump is to be turned on at 2.8 bar and off again at 4.2 bar.

Chosen type: DCM6-203 according to data sheet DCM. Setting: Scale pointer to 2.8 bar (lower switching point). Switching differential to 1.4 bar (set according to pressure gauge).

Cutoff point: 2.8 bar + 1.4 bar = 4.2 bar.

General information about explosion protection

Basic principle

The basic principle of explosion protection is that:

- a) combustible materials (gas, vapour, mist or dust) in dangerous quantities
- b) air (or oxygen)
- c) ignition sources

must not occur in the same place.

The permanent or temporary occurrence of explosive mixtures as per a) and b) is often unavoidable, therefore when operating electrical installations care must be taken to ensure that no ignition sources can occur.



With this in mind, the CENELEC technical committee has adopted the following European standards which are recognized in all EU member states.

• General requirements	EN 50 014	• Pressure resistant encapsulation "d"	EN 50 018
• Oil encapsulation "o"	EN 50 015	• Increased safety "e"	EN 50 019
• Overpressure encapsulation "p"	EN 50 016	• Intrinsic safety "i"	EN 50 020
• Sand encapsulation "q"	EN 50 017	• Cast encapsulation "m"	EN 50 028

The guidelines relevant to FEMA products – besides the **"General Requirements EN 50 014"** – are **"Pressure resistant encapsulation d"** and **"Intrinsic safety i"**.

In addition, all explosion protection guidelines issued up to the present time have been combined into a single European Ex-Protection Directive 94/9EC. The aim of this new harmonized directive is to bring the explosion protection regulations of European member states into line with one another and eliminate barriers to trade between partner states. The new Directive 94/9EC (ATEX 100a), which came into force on 1 July 2003, replaces all previous directives.

All FEMA ex-pressure switches and ex-thermostats meet the requirements of the new European Ex-Protection Directive 94/9EC (ATEX 100a).

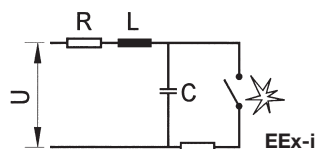

Pressure resistant encapsulation "d"

Switching elements and other electrical function units capable of igniting an explosive mixture are cast in a housing capable of withstanding the explosive pressure caused by an explosion indoors and preventing transmission to the surrounding atmosphere.

Intrinsic safety "i"

The equipment used in the area at risk of explosion contains only intrinsically safe electric circuits. An electric circuit is only intrinsically safe if the quantity of energy is so small that no spark or thermal effect can occur.

The term "simple electrical equipment"

In view of the use of simple microswitches without additional capacitance or inductance generating components, our pressure switches and thermostats designed for protection type Ex-i fall in the category of "simple electrical equipment". These are not subject to testing or certification requirements within the meaning of Directive 94/9EC. The units may only be used in conjunction with ATEX-tested isolating amplifiers in areas at risk of explosion. We equip all units which are explicitly designed for such use with microswitches having gold contacts, a grounding screw and — for ease of identification — a blue cable entry.

General information about explosion protection

Zone classification

Explosion risk areas are grouped into zones according to the likelihood of a dangerous explosive atmosphere **according to EN 1127-1** occurring.

When assessing the explosion hazard, i.e. when identifying explosion risk areas, the "Guidelines for the Avoidance of Danger due to Explosive Atmospheres with Examples (ExRL)" of the German Insurance Association for the Chemical Industry [Berufsgenossenschaft Chemie] must be taken into account.

If the situation concerns a special case or if doubts exist as to the definition of explosion risk areas, the matter shall be decided by the supervisory authorities (Trade Supervisory Office [Gewerbeaufsichtsamt], where applicable with the assistance of the Insurance Association or the Technical Control Boards [Technische Überwachungsvereine]).

In Zones 0 (20) and 1 (21), only electrical equipment for which a type test certificate has been issued by a recognized testing agency may be used. In Zone 0 (20), however, only equipment expressly authorized for that zone may be used. Equipment approved for use in Zones 0 (20) and 1 (21) may also be used in Zone 2 (22). Under the new European Directive 94/9 EC (ATEX 100a), a distinction is made between **gas atmospheres** and **dust atmospheres**. This results in the following zone classifications:

Gas	Zone 0	continuously or for long periods	Zone 0 (gas) is a place in which a dangerous explosive atmosphere is present continuously or for long periods. This normally includes only the interior of containers or the interior of apparatus (evaporators, reaction vessels etc.), if the conditions of Zone 0 are fulfilled. Continuous danger > 1000 hours/year.
	Zone 1	occasionally	Zone 1 (gas) is a place in which a dangerous explosive atmosphere can be expected to occur occasionally in normal operation. This may include the immediate vicinity of Zone 0. Occasional danger = 10 to 1000 hours/year.
	Zone 2	seldom and for short periods	Zone 2 (gas) is a place in which a dangerous explosive atmosphere can be expected to occur only rarely and then only for short periods. This may include areas surrounding Zones 0 and/or 1. Danger only under abnormal operating conditions < 10 hours/year.
Dust	Zone 20	continuously or for long periods	Zone 20 (dust) is a place in which a dangerous explosive atmosphere in the form of a cloud of dust in air is present continuously or for long periods, and in which dust deposits of unknown or excessive thickness may be formed. Dust deposits on their own do not form a Zone 20. Continuous danger > 1000 hours/year.
	Zone 21	occasionally	Zone 21 (dust) is a place in which a dangerous explosive atmosphere in the form of a cloud of dust in air may occasionally occur in normal operation, and in which deposits or layers of inflammable dust may generally be present. This may also include the immediate vicinity of Zone 20. Occasional danger = 10 to 1000 hours/year.
	Zone 22	seldom and for short periods	Zone 22 (dust) is a place in which a dangerous explosive atmosphere may be expected to occur only rarely and then only for short periods. This may include areas in the vicinity of Zones 20 and 21. Danger only under abnormal operating conditions < 10 hours/year.

General information about explosion protection

Explosion group

The requirements for explosion-protected equipment depend on the gases and/or vapours present on the equipment and on the dusts lying on, adhering to and/or surrounding the equipment. This affects the gap dimensions required for pressure-proof encapsulation and, in the case of intrinsically safe circuits, the maximum permitted current and voltage values. Gases, vapours and dusts are therefore subdivided into various explosion groups.

The danger of the gases rises from explosion group IIA to IIC. The requirements for electrical equipment in these explosion groups increase accordingly. Electrical equipment approved for IIC may also be used for all other explosion groups.

Temperature class

The maximum surface temperature of an item of equipment must always be lower than the ignition temperature of the gas, vapour or dust mixture. The temperature class is therefore a measure of the maximum surface temperature of an item of equipment.


Temperature class °C	Ignition temperature °C	Maximum surface temperature
T1	> 450	450
T2	> 300	300
T3	> 200	200
T4	> 135	135
T5	> 100	100
T6	> 85	85

Identification of explosion-protected electrical equipment

In addition to normal data (manufacturer, type, serial number, electrical data), data relating to the explosion protection must be included in the identification.

Under the new Directive 94/9EC (ATEX 95), based on IEC recommendations, the following identification is required:


For example:

		II	G	D	EEx	de	IIC	T6	IP65	T 80 °C
Ex-protection symbol	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Device group II	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Approved for gas	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Approved for dust	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Symbol for equipment built in accordance with European standards	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Explosion protection identifier	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Explosion group	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Temperature class	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
IP protection class	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____
Approved maximum temperature	_____	_____	_____	_____	_____	_____	_____	_____	_____	_____




Pressure monitoring in explosion risk areas Zone 1, 2 and 21, 22

Specially equipped pressure switches can also be used in **explosion risk areas Zone 1, 2 and 21, 22**. The following alternatives are possible:



1. Pressure-proof encapsulated switching device, explosion protection EEx de IIC T6, PTB 02 ATEX 1121

The pressure switch with pressure-proof encapsulation can be used directly in the explosion risk area (Zone 1 and 2 or 21 and 22). The maximum switching voltage, switching capacity and ambient temperature must be taken into account and the rules for installation in the explosion risk area must be observed. All pressure switches may be equipped with explosion-proof switching devices. However, special circuits and designs with an adjustable switching differential or internal interlock (reclosing lock-out) are not permitted.

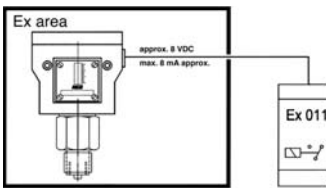


2. EEx-i pressure switches

All pressure switches of normal design can be used in explosion risk areas Zone 1 and 2 or 21 and 22, if they are integrated into an "intrinsically safe control current circuit". Intrinsic safety is based on the principle that the control current circuit in the explosion risk area carries only a small quantity of energy which is not capable of generating an ignitable spark.

Isolating amplifiers, e.g. type Ex 011 or Ex 041, must be tested by the Physikalisch-Technische Bundesanstalt (PTB) and approved for use in explosion risk areas. Isolating amplifiers must always be installed outside the explosion risk zone.

Pressure switches designed for EEx-ia installations may be provided with blue connection terminals and cable entries. In view of the low voltages and currents carried via the contacts of the microswitches, gold-plated contacts are recommended (additional function ZF 513).

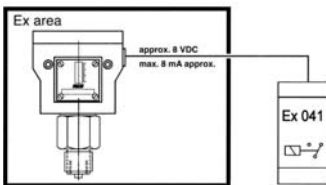


3. Pressure switches with microswitch and resistor combination for short-circuit and line break monitoring (see DBS series)

A combination of a pressure switch with mechanical microswitch connected to a 1.5 kOhm series resistor and a safety-engineered isolating amplifier (type Ex 041) may also be used in explosion risk zones 1, 2 and 21, 22 (explosion protection EEx-ia).

The safety-engineered isolating amplifier produces a separate intrinsically safe control current circuit and at the same time monitors the supply conductors between the isolating amplifier and the pressure switch for short-circuit and line break. In this regard, see also the section on pressure limiters for safety-critical applications and data sheet Ex 041.


Pressure monitoring in explosion risk areas Zone 1 (21) and 2 (22)



Ex-D...

Pressure-proof encapsulated


Explosion protection: EEx de IIC T6 PTB approval for the complete switching device. Switching capacity at 250 V/3 A. The pressure switch can be installed within the Ex-Zone.



D...-513 + Ex 011

Intrinsically safe

Explosion protection: EEx-ia PTB approval for isolating amplifiers Ex 041 Pressure switch with gold-plated contacts, blue terminals and blue cable entries. The isolating amplifier must be installed outside the Ex-Zone.



DWR...-576 + Ex 041

Intrinsically safe, line break and short-circuit monitoring

Explosion protection: EEx-ia PTB approval for isolating amplifiers Ex 041 Pressure switch with safety sensor, positive opening microswitch, gold-plated contacts, blue terminals and blue cable entries. The isolating amplifier must be installed outside the Ex-Zone.

10 selection criteria

CHECKLIST

1	Medium	Steam, hot water, fuel gases, air, flue gases, liquid gas, liquid fuels, other media
1a	Sensor material	Stainless steel, non-ferrous metals, plastics (e.g. Perbunan). Are all sensor materials resistant to the medium? Oil and grease-free for oxygen?
2	Type approval	Is type approval (TÜV, DVGW, PTB, etc.) required for the intended application?
3	Function	Monitors, limiters. Safety-engineered pressure limiters.
4	Direction of action	Is the maximum pressure or minimum pressure to be monitored? Does the pressure switch have a controller function (e.g. turns pump on and off)?
5	Setting range	The desired setting range can be found in the Product Summaries.
6	Switching differential for controllers/monitors only	The adjustable switching differential is only important in the case of pressure switches with a controller function. For limiter functions the switching differential (hysteresis) has no significance
7	Maximum working pressure	The maximum working pressure listed in the tables must be equal to or greater than the maximum system pressure
8	Environmental conditions	Medium temperature / ambient temperature / type of protection / humidity / Ex-zone / Outdoor installation – protective measures
9	Type of construction/Size Pressure connection	Size, installation position, installation method, pressure connection with seal
10	Electrical data Switching capacity	Switching element / changeover contact / normally closed contact / normally open contact / switching capacity / interlocking / gold contacts / contactless signal transmission

**This list of criteria does not claim to be complete.
However, all items must be checked.
The stated sequence is expedient but not mandatory.**


Pressure switches

General description

Operating mode

The pressure occurring in the sensor housing (1) acts on the measuring bellows (2). Changes in pressure lead to movements of the measuring bellows (2) which are transmitted via a thrust pin (4) to the connecting bridge (5). The connecting bridge is frictionlessly mounted on hardened points (6). When the pressure rises the connecting bridge (5) moves upwards and operates the microswitch (7). A counter-force is provided by the spring (8) whose pretension can be modified by the adjusting screw (9) (switching point adjustment). Turning the setting spindle (9) moves the running nut (10) and modifies the pretension of the spring (8). The screw (11) is used to calibrate the microswitch in the factory. The counter-pressure spring (12) ensures stable switching behaviour, even at low setting values.

- 1 = Pressure connection
- 2 = Measuring bellows
- 3 = Sensor housing
- 4 = Thrust pin
- 5 = Connecting bridge
- 6 = Pivot points
- 7 = Microswitch or other switching elements
- 8 = Setting spring
- 9 = Setting spindle (switching point adjustment)
- 10 = Running nut (switching point indicator)
- 11 = Microswitch calibration screw (factory calibration)
- 12 = Counter pressure spring

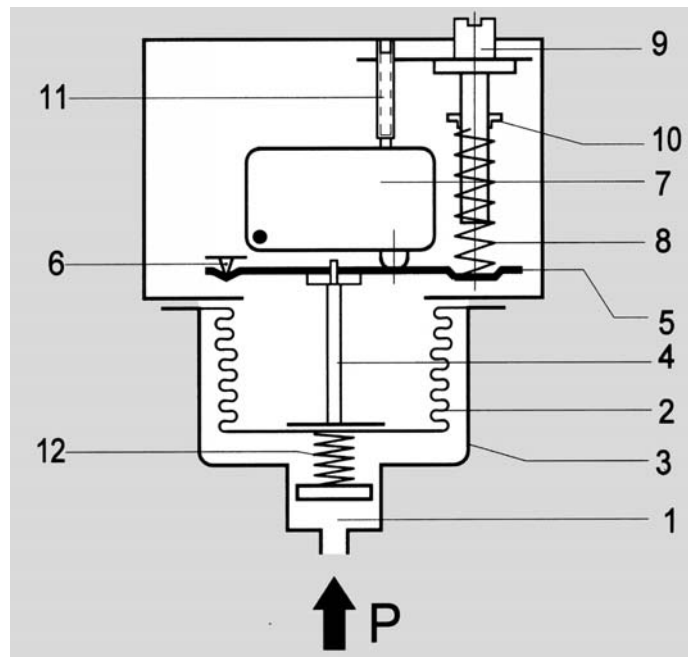

Pressure sensors

Apart from a few exceptions in the low-pressure range, all pressure sensors have measuring bellows, some made of copper alloy, but the majority of high-quality stainless steel. Measured on the basis of permitted values, the measuring bellows are exposed to a minimal load and perform only a small lifting movement. This results in a long service life with little switching point drift and high operating reliability. Furthermore, the stroke of the bellows is limited by an internal stop so that the forces resulting from the overpressure cannot be transmitted to the switching device. The parts of the sensor in contact with the medium are welded together without filler metals. The sensors contain no seals. Copper bellows, which are used only for low pressure ranges, are soldered to the sensor housing. The sensor housing and all parts of the sensor in contact with the medium can also be made entirely from stainless steel 1.4571 (DNS series). Precise material data can be found in the individual data sheets.

Pressure connection

The pressure connection on all pressure switches is executed in accordance with DIN 16288 (pressure gauge connection G 1/2A). If desired, the connection can also be made with a G 1/4 internal thread according to ISO 228 Part 1. Maximum screw-in depth on the G 1/4 internal thread = 9 mm.


Centring pin



In the case of connection to the G 1/2 external thread with seal in the thread (i.e. without the usual sheet gasket on the pressure gauge connection), the accompanying centring pin is not needed. Differential pressure switches have 2 pressure connections (max. and min.) each of which are connected to a G 1/4 internal thread.

General technical data

with microswitches of the DCM, VCM, DNM, DNS and DDC series.

The technical data of type-tested units may differ slightly.
(please refer to type sheet)

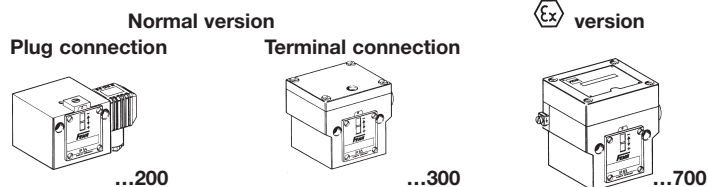

Switch housing	Diecast aluminium GD Al Si 12	Diecast aluminium GD Al Si 12
Pressure connection	G 1/2 external thread (pressure gauge connection) and G 1/4 internal thread G 1/4 internal thread for DDCM differential pressure switches	
Switching function and connection diagram (applies only to version with microswitch)	Floating changeover contact. With rising pressure switching single-pole from 3-1 to 3-2. 	Floating changeover contact. With rising pressure switching single-pole from 3-1 to 3-2. 
Switching capacity (applies only to version with microswitch)	8 A at 250 VAC 5 A at 250 VAC inductive 8 A at 24 VDC 0.3 A at 250 VDC min. 10 mA, 12 VDC	3 A at 250 VAC 2 A at 250 VAC inductive 3 A at 24 VDC 0.03 A at 250 VDC min. 2 mA, 24 V DC
Mounting position	preferably vertical (see technical data sheet)	vertical
Degree of protection (in vertical position)	IP 54; (for terminal connection ...300 IP 65)	IP 65
Ex degree of protection	–	EEx de IIC T6 tested to EN 50014/50018/50019 (CENELEC)
PTB approval Electrical connection	–	PTB 02 ATEX 1121
Cable entry	Plug connection to DIN 43 650 (200 series) or terminal connection (300 series)	Terminal connection
Ambient temperature	PG 11 / for terminal connection M 16 x 1.5	M 16 x 1.5
Switching point	See data sheets Adjustable via spindle. On switching device 300 the terminal box cover must be removed	–15 to +60°C Adjustable via spindle after the terminal box lid is removed
Switching differential		
Lead seal	Adjustable or not adjustable (see Product Summary)	Not adjustable
Medium temperature	Only possible on plug connection housing 200 Max. 70°C, briefly 85°C	Max. 60°C
Vacuum	Higher medium temperatures are possible provided the above limits for the switching device are ensured by suitable measures (e.g. siphon). All pressure switches can operate under vacuum. This will not damage the device.	
Repetition accuracy of switching points	< 1% of the working range (for pressure ranges > 1 bar)	
Vibration strength		
Mechanical life	No significant deviations up to 4 g. With sinusoidal pressure application and room temperature, 10 x 10 ⁶ switching cycles. The expected life depends to a very large extent on the type of pressure application, therefore this figure can serve only as a rough estimate. With pulsating pressure or pressure impacts in hydraulic systems, pressure surge reduction is recommended.	
Isolation values	Overvoltage category III, contamination class 3, reference surge voltage 4000 V.	
Oil and grease-free	Conformity to DIN VDE 0110 (01.89) is confirmed. The parts of all pressure switches with sensors made from steel or stainless steel are oil and grease-free. The sensors are hermetically encapsulated. They contain no seals. (See also additional function ZF 1979 Special Packing)	

ZF additional functions — Pressure switches and pressure monitors

Example for ordering:










DWR 6 – 205

- Code of additional function (e.g. maximum limiter)
- Code for pressure range
- Sensor system

How to order:

Pressure switch
DWR 6–205
or DWR 6
with ZF 205

Additional functions / Connection diagrams

	Plug connection 200 series (IP 54)	Terminal connection 300 series (IP 65)	Connection diagram	Explanation
Normal version (plug connection) Microswitch, single pole switching Switching differential not adjustable				
Terminal connection – housing (300)		...301		
Unit with adjustable switching differential	ZF 203			
Maximum limiter with reclosing lockout Interlocking with rising pressure	ZF 205			see DWR series
Minimum limiter with reclosing lockout Interlocking with falling pressure	ZF 206			see DWR series
Two microswitches , switching in parallel or in succession. Fixed switching interval, only possible with terminal connection housing. State the switching interval (not possible with all pressure switches, see data sheet p. 2, pp. 40 - 43)		ZF 307 *		
Two microswitches, 1 plug switching in succession. adjustable switching interval Please indicate switching scheme* (not possible with all pressure switches, see data sheet p. 2, pp. 40 – 43)	ZF 217 *			
Gold-plated contacts , single pole switching (not available with adjustable switching differential).	ZF 213			Permitted contact load: Max: 24 VDC, 100 mA Min: 5 VDC, 2 mA
Switch housing with surface protection (chemical version).		ZF 351		

*Switching point adjustment: Please specify **switching point and direction of action** (rising or falling pressure).




DWAM...-576

Additional functions for EEx-i equipment ZF 5...

- Housing (300) with terminal connection (IP 65), "blue" cable entry and terminals.
- Also available with resistor combination for line break and short-circuit monitoring (with isolating amplifier Ex 041).

Important:

All pressure switches with the ZF 5... additional functions listed here can only be operated in combination with a suitable isolating amplifier (see pages 60 – 61).



For ZF513, ZF576, ZF574:

$U_i = 15 \text{ V DC}$, $I_i = 60 \text{ mA}$,

$P_i = 0.9 \text{ W}$, $C_i < 1 \text{ nF}$, $L_i < 100 \text{ }\mu\text{H}$

Additional functions for EEx-i equipment	Connection diagram	Isolating amplifier
Gold-plated contacts , single-pole switching. Switching differential fixed (not adjustable). Switching capacity: max. 24 VDC, 100 mA, min. 5 VDC, 2 mA.	ZF 513 	Ex 011
Versions with resistor combination for line break and short-circuit monitoring in control current circuit, see DBS series, pages 54 – 56:		
Normally closed contact with resistor combination for maximum pressure monitoring , gold-plated contacts, plastic-coated housing (chemical version).	ZF 576 	Ex 041
Normally closed contact with reclosing lockout and resistor combination, for maximum pressure monitoring . Plastic-coated housing (chemical version).	ZF 577 	Ex 041
Normally closed contact with resistor combination for minimum pressure monitoring , gold-plated contacts, plastic-coated housing (chemical version).	ZF 574 	Ex 041
Normally closed contact with reclosing lockout and resistor combination, for minimum pressure monitoring . Plastic-coated housing (chemical version).	ZF 575 	Ex 041
Other additional functions	Plug connection 200 series	Terminal connection 300 series
Adjustment according to customer's instruction: one switching point two switching points or defined switching differential	ZF 1970* ZF 1972*	ZF 1970* ZF 1972*
Adjustment and lead sealing according to customer's instruction: one switching point two switching points or defined switching differential	ZF 1971* ZF 1973*	– –
Labelling of units according to customer's instruction with sticker	ZF 1978	ZF 1978
Special packing for oil and grease-free storage	ZF 1979	ZF 1979

Documents: Additional documents, e.g. data sheets, operating instructions, TÜV, DVGW or PTB certificates.

Test certificates according to EN 10 204

Factory certificate 2.2 based on non-specific specimen test	WZ 2.2	WZ 2.2
Acceptance test certificate 3.1 based on specific test	AZ 3.1	AZ 3.1
Acceptance test certificate for ZFV separating diaphragms	AZ 3.1 –V	AZ 3.1 –V

***Switching point adjustment:** Please specify **switching point and direction of action** (rising or falling pressure).



Setting instructions

Factory calibration of pressure switches


In view of tolerances in the characteristics of sensors and springs, and due to friction in the switching kinematics, slight discrepancies between the setting value and the switching point are unavoidable. The pressure switches are therefore calibrated in the factory in such a way that the setpoint adjustment and the actual switching pressure correspond as closely as possible in the middle of the range. Possible deviations spread to both sides equally.

The device is calibrated either for falling pressure (calibration at lower switching point) or for rising pressure (calibration at higher switching point), depending on the principal application of the type series in question.

Where the pressure switch is used at other than the basic calibration, the actual switching point moves relative to the set switching point by the value of the average switching differential. As FEMA pressure switches have very small switching differentials, the customer can ignore this where the switching pressure is set only roughly. If a very precise switching point is needed, this must be calibrated and checked in accordance with normal practice using a pressure gauge.


1. Calibration at lower switching point

Setpoint x_s corresponds to the lower switching point, the upper switching point x_o is higher by the amount of the switching differential x_d .




2. Calibration at upper switching point

Setpoint x_s corresponds to the upper switching point, the lower switching point x_u is lower by the amount of the switching differential x_d .



The chosen calibration type is indicated in the technical data for the relevant type series.



Clockwise:
lower switching
pressure


Anticlockwise:
higher switching
pressure

**Direction of action of setting
spindle**

Setting switching pressures

Prior to adjustment, the securing pin above the scale must be loosened by not more than 2 turns and retightened after setting. The switching pressure is set via the spindle. The set switching pressure is shown by the scale.

To set the switching points accurately it is necessary to use a pressure gauge.

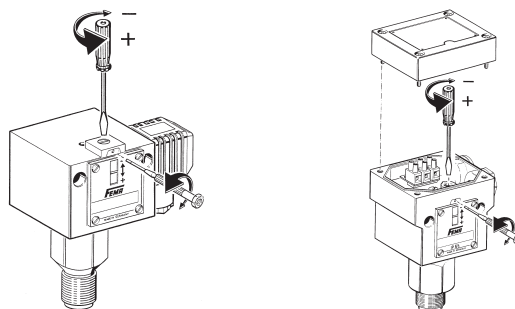


Changing the switching differential (only for switching device with suffix "V", ZF 203)

By means of setscrew within the spindle. The lower switching point is not changed by the differential adjustment; only the upper switching point is shifted by the differential. One turn of the differential screw changes the switching differential by about 1/10 of the total differential range. The switching differential is the hysteresis, i.e. the difference in pressure between the switching point and the reset point.

Lead seal of setting spindle (for plug connection housing 200 only)

The setting spindle for setting the desired value and switching differential can be covered and sealed with sealing parts available as accessories (type designation: P2) consisting of a seal plate and capstan screw. The sealing parts may be fitted subsequently. The painted calibration screws are likewise covered.



Clockwise:
greater
difference
Anticlockwise:
smaller
difference

**With pressure switches of the
DWAMV and DWR...-203 series,
the direction of action of the
differential screw is reversed.**



Pressure switch with locking of switching state (reclosing lockout)


In the case of limiter functions, the switching state must be retained and locked, and only unlocked and the system restarted once the cause of the safety shutdown has been eliminated. There are two ways of doing this:

1. Mechanical locking inside the pressure switch

Instead of a microswitch with automatic reset, limiters contain a "bistable" microswitch. If the pressure reaches the value set on the scale, the microswitch trips over and remains in this position. The lock can be released by pressing the unlocking button (identified by a red dot on the scale side of the switching device). The interlock can operate with rising or falling pressure depending on the version.

The device can only be unlocked when the pressure has been reduced (or increased) by the amount of the predefined switching differential. When selecting a pressure limiter, it is necessary to distinguish between maximum and minimum pressure monitoring. EEx-d versions cannot be equipped with internal locking.


Maximum pressure limitation



Switching and interlocking with rising pressure. Additional function ZF 205.

Connection of control current circuit to terminals 1 and 3.

Minimum pressure limitation




Switching and interlocking with falling pressure. Additional function ZF 206.

Connection of control current circuit to terminals 2 and 3.


2. External electrical interlock in the control cabinet (suggested circuits)

A pressure monitor (microswitch with automatic reset) can also be used as a limiter if an electrical interlock is added. For pressure limitation in steam and hot water boilers, an external interlock is only permitted if it has been ascertained that the pressure monitor is "of special construction".

Maximum pressure limitation with external interlock

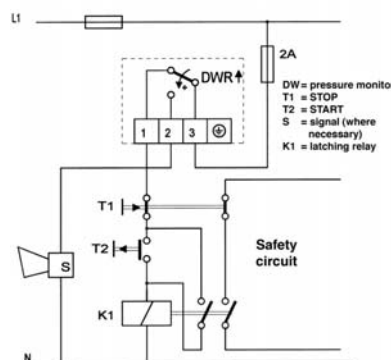

Minimum pressure limitation with external interlock

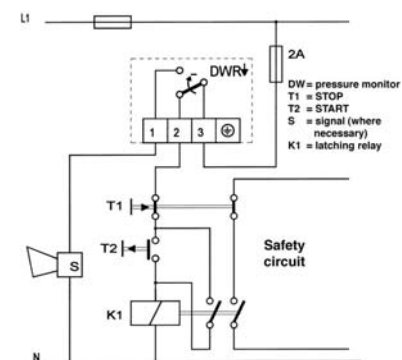

Where the above interlock circuit is used, the requirements of DIN 57 116/VDE 0116 are met if the electrical equipment (such as contactors or relays) of the external interlock circuit satisfy VDE 0660 or VDE 0435.

Explanation of type designations – type codes



The type designations of FEMA pressure switches consist of a combination of letters followed by a number denoting the setting range. Additional functions and version variants are indicated by a code which is separated from the basic type by a hyphen. Ex versions (explosion protection EEx-d) are identified by the prefix “Ex” in front of the type designation.

Basic version (based on the example of DCM series)	with additional function	Ex-version
DCM XXX	DCM XXX-YYY	Ex-DCM XXX

DCM	→	Series code (e.g. DCM)
XXX	→	Codes for pressure range
YYY	→	Code for additional functions
Ex	→	Code for Ex version

Switch housing version	
DCM XXX	Basic version with plug connection housing
DCM XXX-2...	Basic version with plug connection housing
DCM XXX-3...	Terminal connection housing (300)
Ex-DCM XXX	EEx-d switching device (700)
DCM XXX-5...	EEx-i version

Which additional function goes with which pressure switch?

	Plug connection, 200 series 			Terminal connection, 300 series 					
	Additional function ZF			Additional function ZF					
	203	213	217	301	307	513	574 576	575 577	EEx-d
DCM/VCM	• ¹	•	• ¹	•	• ¹	•			•
VNM/DNS/VNS	•	•	•	•	•	•			•
DWAM		•		•	•	•	•	•	
DDCM		•	• ²	•	• ²	•			•
DWR	•	•		•		•	•	•	•
DGM		•		•		•	•	•	•

• available

¹ except DCM 4016, DCM 4025, VCM 4156 and DCM 1000

² except DDCM 252, 662, 1602, 6002

Ex-versions (EEx-d) can only be supplied in basic form.
Additional functions are not possible.



DCM 025

DCM pressure switches and pressure monitors

for overpressure, for non-aggressive liquid and gaseous media



DCM 25

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) according to DIN 16 288 and internal thread G 1/4 according to ISO 228 Part 1.

Switching device

Robust housing (200) made of seawater-resistant diecast aluminium GD Al Si 12.

Degree of protection

IP 54, in vertical position.

Pressure sensor materials

DCM 3...DCM 63 Metal bellows: 1.4571
Sensor housing: 1.4104
DCM 025 – DCM 1 Metal bellows: Cu Sensor housing: Cu + Ms
DCM 4016/ Diaphragm: Perbunan
DCM 4025 Sensor housing: 1.4301
DCM 1000 Diaphragm: Perbunan Sensor housing: Brass

Mounting position

Vertically upright and horizontal. DCM 4016 and 4025 vertically upright.

Ambient temp. at switching device

–25...+70 °C, except: DCM 4016, 4025, 1000: –15...+60 °C
For EEx-d versions: –15...+60 °C

Max. medium temperature

The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods (not EEx-d). Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge-connection) or on a flat surface with two 4 mm Ø screws.

Switching pressure

Adjustable from outside with screwdriver.

Switching differential

Not adjustable with DCM and Ex-DCM types. Adjustable from outside with DCM-203 types. For values see Product Summary.

Contact arrangement

Single-pole changeover switch.

Switching capacity	250 VAC (ohm)	(ind)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A	8 A
EEx-d	3 A	2 A	0.03 A	3 A

Type	Setting range	Switching differential (mean values)	Max. permissible pressure	Materials in- contact with medium	Dimen- sioned drawing
------	---------------	---	---------------------------------	---	-----------------------------

Switching differential not adjustable

DCM 4016	1...16 mbar	2 mbar	1 bar	Perbunan	1 + 11
DCM 4025	4...25 mbar	2 mbar	1 bar	+ 1.4301	
DCM 1000	10...100 mbar	12 mbar	10 bar	Perbunan + MS	1 + 10
DCM 025	0.04...0.25 bar	0.03 bar	6 bar	Cu + Ms	1 + 14
DCM 06	0.1...0.6 bar	0.04 bar	6 bar		
DCM 1	0.2...1.6 bar	0.04 bar	6 bar		
DCM 506	15...60 mbar	10 mbar	12 bar		1 + 12
DCM 3	0.2...2.5 bar	0.1 bar	16 bar		1 + 18
DCM 6	0.5...6 bar	0.15 bar	16 bar		
DCM 625	0.5...6 bar	0.25 bar	25 bar		
DCM 10	1...10 bar	0.3 bar	25 bar	1.4104	1 + 17
DCM 16	3...16 bar	0.5 bar	25 bar	+	
DCM 25	4...25 bar	1.0 bar	60 bar	1.4571	1 + 16
DCM 40	8...40 bar	1.3 bar	60 bar		
DCM 63	16...63 bar	2.0 bar	130 bar		

Switching differential adjustable

DCM 025-203	0.04...0.25 bar	0.03...0.4 bar	6 bar	Cu + Ms	1 + 14
DCM 06-203	0.1...0.6 bar	0.04...0.5 bar	6 bar		
DCM 1-203	0.2...1.6 bar	0.07...0.55 bar	6 bar		
DCM 3-203	0.2...2.5 bar	0.15...1.5 bar	16 bar		1 + 18
DCM 6-203	0.5...6 bar	0.25...2.0 bar	16 bar		
DCM 10-203	1...10 bar	0.5...2.8 bar	25 bar		
DCM 16-203	3...16 bar	0.7...3.5 bar	25 bar	1.4104	1 + 17
DCM 25-203	4...25 bar	1.3...6.0 bar	60 bar	+	
DCM 40-203	8...40 bar	2.6...6.6 bar	60 bar	1.4571	1 + 16
DCM 63-203	16...63 bar	3.0...10 bar	130 bar		

For smaller pressure ranges see also VCM, DGM, HCD and DPS sheets.

For additional functions refer to ZF data sheet.

Ex version, (housing 700), explosion protection EEx-d

Ex-DCM 4016	1...16 mbar	2 mbar	1 bar	Perbunan	3 + 11
Ex-DCM 4025	4...25 mbar	2 mbar	1 bar	Perbunan	3 + 11

For other Ex-devices, see type series VCM, DNM, DNS, DDCM, DWR, DGM described below.

Calibration

The **DCM** series is calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).



Degree of protection:
IP 54



VCM type series

Negative pressure switches (vacuum switches)

FEMA negative pressure switches detect the pressure difference relative to atmospheric pressure. All data relating to the setting range and thus also the scale divisions on the switching devices are to be understood as the difference in pressure between the relevant atmospheric pressure and the set switching pressure.

The "zero" reference point on the scale of the unit corresponds to the relevant atmospheric pressure. A minus sign before the pressure value signifies negative pressure below the relevant atmospheric pressure.

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) according to DIN 16 288 and internal thread G 1/4 according to ISO 228 Part 1.

Switching device

Robust housing (200) made of seawater-resistant diecast aluminium GD Al Si 12.

Degree of protection

IP 54, in vertical position.
IP 65, for EEx-d version.

Pressure sensor materials

VNM 111 and VNM 301: Metal bellows: 1.4571
Sensor housing: 1.4104
VCM 095, 101 and 301: Metal bellows of Cu Zn
Sensor housing of Cu Zn
VCM 4156: Perbunan diaphragm sensor housing: 1.4301

Mounting position

Vertically upright and horizontal.
VCM 4156 vertically upright.

Ambient temp. at switching device

-25...+70 °C
For EEx-d versions: -15...+60 °C

Max. medium temperature

The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods (not EEx-d). Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge-connection) or on a flat surface with two 4 mm Ø screws.

Switching pressure

Adjustable from outside with screwdriver.

Switching differential

Not adjustable with VCM and Ex-VCM types.
Adjustable with VCM-203 type.
For values see Product Summary.

Contact arrangement

Single-pole changeover switch.

Switching capacity	250 VAC (ohm)	250 VDC (ind)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A	8 A
EEx-d	3 A	2 A	0.03 A	3 A

Product Summary

Type	Setting range	Switching differential (mean values)	Max. permissible pressure	Dimensioned drawing
------	---------------	---	---------------------------	---------------------

Switching differential not adjustable

VCM 4156	-15...+6 mbar	2 mbar	1 bar	1 + 11
VCM 301	-250...+100 mbar	25 mbar	1.5 bar	1 + 13
VNM 301	-250...+100 mbar	45 mbar	3 bar	1 + 15
VCM 101	-1*...+0.1 bar	45 mbar	3 bar	1 + 14
VCM 095	-0.9...+0.5 bar	50 mbar	3 bar	1 + 14
VNM 111	-1*...+0.1 bar	50 mbar	6 bar	1 + 15

Switching differential adjustable

VCM 301-203	-250...+100 mbar	30-200 mbar	1.5 bar	1 + 13
VNM 301-203	-250...+100 mbar	70-500 mbar	3 bar	1 + 15
VCM 101-203	-1*...+0.1 bar	80-350 mbar	3 bar	1 + 14
VCM 095-203	-0.9...+0.5 bar	90-400 mbar	3 bar	1 + 14
VNM 111-203	-1*...+0.1 bar	90-650 mbar	6 bar	1 + 15



version, (housing 700), explosion protection EEx-d

Ex-VCM 4156	-15...+6 mbar	2 mbar	1 bar	3 + 11
Ex-VCM 301	-250...+100 mbar	25 mbar	1.5 bar	3 + 13
Ex-VNM 301	-250...+100 mbar	45 mbar	3 bar	3 + 15
Ex-VCM 101	-1*...+0.1 bar	45 mbar	3 bar	3 + 14
Ex-VCM 095	-0.9...+0.5 bar	50 mbar	3 bar	3 + 14
Ex-VNM 111	-1*...+0.1 bar	50 mbar	6 bar	3 + 15

* At very high vacuums, close to the theoretical maximum of -1 bar, the switch may not be usable in view of the special conditions of vacuum engineering. However, the pressure switch itself will not be damaged at maximum vacuum.

For additional functions refer to ZF data sheet.

For smaller pressure ranges see also HCD and DPS data sheets.

Calibration

The **VCM** and **VNM** series are calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).



Degree of protection:
IP 54/65



DNM 025

DNM type series

Pressure switches free of non-ferrous metal

All parts of the DNM series of FEMA pressure switches which come into contact with the medium are made of stainless steel. The pressure sensor is welded according to the latest methods without filler metals.

The diecast aluminium switch housing is also highly resistant to aggressive influences in the surrounding atmosphere.

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) according to DIN 16 288 and internal thread G 1/4 according to ISO 228 Part 1.

Switching device

Robust housing (200) made of seawater-resistant diecast aluminium GD Al Si 12.

Degree of protection

IP 54, in vertical position.
IP 65, for EEx-d version.

Pressure sensor materials

Sensor housing 1.4104
Pressure bellows: 1.4571

Mounting position

Vertically upright and horizontal.

Ambient temperature at switching device

-25...+70 °C.
For EEx-d versions: -15...+60 °C

Max. medium temperature

The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods (not EEx-d). Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge connection) or on a flat surface with two 4 mm Ø screws.

Switching pressure

Adjustable from outside with screwdriver.

Switching differential

Not adjustable with DNM and Ex-DNM types.

Contact arrangement

Single-pole changeover switch.

Switching capacity	250 VAC (ohm)	250 VAC (ind)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A	8 A
EEx-d	3 A	2 A	0.03 A	3 A

Product Summary

Type	Setting range	Switching differential (mean values)	Max. permissible pressure	Dimensioned drawing
Switching differential not adjustable				
DNM 025	0.04...0.25 bar	0.03 bar	6 bar	1 + 15
Ex version, (housing 700), explosion protection EEx-d				
Ex-DNM 10	1...10 bar	0.3 bar	16 bar	3 + 17
Ex-DNM 63	16...63 bar	1.0 bar	130 bar	3 + 16

Calibration

The DNM series is calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).



DNS type series

Pressure switch with stainless steel sensor system, with optional plastic-coated housing

Pressure switches of the DNS series are suitable for monitoring and controlling pressures in chemical plants, process engineering and any situation where the pressure of aggressive liquids and gases must be monitored.

All components of the sensor system are made from high-quality stainless steel (1.4571) and welded using the latest methods without filler metals. The pressure sensor is hermetically encapsulated and contains no sealing materials.

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) according to DIN 16 288 and internal thread G 1/4 according to ISO 228 Part 1.

Switching device

Robust housing (200) made of seawater-resistant diecast aluminium GD Al Si 12.

Degree of protection

IP 54, in vertical position.
IP 65, for EEx-d version.

Pressure sensor materials

Pressure bellows and all parts in contact with medium. X 6 Cr Ni Mo Ti 17122 Material no. 1.4571

Mounting position

Vertically upright and horizontal.

Max. ambient temperature at switching device

-25...+70 °C.
For EExd versions: -15...+60 °C.

Max. medium temperature

The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods (not EEx-d). Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge-connection) or on a flat surface with two 4 mm Ø screws.

Switching pressure

Adjustable from outside with screwdriver.

Switching differential

For values see Product Summary.

Contact arrangement

Single-pole changeover switch.

Switching capacity	250 VAC (ohm)	250 VDC (ind)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A
EEx-d	3 A	2 A	0.03 A

Plastic coating

The diecast aluminium housing in GD Al Si is chromated and stove-enamelled with resistant plastic. Corrosion tests with 3% saline solution and 30 temperature changes from +10 to +80°C showed no surface changes after 20 days.

Product Summary

Type	Setting range	Switching differential (mean values)	Max. permissible pressure	Dimensioned drawing
Switching differential not adjustable				
VNS 301-201	-250...+100 mbar	45 mbar	3 bar	1 + 15
VNS 111-201	-1*...+0.1 bar	50 mbar	6 bar	
DNS 025-201	0.04...0.25 bar	30 mbar	6 bar	
DNS 06-201	0.1...0.6 bar	40 mbar	6 bar	
DNS 1-201	0.2...1.6 bar	60 mbar	6 bar	1 + 18
DNS 3-201	0.2...2.5 bar	0.1 bar	16 bar	
DNS 6-201	0.5...6 bar	0.15 bar	16 bar	
DNS 10-201	1...10 bar	0.3 bar	16 bar	1 + 16
DNS 16-201	3...16 bar	0.5 bar	25 bar	

...-203 types Adjustable switching differential

Plastic-coated housing

VNS 301-351	-250...+100 mbar	45 mbar	3 bar	2 + 15
VNS 111-351	-1*...+0.1 bar	50 mbar	6 bar	
DNS 025-351	0.04...0.25 bar	30 mbar	6 bar	
DNS 06-351	0.1...0.6 bar	40 mbar	6 bar	
DNS 1-351	0.2...1.6 bar	60 mbar	6 bar	2 + 18
DNS 3-351	0.2...2.5 bar	0.1 bar	16 bar	
DNS 6-351	0.5...6 bar	0.15 bar	16 bar	
DNS 10-351	1...10 bar	0.3 bar	16 bar	2 + 16
DNS 16-351	3...16 bar	0.5 bar	25 bar	



version, (housing 700), explosion protection EEx-d

Ex-VNS 301	-250...+100 mbar	45 mbar	3 bar	3 + 15
Ex-VNS 111	-1*...+0.1 bar	50 mbar	6 bar	
Ex-DNS 025	0.04...0.25 bar	30 mbar	6 bar	
Ex-DNS 06	0.1...0.6 bar	40 mbar	6 bar	
Ex-DNS 1	0.2...1.6 bar	60 mbar	6 bar	3 + 18
Ex-DNS 3	0.2...2.5 bar	0.1 bar	16 bar	
Ex-DNS 6	0.5...6 bar	0.15 bar	16 bar	
Ex-DNS 10	1...10 bar	0.3 bar	16 bar	3 + 16
Ex-DNS 16	3...16 bar	0.5 bar	25 bar	

Explosion protection EEx-i with ZF 513

Example for ordering: DNS...-513

* At very high vacuums, close to the theoretical maximum of -1 bar, the switch may not be usable in view of the special conditions of vacuum engineering. However, the pressure switch itself will not be damaged at maximum vacuum.

Calibration

The **DNS** and **VNS** series are calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).



Degree of protection:
IP 54/65



Ex-DDCM

DDCM 252

DDCM type series

Differential pressure switch

FEMA differential pressure switches are suitable for monitoring and controlling differential pressures, flow monitoring and automatic control of filter systems. A double chamber system with stainless steel bellows or Perbunan diaphragm accurately detects the difference between the two applied pressures. The desired switching pressure is continuously adjustable within the ranges mentioned in the type summary.

The settings relate to the lower switching point (with falling differential pressure). The upper switching point (with rising differential pressure) is higher by the amount of the switching differential. All differential pressure monitors can also be used in the vacuum range. Every pressure switch has 2 pressure connections with appropriate markings.

Technical data

Pressure connection
Internal thread G 1/4

Switching device
Robust housing (200) made of seawater-resistant diecast aluminium GD Al Si 12.

Degree of protection
IP 54, in vertical position.
IP 65, for EEx-d version.

Pressure sensor materials
DDCM 014–16:
Pressure bellows of 1.4571
Sensor housing of 1.4305.
DDCM 252–6002:
Perbunan diaphragm.
Aluminium sensor housing.

Mounting position
vertically upright.

Ambient temperature at switching device
–25...+70 °C
For EEx-d versions: –15...+60 °C

Max. medium temperature
The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods (not EEx-d). Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting
Directly on the pressure line or on a flat surface with two 4 mm Ø screws.
Note the connection of pressurized lines:
P (+) = high pressure
S (–) = low pressure

Switching pressure
Adjustable from outside with screwdriver.

Switching differential
Not adjustable. For values see Product Summary.

Scale
Types 252–6002 without graduation. Set according to pressure gauge.

Switching capacity	250 VAC (ohm)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A
EEx-d	3 A	2 A	0.03 A

Product Summary

Type	Setting range (differential pressure)	Switching differential (mean values)	Max.** permissible pressure	Materials in- contact with medium	Dimen- sioned drawing
Switching differential not adjustable					
DDCM 252*	4...25 mbar	2 mbar	0.5 bar	Aluminium + Perbunan	1 + 20
DDCM 662*	10...60 mbar	15 mbar	1.5 bar		
DDCM 1602*	20...160 mbar	20 mbar	3 bar		
DDCM 6002*	100...600 mbar	35 mbar	3 bar		
DDCM 014*	–0.1...0.4 bar	0.15 bar	15 bar	Stainless steel 1.4305 + 1.4571	1 + 21
DDCM 1	0.2...1.6 bar	0.13 bar	15 bar		
DDCM 4*	1...4 bar	0.20 bar	25 bar		
DDCM 6	0.5...6 bar	0.2 bar	15 bar		
DDCM 16	3...16 bar	0.6 bar	25 bar		

* without graduation (only ± scale).

** also loadable on one side

For smaller pressure ranges see also HCD and DPS datasheets.

Type	Setting range (differential pressure)	Switching differential (mean values)	Max.** permissible pressure	Materials in- contact with medium	Dimen- sioned drawing
Ex version · Explosion protection EEx de IIC T6					
Ex-DDCM 252*	4...25 mbar	2 mbar	0.5 bar	Aluminium + Perbunan	3 + 20
Ex-DDCM 662*	10...60 mbar	15 mbar	1.5 bar		
Ex-DDCM 1602*	20...160 mbar	20 mbar	3 bar		
Ex-DDCM 6002*	100...600 mbar	35 mbar	3 bar		
Ex-DDCM 014*	–0.1...0.4 bar	0.15 bar	15 bar	Stainless steel 1.4305 + 1.4571	3 + 21
Ex-DDCM 1	0.2...1.6 bar	0.13 bar	15 bar		
Ex-DDCM 4*	1...4 bar	0.2 bar	25 bar		
Ex-DDCM 6	0.5...6 bar	0.2 bar	15 bar		
Ex-DDCM 16	3...16 bar	0.6 bar	25 bar		

* without graduation (only ± scale)

** also loadable on one side

- Accessories:**
- Threaded joint with male adapter union G 1/4"/8 mm MAU 8/Ms and MAU 8/Nst, page 63
 - Valve combinations VKD 3 and VKD 5, page 63

Calibration

The **DDCM** series is calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).



Degree of protection:
IP 54/65



DPS

DPS series

Differential pressure switches for ventilation and air-conditioning systems

Applications

Differential pressure switches for filter, fan or air flow monitoring in air-conditioning and ventilation systems.

Technical data

Pressure connection

Plastic connection piece with 6 mm external diameter for measuring hose with 5 mm internal diameter. Connector P 1 for higher pressure, P 2 for lower pressure.

Pressure medium

Air, and non-combustible and non-aggressive gases.

Diaphragm

made of sintered silicone is resistant to out-gassing. Switching kinematics on the "P2" side.

Switch housing and parts in contact with medium

Switch housing and pressure connection P 2 made of PA 6.6. Lower part and pressure connection P 1 made of POM.

Medium and ambient temperature

–20°C to +85°C
(storage temperature –40°C to +85°C)

Maximum working pressure

50 mbar for all types.

Mounting position

vertical, pressure connections pointing downwards. (With horizontal mounting and cover facing upwards, the scale values are 20 Pa below the actual values; with horizontal mounting and cover facing downwards, the scale values are 20 Pa higher. At setting values below 50 Pa, the device must be mounted vertically!).

Degree of protection: IP 54

Mounting

Via fastening pieces integrated into the housing with 2 screws, mounted directly onto a vertical surface, e.g. of the airconditioning unit or air duct. For mounting in the ceiling area, use an L-shaped bracket if necessary.


Setting the switching point

Remove the cover and set the scale to the desired value. The setting values relating to the upper switching point (for maximum pressure monitoring). For minimum pressure monitoring, the switching point lies below the setting value, according to the switching differential.

Weight: 160 g

Switching function: single pole switching.

Electrical connection



Flat plug 6.3 x 0.8 DIN 46 244 or use the screw terminals supplied.

Min. switching capacity: 5 mA / 5 VDC

Max. switching capacity: 1.5 (0.4) A / 250 VAC

Cable entry: Pg 11



Product Summary

Type	Setting range for upper switching	Switching differentials (guideline values)
DPS 200 F	0.2...2 mbar	0.1 mbar
DPS 400 F	0.4...4 mbar	0.2 mbar
DPS 500 F	0.5...5 mbar	0.2 mbar
DPS 1000 F	2...10 mbar	1 mbar
DPS 2500 F	5...25 mbar	1.5 mbar

DVGW test certificate

EC type testing according to EC Gas Appliance Directive (90/396 EEC) and DIN EN 1854, product identification number **CE-0085AR0013**


+ Supplied accessories:

2 m silicone hose, 2 connection pieces with mounting screws,
2 self-tapping screws for mounting the housing,
3 screw terminals for the electrical connection

+ Optional accessories:

DPSLF L-shaped bracket for installation turned through 90°, e.g. in ceiling area
DPSJF Channel connection fitting

Dimensioned drawing

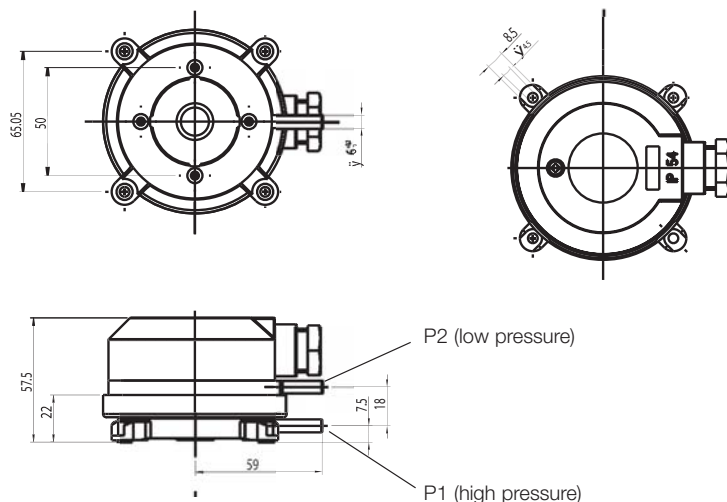

DVGW
tested

Degree of protection:
IP 54



(according to Gas Appliance
Directive 90/396/EEC)



HCD

HCD series

Pressure and differential pressure switches for neutral gases (DVGW-tested)

Pressure switches of the HCD series are suitable for neutral and non-aggressive gases. They can be used for monitoring overpressure and differential pressure. For overpressure detection the pressure side is connected to the lower connection piece G 1/4"; for vacuum detection the pressure side is connected to the upper

connection piece G 1/8" (remove sealing chamber). For differential pressure detection the high pressure is applied to the lower connection piece (G 1/4") and the low pressure side to the upper connection piece (G 1/8"). A pressure measurement connector (9 mm \varnothing) is available for accurate setpoint adjustment.

Technical data

Pressure connection

Pressure connection for overpressure:
G 1/4" internal thread.
For vacuum and differential pressure:
G 1/8" internal thread.

Switch housing

Diecast aluminium.

Medium temperature

-15 to +60 °C.

Maximum working pressure

See Product Summary

Mounting position

Horizontal with connection pieces pointing downwards.

Type of protection IP 40 according to DIN 40050.

Mounting


Either directly on pipe or with mounting bracket (supplied) on a vertical surface.

Setting the switching point

Remove the cover and turn the setting spindle marked +/- in the corresponding direction. The scale shows only guideline values. For accurate setpoint adjustment it is necessary to use a pressure gauge which can be attached to the measuring point (9 mm \varnothing pressure measurement connector).

Switching function Single pole switching.

Electrical connection



Switching capacity

2 A/220-240 VAC (inductive load)
10 A/220-240 V AC (resistive load)


Cable entry Pg 13.5

Tested according to Gas Appliance Directive 90/396/EEC, DVGW reg. no. E 3085/2.

Type	Setting range	Switching differential		Max. working pressure
		in lower range	in upper range	
HCD 6003	0.2...3 mbar	0.3... mbar	0.5 mbar	100 mbar
HCD 6010	1...10 mbar	0.3... mbar	1 mbar	100 mbar
HCD 6050	5...50 mbar	1.5... mbar	3 mbar	200 mbar
HCD 6150	15...150 mbar	4... mbar	10 mbar	300 mbar

The switching differential is not adjustable. The low switching differentials are for the lower setting range; the higher values relate to the upper ranges.

Dimensioned drawing

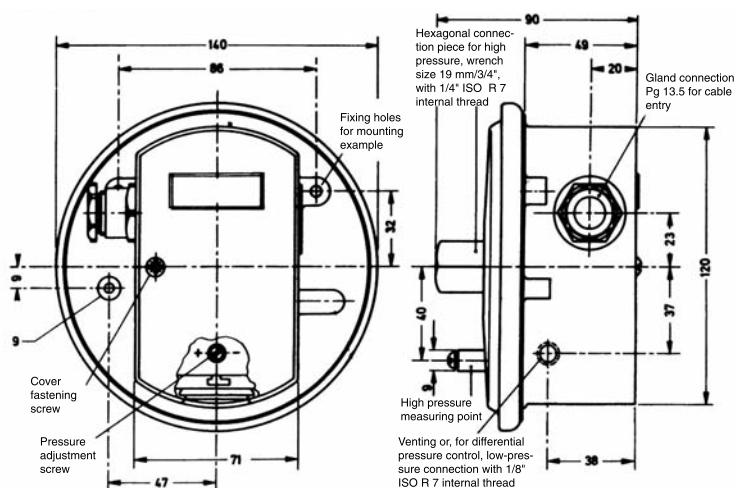

GASTEC
tested

Degree of protection:
IP 40

S2 type series

Pressure switches with 2 microswitches – technical data

FEMA pressure switches of the **DCM** (except DCM 1000, DCM 4016 and DCM 4025), **VCM** (except VCM 4156), **VNM**, **DNS**, **VNS** series and the differential pressure monitor **DDCM** (except DDCM 252, 662, 1602, 6002) can be

equipped with 2 microswitches (see also the table on page 41).

This is not possible with any other type series or with Ex versions.

Technical data

Standard equipment

The standard equipment of every two-stage pressure switch includes a switching device with 2 microswitches, both single-pole switching. Switch I monitors the low pressure, switch II the higher pressure. The setting ranges indicated in the data sheets for the basic types apply to the two-stage pressure switches as well. It should be noted that the switching differentials of the individual microswitches may not be exactly the same due to component tolerances.

Switching interval

The switching interval of the two microswitches is the difference (in bar or mbar) between the switching points of the two microswitches.

For example:

When the pressure rises, a two-stage pressure switch turns on a warning light (e.g. 2.8 bar), and if the pressure continues to rise (e.g. 3.2 bar) the system shuts down. The switching interval is $3.2 - 2.8 = 0.4$ bar. For all versions the rule is:

The switching interval remains constant over the whole setting range of the pressure switch. If the switching pressure setting is changed with the setting spindle, the switching interval does not change – the switching points are moved in parallel.





Switching differential

The switching differential, i.e. the hysteresis of the individual microswitches, corresponds to the values of the relevant basic design referred to in the Product Summary. In the case of two-stage pressure switches, **the switching differential of the individual microswitches is not adjustable.**

Versions

Two-stage pressure switches are available in three different versions, each identified by a ZF number. The versions differ in terms of their connection schemes and electrical connection types (terminal or plug connection).


The applicable data sheet for the basic types contains the technical data for the two-stage pressure switches. This includes all limits of use, temperature, maximum pressure, mounting position, type of protection, electrical data etc. The principal dimensions are the same as for single-stage pressure switches, with similar pressure ranges and design features.

Additional function	Switching interval between the two microswitches	Electrical connection	Connection diagram	Ordering information required
ZF 307 	Factory setting according to customer-specifications	Terminal connection (All terminals of both microswitches are accessible (6 terminals))	2 x single pole switching. 	1. Basic type with ZF 307 2. Switching points I and II, with direction of action in each case (rising or falling pressure). Example: DCM 16-307 Switching point I: 10 bar falling Switching point II: 12 bar falling or switching interval only.
ZF 217 	Adjustable via adjustment knobs I and II according to "Switching intervals" table	Plug connection according to DIN 43 650 (3-pole + ground conductor) Function-appropriate internal wiring according to "Switching functions" table	Example selection according to "Switching schemes" table, page 42. 	1. Basic type with ZF 217 2. Switching scheme Example: DCM 16-217/B 4 Since all values are adjustable within the specified limits, no further data is required.

S2 type series (selection)

ZF 217 pressure switches with two microswitches and switching intervals

Switching intervals of two-stage pressure switches (ZF 217, ZF 307)

Type series S2 ZF 217 ZF 307	min. switching interval	 higher pressure lower pressure		
		max. switching interval (average values)		
Type	Factory default	Switching scheme A1/A3/B2/B4 C1/C3/D2/D4 + ZF 307	Switching scheme A2/A4/C2/C4	Switching scheme B1/B3/D1/D3
DCM 06	40 mbar	165 mbar	190 mbar	140 mbar
DCM 025	20 mbar	140 mbar	160 mbar	120 mbar
DCM 1	40 mbar	240 mbar	280 mbar	200 mbar
DCM 3	0.1 bar	0.65 bar	0.75 bar	0.55 bar
DCM 6	0.15 bar	0.95 bar	1.2 bar	0.8 bar
DCM 10	0.25 bar	1.6 bar	1.85 bar	1.35 bar
DCM 16	0.3 bar	2.0 bar	2.3 bar	1.7 bar
DCM 25	0.6 bar	4.0 bar	4.6 bar	3.4 bar
DCM 40	0.9 bar	6.0 bar	6.9 bar	5.1 bar
DCM 63	1.3 bar	8.5 bar	9.8 bar	7.2 bar
DDCM 1	0.09 bar	0.55 bar	0.64 bar	0.46 bar
DDCM 6	0.14 bar	0.94 bar	1.08 bar	0.8 bar
DNM 025	35 mbar	215 mbar	240 mbar	180 mbar
VCM 095	40 mbar	300 mbar	340 mbar	260 mbar
VCM 101	40 mbar	260 mbar	300 mbar	220 mbar
VCM 301	20 mbar	100 mbar	120 mbar	80 mbar
VNM 111	50 mbar	310 mbar	360 mbar	260 mbar

Switching devices with adjustable switching interval

Additional function ZF 217


On switching devices with additional function ZF 217, the switching interval is continuously adjustable via two adjustment knobs I and II accessible from outside. The maximum switching intervals are stated in the "Switching intervals" table.

Turning adjustment knob I clockwise produces a lower switching point for microswitch I.

Turning adjustment knob II anticlockwise produces a higher switching point for microswitch II.

Adjustment knobs I and II have an internal stop to prevent the microswitches from being adjusted beyond the effective range.

Adding together the adjustments on knobs I and II gives the switching interval between the two microswitches. Changes made with the setting spindle do not affect the switching interval. The switching interval remains constant over the whole setting range of the spindle. The two switching points are moved up or down in parallel.



Recommended adjustment method for switching devices with ZF 217

- Set adjustment knobs I and II to their basic positions.
Turn adjustment knob I as far as possible anticlockwise.
Turn adjustment knob II as far as possible clockwise.
- Adjust the setting spindle **S** by the scale to a value midway between the desired upper and lower switching points.
- With pressure applied, set the lower switching point with adjustment knob I.
- In the same way as in step 3, set the upper switching point with adjustment knob II.
- If the desired upper and lower switching points cannot be reached, turn the setting spindle **S** in the appropriate direction and repeat steps 3 and 4.

S2 type series

Two-stage pressure switches, switching schemes for ZF 217

Function-appropriate internal configuration of microswitches I and II, switching scheme selection table. The switch position shown corresponds to the pressureless state. On the horizontal axis is the switching function of microswitch I (A–D); on the vertical axis is the switching function of microswitch II (1–4). At the intersection is the switching scheme which satisfies both conditions (e.g. A 2).

Microswitch I (lower switching point)				
	A falling, close	B rising, close	C falling, open	D rising, open
1 falling, close				
2 rising, close				
3 falling, open				
4 rising, open				

Information required when ordering:

As well as the basic type (e.g. DCM 10) and the switching scheme (e.g. A 2), for factory setting it is also necessary to indicate the switching points and direction of action:


Example: DCM 10–217 / A 2 Switch I: 6.5 bar falling, Switch II: 7.5 bar rising.

S2 type series

Examples of use for two-stage pressure switches

Pressure monitoring and controlling can be greatly simplified by using pressure monitors with two built-in microswitches which can be made to operate one after the other under rising or falling pressure. For example, minimum and maximum pressure monitoring can be achieved with only **one** pressure switch, doing away with the need for a second pressure switch (including the cost of installation). Step switching, e.g. pressure-dependent control of a two-stage pump, is of course also possible using this special series.

For pressure-dependent control of automatic expansion valves and pressure holding devices

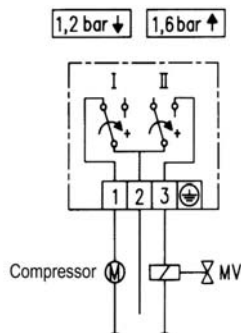

Example 1:

Requirement

Pressure holding devices and automatic expansion valves usually have a gas cushion whose pressure must be kept constant within a certain range. If the pressure is too low, a compressor is switched on. If the pressure is too high, a solenoid valve must be opened to vent the gas. Between these two levels is a neutral zone, in which the compressor and the solenoid valve are at rest.

Solution


All pressure switches of types DCM, DNM, DNS, each with additional function ZF 217 and switching scheme A 2, are suitable. All pressure ranges listed in the technical documents are possible. Example for ordering: DCM 6-217/A 2

Switching function / connection scheme

Switch I: With falling pressure, contact 1–2 closes (compressor on)
With rising pressure, contact 1–2 opens (compressor off)

Switch II: With rising pressure, contact 2–3 closes (valve open)
With falling pressure, contact 2–3 opens (valve closed).
In between there is a neutral zone in which the compressor is not switched on and the solenoid coil is not energized (off position).

Minimum and maximum pressure monitoring in a nitrogen line

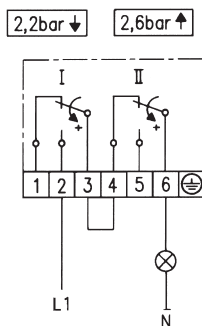

Example 2:

Requirement

In a process engineering system, the pressure in a nitrogen line has to be monitored. A green signal lamp indicates that the pressure in the line is between 2.2 and 2.6 bar. If the pressure goes below 2.2 bar or above 2.6 bar, the indicator lamp goes out and the system shuts down.

Solution

The first contact of a DCM 3–307 pressure switch with 2 microswitches opens under falling pressure at 2.2 bar; the second microswitch opens under rising pressure at 2.6 bar. If the pressure is >2.2 bar and <2.6 bar, the circuit is closed via both microswitches and the signal lamp is lit.

Example 3:


Requirement

The gradual fouling of a filter system is to be monitored by a differential pressure switch. Increased fouling causes a higher differential pressure between the input and the output of the filter system. A green signal lamp indicates the normal operating state. If fouling reaches a certain value (differential pressure >0.9 bar), a yellow signal lamp warns the operator that it is time to change the filter elements. If this is not done and the differential pressure rises due to further fouling (e.g. to >1.2 bar), the system must be shut down.

Solution

A differential pressure switch DDCM 6–307 operates under rising differential pressure (at 0.9 bar), the green control lamp goes out; at the same time the yellow lamp comes on (warning that it is time to clean the filter). If the differential pressure continues to rise (to >1.2 bar), the circuit opens via 4–6 of the second microswitch, the relay drops out and the system shuts down.

Filter monitoring with a 2-stage differential pressure switch

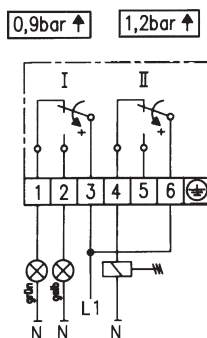

TÜV
DVGW

Pressure switches “of special construction”

Definitions and information

Pressure monitoring and pressure limiting in

- Steam boilers
- District heating systems
- Oil pipelines
- Liquid gas installations etc.
- Hot water heating systems
- Gas installations
- Firing systems

is extremely important with regard to safety.

Component testing

Pressure monitoring devices for safety-critical applications must work reliably and be tested according to the relevant directives in each case. **The reliability of pressure monitors and pressure limiters must be certified by a component test** which is performed by the testing agencies responsible in each case (e.g. TÜV and DVGW). The following section deals with the FEMA product range for safety-critical pressure monitoring in thermal and process engineering systems.

Special construction

The term “of special construction” originates from the **VdTÜV Memorandum “Pressure 100/1”, issue 04.83**, which defines the requirements for **pressure monitors and pressure limiters for steam boilers and hot water systems**. Originally used only for pressure monitoring in the area of steam and hot water, the “special construction” characteristic is increasingly used as a quality and safety argument for other applications as well. The following section describes the requirements for pressure limiters “of special construction”. Recommendations for the correct selection of pressure limiters are given by reference to safety analyses.

Definitions of the VdTÜV Memorandum “Pressure 100/1”:

Pressure monitors (DW)

Pressure monitors are devices which switch off the heating system on exceeding and / or falling below a predefined pressure limit and release the heating system again only after a change in pressure.

Pressure limiters (DB)

Pressure limiters are devices which switch off the heating system on exceeding and / or falling below a predefined pressure limit and lock it to prevent automatic restarting.

Pressure limiters “of special construction” (SDB)

Pressure limiters “of special construction” perform the same tasks as pressure limiters. In addition they must satisfy the extended safety requirements of section 3.3 (of “Pressure 100/1”).

Safe condition

According to DIN VDE 0660, Part 209, the safe condition of the system is reached if a cut-off command is present at the output contact which means that in the safe condition, the microswitch in the pressure limiter is actuated (opened) and the control circuit is interrupted. Series connected switching devices must react in the same way. The operating mode of the safety pressure limitation thus corresponds to the **closed circuit principle**.

Additional requirements for pressure limiters "of special construction"

Section 3.3 of VdTÜV Memorandum "Pressure 100/1":

Pressure limiters "of special construction" **must, in the event of a breakage in the mechanical part of the measuring element, lead to cut-off and interlock of the heating.** This requirement is also fulfilled if the mechanical part of the measuring element is calculated for vibrating stress **or has withstood a test with 2 million operating cycles and the pressurized parts of the measuring element are made of corrosion-resistant materials.**

(Abbreviated excerpt from VdTÜV Memorandum "Pressure 100/1").

Therefore there are two possible ways of meeting the requirements for pressure limiters "of special construction":

- By a self-monitoring pressure sensor which is designed so that a breakage in the mechanical part of the measuring element leads to cut-off to the safe side (see Fig. 1)
- By certification of endurance testing with 2 million operating cycles during the component test (see Fig. 2)


a) Self-monitoring pressure sensor with safety diaphragm (for maximum pressure monitoring only)

Fig. 1 is a cross-sectional diagram of a pressure sensor which fulfils the "special construction" requirements. The measuring chamber is bordered by the housing (1), base (2) and measuring bellows (3). All parts are made of stainless steel and are welded together without filler metals. When the pressure rises the measuring bellows (3) moves upwards, supported by the back pressure spring (5). The setpoint spring installed in the switching device acts as a counterforce. A transfer bolt (6) which transfers the pressure-dependent movements of the measuring bellows (3) to the switching device located above is placed on the inside of the base. A plastic diaphragm (7), which is not in contact with the medium and in normal operation follows the movements of the measuring bellows but itself has no influence on the position of the bellows, is clamped in the upper part of the transfer bolt. On breakage of the measuring bellows (3), the medium can escape into the interior of the bellows. The medium pressure is now on the underside of the diaphragm (PL). An additional force is generated because of the far larger effective area of the diaphragm compared with the bellows, and this pushes the transfer bolt (6) upwards. This results in cut-off to the safe side. The cut-off condition thus achieved is normally interlocked electrically or mechanically, so that the system also remains cut off when the pressure drops again. The plastic diaphragm (7) is not a pressure-bearing part; it has no function in normal operation and is effective only if a leakage occurs to the measuring bellows. Safety diaphragms of the described design are permissible up to 32 bar. This should be sufficient for most applications.


b) Pressure sensors with certification of 2 million operating cycles (DWR series)

In this design it is assumed that the pressure sensors which have withstood dynamic loading of 2 million operating cycles during component testing can be considered as reliable elements. They do not have an additional safety device in the sensor. Although the units are produced and tested with very great care, maximum pressure limiters without additional safety device can lead to dangerous conditions if errors which cannot be detected in the tests occur due to secondary effects. These may be caused by hole corrosion due to deposited metal particles on the (usually very thin-walled) bellows of the pressure sensor, material defects in the pressure bellows or a broken weld seam. Despite careful production and testing, a residual risk remains in the case of maximum pressure monitoring. It is ultimately up to the user and operator of the systems themselves to decide on the degree of safety to which pressure vessels should be monitored.

Pressure sensors without safety diaphragm are self monitoring when used in minimum pressure monitoring applications.

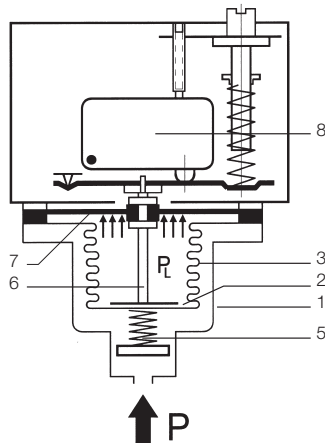

Self-monitoring maximum pressure limiter with safety diaphragm
DWAM..., DWAMV..., SDBAM...

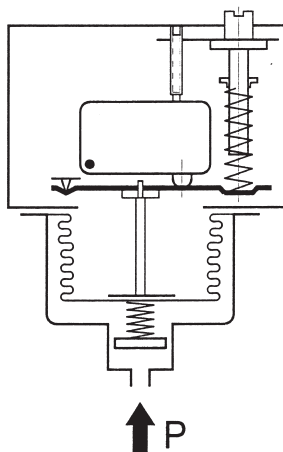

Pressure limiter without safety-diaphragm (not self-monitoring for maximum pressure) DWR...

Safety analysis for maximum pressure monitoring

Observing the direction of action

The preceding description and safety considerations relate to the monitoring of maximum pressure. The safe side here means: The energy supply is cut off (e.g. burner is turned off) to avoid a further pressure rise. Minimum pressure monitoring requires an entirely different approach. The safe side here means: Preventing the pressure from falling further (for example: hotwater systems with external pressure retention or monitoring of water level in heating systems). Based on a safety analysis, a pressure limiter without safety diaphragm is clearly the best option. In the event of leakage in the sensor, "low pressure" is signalled and the system switches over to the safe side. A pressure sensor without safety diaphragm is therefore "of special construction" within the meaning of Memorandum "Pressure 100/1", if it is used as a minimum pressure limiter. On the other hand, it is clear from the above that pressure sensors with safety diaphragms, which offer considerable advantages in maximum pressure monitoring, should never be used for minimum pressure monitoring. Incorrect use can create a dangerous condition. It is therefore essential for users and planners to observe the direction of action when selecting pressure limiters.

In summary it may be said:

Pressure limiters "of special construction" with safety diaphragms (self-monitoring pressure sensors) offer the highest degree of safety in maximum pressure monitoring. Such devices must not however be used for minimum pressure monitoring. Pressure limiters "of special construction" with certification of 2 million operating cycles are self-monitoring in the case of minimum pressure monitoring, even without a safety diaphragm. In the case of maximum pressure monitoring, however, a residual risk remains.




Safety analysis for maximum pressure monitoring

If one considers the switch positions in the possible operating conditions, the difference compared with pressure sensors "of special construction" becomes clear. The left column shows normal operation in which the switch connects terminals 3 and 1. The cut-off condition when pressure is too high is shown in column 2. The control circuit is interrupted via terminals 3 and 1.

The difference in safety terms is clear from column 3, which shows the switch position in the event of a leak in the pressure sensor. With a safety-engineered sensor the control circuit is interrupted, whereas in the case of a sensor without a safety diaphragm the control circuit remains closed, and thus a "dangerous condition" can arise.

Devices with safety diaphragm (DWAM, DWAMV, SDBAM)




In pressure limiters "of special construction" which are equipped with **safety sensors**, different operating conditions occur in the following switch positions:

1	2	3
Normal operation	Limit exceeded	Leakage in pressure sensor
		
Control circuit closed	Control circuit interrupted	Control circuit interrupted

Device without safety diaphragm

"Special construction" must also be proven by an **endurance test with 2 million operating cycles**. In the case of breakage/leakage (e.g. material defect, fault in weld seams, hole corrosion), the system **does not cut off to the safe side (no self-monitoring)**.

In the different operating conditions the following switch positions occur **in the case of maximum pressure monitoring**: In the event of leakage in the pressure sensor, the pressure monitors/limiters according to b) are not safe. A "dangerous condition" can arise.

Normal operation	Limit exceeded	Leakage in pressure sensor
		
Control circuit closed	Control circuit interrupted	Control circuit closed Dangerous condition!

Further observations and summary

Minimum pressure

All **minimum pressure monitors and minimum pressure limiters are self-monitoring** within the meaning of "Pressure 100/1" (with or without safety diaphragm).

Pressure limiters must interlock the cut-off state

Memorandum "Pressure 100/1" specifies that pressure limiters must cut off and interlock against automatic restarting. For this purpose, pressure limiters are offered with integrated mechanical interlock (reclosing lockout). The direction of action is also important in the selection of the interlock. Depending on the direction of action it is necessary to determine whether the interlock should operate on rising (maximum pressure monitoring) or falling (minimum pressure monitoring) pressure.

External interlock is also possible

A pressure monitor can become a pressure limiter if an electrical interlock is connected in series. The figures on page 29 show suggested interlock circuits for maximum pressure and minimum pressure monitoring. The direction of action must be observed when deciding the circuit. For the combination of pressure monitor with external interlock to be considered as a limiter "of special construction", the pressure monitor itself must satisfy the "special construction" requirements.

Other considerations

"Special construction" — not just for steam and hot water systems

According to current standards, pressure limiters "of special construction" are mandatory for steam - boilers according to TRD 604 and for heating systems according to DIN 4751 Part 2. They are considered to be failsafe elements within the meaning of TRD 604 and can therefore be used on installations in 24-hour operation and 72-hour operation (for further information see TRD 604). It is clearly advantageous to transfer the positive experience from pressure monitoring of steam boilers to other applications. In the interest of greater safety it is desirable to incorporate the requirements for pressure limiters "of special construction" used in safety-critical monitoring applications into other standards as well. This applies particularly to applications in the field of gas, which are covered by DIN 3398 Parts 1 and 3, and liquid fuels, covered by DIN 3398 Part 4.

For even greater safety:

Positive opening contacts

In maximum pressure monitoring, safety can be further increased through additional measures. The microswitches, normally equipped with a spring contacts, can be fitted with **positive opening contacts (to protect against contact sticking)**.

Line break and short-circuit monitoring

The power supply to the pressure limiter is monitored for short-circuit and interruption by an external isolating amplifier (EX 041). In the case of faults in the power supply, the system cuts off to the safe side. EEx-d and EEx-i versions, where applicable combined with sensors "of special construction", open up a wide range of possibilities in the field of Ex applications for **process engineering systems and gas engineering**. See DBS series.

Summary

It is apparent that safety can be improved significantly and numerous causes for the occurrence of dangerous conditions can be eliminated through the appropriate use of technical measures. However, it is also apparent that a residual risk remains. Careful planning and conscientious maintenance and testing of existing systems are absolutely essential for reliable pressure monitoring on pipelines and pressure vessels.

Standards – Directives – Component tests

VdTÜV
Pressure 100/1

Steam and hot water

Pressure monitors and pressure limiters for steam and hot water in systems to DIN 4751 T2 and TRD 604. Series DA and DWR.

DVGW
DIN 3398 T.1 and 3

Fuel gases CE

Pressure monitors and limiters for fuel gases in accordance with DVGW Worksheet G 260. Series DGM and DWR.

TÜV
DIN 3398 T.4

Liquid fuels

Pressure monitors and pressure limiters for liquid fuels (heating oil) Series DWR.

TÜV, Pressure 100/1
(DIN 3398 T.3 and 4)

Safety-engineered pressure limiters

For safety-critical pressure monitoring in liquid gas systems, chemical and process engineering systems.

PED 97/23EC

Pressure Equipment Directive 97/23EC

Pressure monitors and limiters to DIN 3398 Parts 3 + 4 fall into Category IV of the PED

ATEX 94/9 EC


Ex -versions

For Ex areas Zones 1 and 2, all pressure switches can be supplied in pressure-proof encapsulated design (Ex degree of protection EEx de IIC T 6).


PTB approval: PTB 02 ATEX 1121

For intrinsically safe control circuits (Ex degree of protection EEx-ia), pressure switches with gold contacts, proximity switches and the blue terminals and cable entries customary in EExi areas can be supplied. In addition to the pressure switch, an isolating amplifier which transfers the control commands of the pressure switch from an intrinsically safe control circuit (EEx-ia) to a non-intrinsically safe active circuit is required


Medium

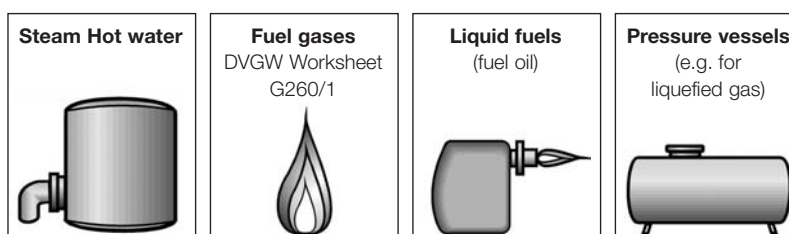

Plant directives



Directives for component testing

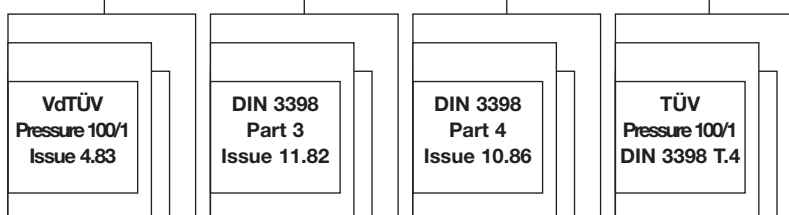


Type series





Pressure monitor



Pressure limiter with internal interlock

Selection according to function and application

Application Function	Steam and hot water systems to TRD 604 and DIN 4751 T.2	Fuel gases to DVGW-Worksheet G 260	Heating oil and other liquid fuels	Other media (check compatibility with the materials used)
Pressure monitoring Pressure regulation (e.g. burner or pump control)	DWAM... DWAMV... DWR... DWR...-203	DGM... DWR... DWR...-203	DWR... DWR...-203	DWAM... DWAMV... DWR... DWR...-203
Maximum pressure limitation with internal interlock	SDBAM... DWR...-205	DGM...-205 DWR...-205	DWR...-205	SDBAM... DWR...-205
with external interlock	DWAM... DWR...	DGM... DWR...	DWR...	DWAM... DWR...
Minimum pressure limitation with internal interlock	DWR...-206	DGM...-206 DWR...-206	DWR...-206	DWR...-206
with external interlock	DWR... DWR...	DGM... DWR...	DWR...	

...The code number for the pressure range must be inserted here (see datasheets). A final number of 2... (e.g. DWR...-205) means a plug connector according to DIN 43650.

DWR series

The DWR series **covers all the applications mentioned above.**

DA series (self-monitoring sensor)

DWAM, DWAMV and SDBAM are **only suitable for maximum pressure monitoring**. They offer **additional safety** due to the **safety diaphragm (selfmonitoring sensor)**. They are TÜV-tested for steam and hot water, but thanks to the self-monitoring sensor can also be recommended for other, **particularly safety-critical applications** (e.g. in process engineering).

Sensors of the DWR series are self-monitoring when used in minimum pressure monitoring applications.


Equipment of a boiler with pressure monitor and pressure limiter

Pressure monitor for burner control: **DWAM... or DWR...** (without adjustable switching differential)
or
(better, because switching differential adjustable) **DWAMV... or DWR...-203**

Pressure limiter for safety monitoring: **SDBAM... or DWR...-205** (with internal interlock, unlocking button on the pressure limiter)
or
DWAM... or DWR... (with external interlock in the control cabinet)
Suggested connection for the external interlock, see page 31.

Pressure monitor
DWAM...
or DWR...

Pressure limiter
SDBAM... or
DWR...-205

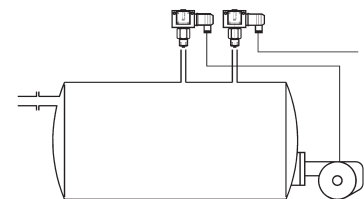



DWAM 1

DA series

Maximum pressure monitors and limiters

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) to DIN 16 288 and internal thread G 1/4 to ISO 228 Part 1.

Switching device

Rugged housing (200) made of seawater-resistant diecast aluminium.

Materials

Pressure bellows: Material no. 1.4571
 Sensor housing: Material no. 1.4104
 Switch housing: GD Al Si 12 according to DIN 1725

Mounting position

Vertically upright and horizontal.

Ambient temperature at switching device

-20 to +70°C.

Medium temperature -20 to +70°C.

The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods. Higher medium temperatures are possible provided the upper limit at the switching device is ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge connection) or on a flat surface with two 4 mm Ø screws.

Calibration for maximum pressure switch

The pressure monitors and safety pressure limiting devices are calibrated so that, **under rising pressure**, switching takes place at the defined switching pressure. The reset point under falling pressure is lower by the amount of the switching differential, or, in the case of pressure limiting devices, by the fall in pressure specified in the table. The scale value corresponds to the upper switching point.

Switching differential

See Product Summary.

Contact arrangement

Single-pole changeover switch.

Switching capacity	250 VAC (ohm)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A

Sealing P2

Generally available for SDBAM limiters.

Bursting pressure

For all types ≥ 100 bar.
 Verified by TÜV test.

Component tested for

Testing basis

TÜV type test approval mark

Function

Direction of action

Sensor

Steam

Systems according to TRD 604

Hot water

Systems according to DIN 4751, T. 2

VdTÜV Memorandum "Pressure 100/1"

TÜV · DW 04 – 132 for series DWAM...

TÜV · DW 04 – 133 for series DWAMV...

TÜV · SDB 04 – 134 for series SDBAM...

Pressure monitor / Pressure limiter

For maximum pressure monitoring only

"Of special construction" (self-monitoring sensor with safety diaphragm)

TÜV
TESTED

Product Summary Maximum pressure monitoring (↑) (for other pressure ranges see DWR series)

Type	Setting range	Switching differential (mean values)	Max. permissible pressure	Dimensioned drawing
------	---------------	--------------------------------------	---------------------------	---------------------

Pressure monitors without differential adjustment for max. pressure monitoring

DWAM 06	0.1...0.6 bar	0.04 bar	5 bar	1 + 15
DWAM 1	0.2...1.6 bar	0.05 bar	5 bar	
DWAM 6	1.2...6 bar	0.2 bar	10 bar	
DWAM 625	1.2...6 bar	0.25 bar	20 bar	1 + 19
DWAM 16	3...16 bar	0.4 bar	20 bar	
DWAM 32	6...32 bar	1.2 bar	45 bar	

Pressure monitors with differential adjustment for max. pressure monitoring

DWAMV 1	0.2...1.6 bar	0.12...0.6 bar	5 bar	1 + 15
DWAMV 6	1.2...6 bar	0.4...1.5 bar	10 bar	
DWAMV 16	3...16 bar	0.8...2.5 bar	20 bar	1 + 19
DWAMV 32	6...32 bar	2.5...6.0 bar	45 bar	

Pressure limiters for maximum pressure monitoring (with internal interlock)

		Pressure change for unlocking		
SDBAM 1	0.2...1.6 bar	0.12 bar	5 bar	1 + 15
SDBAM 2,5	0.4...2.5 bar	0.15 bar	5 bar	
SDBAM 6	1.2...6 bar	0.4 bar	10 bar	
SDBAM 625	1.2...6 bar	0.6 bar	20 bar	1 + 19
SDBAM 16	3...16 bar	0.8 bar	20 bar	
SDBAM 32	6...32 bar	3.0 bar	45 bar	

The maximum permissible working pressure is defined as the upper limit at which the operation, switching reliability and water tightness of the pressure switch are in no way impaired. Pressure monitors DWAM... can also be used for maximum pressure limitation if an external interlock is used (see page 31).



DWR 625

DWR series

Pressure monitors for steam and hot water,
fuel gases and liquid fuels

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) to DIN 16 288 and internal thread G 1/4 to ISO 228 Part 1 (for gas applications internal thread permissible only up to 4 bar).

Switching device

Rugged housing (200) made of seawater-resistant diecast aluminium.

Materials

Pressure bellows: Material no. 1.4571
Sensor housing: Material no. 1.4104 Switch housing: GD Al Si 12 (DIN 1725)

Mounting position

Vertically upright and horizontal. In Ex version only vertical.

Ambient temperature at switching device

–25 to +70°C,
for EEx-d version –15 to +60°C.
Medium temperature –25 to +70°C. The maximum medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods (not EEx-d). Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge connection) or on a flat surface with two 4 mm Ø screws.

Calibration

The DWR series is calibrated for rising pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at rising pressure. The reset point is lower by the amount of the switching differential. (See also page 30, 2. Calibration at upper switching point). In version ...-203 the switching differential is adjustable. The basic calibration is maintained.

Bursting pressure

For all types ≥ 100 bar, verified by TÜV test.

Switching differential For values see Product Summary.

Contact arrangement Single pole changeover switch.

Switching capacity	250 VAC (ohm)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	8 A
EEx-d	3 A	2 A	3 A

Degree of protection IP 54 according to DIN 40 050
IP 65 (alternative version)

Ex protection

EEx de IIC T6, approval PTB 02 ATEX 112,
EEx-i with ZF 513

Degree of protection of EEx-d version
IP 65, installation position only vertical.



Component tested for

Testing basis

Pressure 100/1, Issue 4.83
DIN 3398, T. 3, Issue 11.92
DIN 3398, T. 4, Issue 10.86

Function

Direction of action

Sensor

Steam

Hot water

Fuel gases

Liquid fuels

Registration no.

ID: 000 000 7042
NG-4347AQ1411
3 C028/05

Pressure monitor or pressure limiter
(with external interlock)

For maximum and minimum pressure monitoring (DWFS, SDBFS)

"of special construction" by testing with 2 million cycles.

Systems according to TRD 604

Systems according to DIN 4751, T. 2

DVGW Worksheet G 260

e.g. fuel oils

**TÜV
DVGW**



Product Summary

Type	Setting range	Switching differential (mean values)	Maximum working pressure 1*	Maximum working pressure 2*	Dimensioned drawing
Pressure monitors without differential adjustment					
DWR 06	0.1...0.6 bar	0.04 bar	6 bar	6 bar	1 + 15
DWR 1	0.2...1.6 bar	0.06 bar			
DWR 3	0.2...2.5 bar	0.1 bar	10 bar	16 bar	1 + 18
DWR 6	0.5...6 bar	0.2 bar			
DWR 625	0.5...6 bar	0.25 bar	20 bar	25 bar	1 + 17
DWR 16	3...16 bar	0.5 bar			
DWR 25	4...25 bar	1.0 bar	50 bar	63 bar	1 + 16
DWR 40	8...40 bar	1.3 bar			
EEx-ia versions with ZF 513 (page 29)					
Switching differential adjustable					
DWR 06-203	0.1...0.6 bar	0.08...0.5 bar	6 bar	6 bar	1 + 15
DWR 1-203	0.2...1.6 bar	0.15...0.6 bar			
DWR 3-203	0.2...2.5 bar	0.17...1.2 bar	10 bar	16 bar	1 + 18
DWR 6-203	0.5...6 bar	0.3...1.4 bar			
DWR 625-203	0.5...6 bar	0.4...2.5 bar	20 bar	25 bar	1 + 17
DWR 16-203	3...16 bar	0.75...3.15 bar			
DWR 25-203	4...25 bar	1.3...6.0 bar	50 bar	63 bar	1 + 16
DWR 40-203	8...40 bar	2.3...6.6 bar			
Ex-versions (EEx de IIC T6) e.g. for fuel gases (housing 700)					
Ex-DWR 06	0.1...0.6 bar	0.04 bar	6 bar	6 bar	3 + 15
Ex-DWR 1	0.2...1.6 bar	0.06 bar			
Ex-DWR 3	0.2...2.5 bar	0.1 bar	10 bar	16 bar	3 + 18
Ex-DWR 6	0.5...6 bar	0.2 bar			
Ex-DWR 625	0.5...6 bar	0.25 bar	20 bar	25 bar	3 + 17
Ex-DWR 16	3...16 bar	0.5 bar			
Ex-DWR 25	4...25 bar	1.0 bar	50 bar	63 bar	3 + 16
Ex-DWR 40	8...40 bar	1.3 bar			

* max. working pressure

Column 1: For devices according to DIN 3398, Part 3 (gas pressure monitors)

Column 2: For devices according to "Pressure 100/1" and DIN 3398, Part 4 (for steam, hot water and liquid fuels)



Degree of protection:
IP 54/65



DWR 625-205

DWR-B series

Pressure limiters for steam and hot water, fuel gases and liquid fuels

The pressure limiters are equipped with a reclosing lockout for the mechanical interlocking of the switch-off state. If the switching point set on the pressure limiter is reached, the limiter switches off. The switch-off state is retained even if the pressure changes again. It can only be reset by manually operating the reset button. For unlock-

ing to be possible, the pressure at the sensor must have fallen (in the case of maximum pressure limiters) or risen (in the case of minimum pressure limiters). The pressure change values are listed in the Product Summary.

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) to DIN 16 288 and internal thread G 1/4 to ISO 228 Part 1 (for gas applications internal thread permissible only up to 4 bar).

Switching device

Rugged housing (200) made of seawater-resistant diecast aluminium.

Materials

Pressure bellows: Material no. 1.4571
 Sensor housing: Material no. 1.4104
 Switch housing: GD Al Si 12 (DIN 1725)

Mounting position Vertically upright and horizontal.

Ambient temperature at switching device -25...+70°C

Medium temperature -25...+70°C.

The medium temperature at the pressure sensor must not exceed the permitted ambient temperature at the switching device. Temperatures may reach 85°C for short periods. Higher medium temperatures are possible provided the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

Mounting

Directly on the pressure line (pressure gauge connection) or on a flat surface with two 4 mm Ø screws.

Calibration

The DWR-205 series is calibrated for rising pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at rising pressure. The reset point is lower by the amount of the switching differential. (See also page 30, 2. Calibration at upper switching point). The DWR-206 series is calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).

Bursting pressure For all types ≥ 100 bar, verified by TÜV test.

Switching differential For values see Product Summary.

Contact arrangement Single pole changeover switch.

Switching capacity	250 VAC (ohm)	(ind)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A	8 A

Degree of protection IP 54 according to DIN 40 050
 IP 65 (alternative version)

Sealing P2

On request (can be fitted later).



Component tested for

Testing basis

Pressure 100/1, Issue 4.83
 For maximum pressure limiter
 For minimum pressure limiter
 DIN 3398, Part 3, Issue 11.92
 DIN 3398, Part 4, Issue 10.86

Function

Direction of action

Sensor

Steam

Hot water

Fuel gases

Liquid fuels

Registration no.

TÜV.SDB.02 – 310
 TÜV.SDB.02 – 309
 NG-4347AQ1411
 3 C028/05

Pressure limiter (with internal interlock)

For maximum and minimum pressure monitoring (SDBFS)

"Of special construction" by testing with 2 million cycles.

Systems according to TRD 604

Systems according to DIN 4751, T. 2



DVGW Worksheet G 260

e.g. fuel oils



Important: When selecting the limiter, it is necessary to decide whether the device is to be used for maximum or minimum pressure monitoring. The direction of action cannot be reversed at the pressure limiter.

Product Summary

Product Summary					
Type	Setting range	Switching differential (mean values)	Maximum working pressure 1* 2*	Connection diagram	
Maximum pressure limiters					
DWR 06–205	0.1...0.6 bar	0.06 bar	6 bar	6 bar	
DWR 1–205	0.2...1.6 bar	0.09 bar			
DWR 3–205	0.2...2.5 bar	0.20 bar	10 bar	16 bar	
DWR 6–205	0.5...6 bar	0.30 bar			
DWR 625 –205	0.5...6 bar	0.50 bar	20 bar	25 bar	
DWR 16 –205	3...16 bar	0.70 bar			
DWR 25 –205	4...25 bar	1.4 bar	50 bar	63 bar	
DWR 40–205	8...40 bar	2.3 bar			
Minimum pressure limiters					
DWR 06–206	0.1...0.6 bar	0.06 bar	6 bar	6 bar	
DWR 1–206	0.2...1.6 bar	0.09 bar			
DWR 3–206	0.2...2.5 bar	0.20 bar	10 bar	16 bar	
DWR 6–206	0.5...6 bar	0.30 bar			
DWR 625 –206	0.5...6 bar	0.50 bar	20 bar	25 bar	
DWR 16 –206	3...16 bar	0.70 bar			
DWR 25 –206	4...25 bar	1.4 bar	50 bar	63 bar	
DWR 40–206	8...40 bar	2.3 bar			

* Maximum working pressure and dimensions as for type series DWR. Pressure monitors DWR... (page 51) can also be used as maximum pressure and minimum pressure limiters with external interlock. You will find other maximum pressure limiters with safety sensor, type series SDBAM..., on page 50. Types DWAM... can also be used with external interlock as maximum pressure limiters.



Degree of protection:
 IP 54/65



FD

FD series

Safety-engineered maximum pressure limiter for liquid gas systems, setting range 5–16 bar

Pressure limiters of the FD series are constructed in accordance with the special directives for liquid gas engineering. The requirements of TRB 801 Appendix II §12 are met. All parts coming into contact with the medium are made of stainless steel 1.4104 and 1.4571. The parts of the sensor subjected to pressure are welded without filler metals. Over and above the requirements of

the TRB, the pressure sensor is "self-monitoring", i. e. in the event of rupture of the measuring bellows, the pressure limiter switches off to the safe side. The pressure sensor thus complies with the "special construction" requirements as defined in the VdTÜV Memorandum "Pressure 100/1".

Technical data

Pressure connection External thread G 1/2 (pressure gauge connection) according to DIN 16 288.

Switch housing 300
Diecast aluminium GD Al Si 12.

Degree of protection: IP 65

Explosion protection EEx-ia (only when used in conjunction with Ex 041 isolating amplifier).

TÜV testing station identifying mark see Product Summary.

Pressure sensor materials
Housing: 1.4104. Pressure bellows: 1.4571
All parts fully welded. Perbunan safety diaphragm (not in contact with medium).

Ambient temperature –25°C to +60°C.
At ambient temperatures below 0°C, ensure that condensation cannot occur in the sensor or in the switching device.

Max. medium temperature: +60°C.

Outdoor installations

Protect the device against direct atmospheric influences. Provide a suitable protective cover.

Max. permissible working pressure: 40 bar.

Switching pressure: 5–16 bar. Adjustable with the setting spindle after removing the terminal box.

Calibration

The **FD16-316** and **FD16-327** series are calibrated for rising pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at rising pressure. The reset point is lower by the amount of the switching differential. (See also page 30, 2. Calibration at upper switching point).

Mounting

Can be fitted directly onto pressure line with suitable weld-on connections and union nuts.

Interlock after cutout

Internal interlock on FD 16–327.
Interlock defeat: after pressure reduction of approx. 2.5 bar by pressing the red button (with tool) on the scale side of the pressure switch.

External interlock on FD 16–326.

Interlock defeat: After pressure reduction of approx. 0.5 bar. Press unlocking button in control cabinet.

Line break and short-circuit monitoring

On types FD 16–326 and FD 16–327 used in conjunction with Ex 041 isolating amplifier, the control circuit is monitored for short-circuit and line break. The resistor combination incorporated into the pressure switch ensures that a defined current flows at all times during normal operation. In the event of short-circuit or line break, the current level changes and the relay drops out to the safe side.

The pressure limiters are used in intrinsically safe control circuits (Ex protection EEx-ia). Through use of the Ex 041 isolating amplifier and a suitable resistor combination in the switching device of the pressure limiter, the control circuit is monitored for line break and short-circuit.

Product Summary

Type	Setting range	Switching differential	Inter-lock*	Periphery	TÜV-testing station identifying	Dimensional drawing
FD 16 –326	5–16 bar	0.5	External	Isolating amplifier Ex 041, (self-monitoring with line break and short-circuit monitoring)	01-12-0109	1 + 19
FD 16 –327	5–16 bar	2.5	Internal		01-12-0110	1 + 19

* Interlock on reaching upper cutoff point (maximum pressure set).

Defeat:


E = External, i.e. in control cabinet via relay with latching

I = Internal, i.e. locally at pressure limiter

For technical data of isolating amplifier, see Datasheet Ex 041, page 61.


Please note when ordering: List pressure limiter and isolating amplifier separately.

Internal circuit



FD 16 –326

Single-pole changeover switch with resistor combination for line break and short-circuit monitoring.
(External interlock in control cabinet necessary).



FD 16 –327

Single-pole changeover switch with mechanical switching state interlock on reaching maximum pressure and with resistor combination for line break and short-circuit monitoring.

Please note: FD pressure limiters must never be connected directly to mains voltage. They must only be used in conjunction with isolating amplifier Ex 041.



Degree of protection:
IP 54



DWAM...-576

DBS series

Pressure monitors and limiters
for especially safety-critical applications

Technical data

Greater safety

- in process engineering and chemical installations,
- in gas and liquid gas installations

Basic features:


- "Of special construction" according to VdTÜV Memorandum "Pressure 100/1"
- Line break and short-circuit monitoring between pressure switch and isolating amplifier EX 041
- Suitable for Ex areas (zone 1 & 2 or 21 & 22) (explosion protection EEx-ia)
- Degree of protection IP 65
- Plastic-coated housing (chemical version)

Options:

- Limiter with internal interlock

Type-specific features:

- Self-monitoring sensors
- Positive opening microswitches
- Gold-plated contacts
- TÜV, DVGW component tests



Safety-engineered pressure limiters offer a higher degree of safety compared with normal pressure switches and are therefore especially suitable for chemical process engineering and thermal installations in which safety is an especially critical factor in pressure monitoring. The pressure switches can also be used in Ex zones (zone 1, 2 and 21, 22) and in all cases require an **Ex 041 isolating amplifier**. The isolating switching amplifier is also responsible for monitoring lines for short-circuit and line break and therefore offers an additional safety advantage — even in non-Ex zones.

For Ex applications, the isolating amplifier must be installed outside the Ex zone.

The lines between the Ex 041 isolating amplifier and the pressure switch are monitored for short-circuit and line break.

Safety requirements for pressure limiters

Pressure limiters "of special construction" (DBS) must fulfil additional safety requirements, i.e. breakage or leakage in the mechanical part of the sensor must lead to shutdown to the safe side. The pressure limiter must respond as if the system pressure had already exceeded the maximum limit. The control circuit for the pressure limiter must also be considered from the point of view of safety, as short-circuits in the supply lines or other faults in the control current circuit can lead to dangerous conditions.

Switching element with positive opening operation and gold-plated contacts


The microswitch is equipped with positive opening operation. Rather than transmitting the plunger force via a spring, which is the usual method with most microswitches, this newly developed microswitch has an additional lever which transmits the movements of the pressure bellows positively to the contact lever. If the spring breaks, the contact lever is moved directly.

Line break and short-circuit monitoring in the control circuit

The resistor connected in series with the switching contact limits the current to a defined value with the switch closed. In the event of short-circuit in the area between the isolating amplifier and the series resistor, the current rises above the predetermined limit value, the relay of the isolating amplifier drops out, the output current circuit is interrupted and thus the safe condition is achieved. In the event of a line break, the current flow is interrupted, the relay drops to the safe side and interrupts the output current circuit (safety sequence). Furthermore, the isolating amplifier is designed so that, if faults occur in the electronics (conductor interruption, component defect etc.) and in the resulting situations, the safe shutdown condition is assured. These characteristics of the safety-engineered isolating amplifier, including line break and short-circuit monitoring, satisfy the requirements of DIN/VDE 0660, Part 209.

Connection diagram

See also Datasheet Ex 041. For pressure monitoring in Ex areas, the isolating amplifier must be installed outside the Ex zone. The pressure limiter has an intrinsically safe control current circuit (EEx-ia). This arrangement is suitable for zones 1 and 2, 21 and 22.

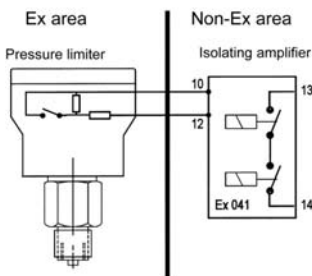

Safety-engineered maximum pressure monitors

Technical data

Pressure connection

External thread G 1/2 (pressure gauge connection) according to DIN 16 288.

Switch housing 500

Diecast aluminium GD Al Si 12.
Aluminium housing coated with resistant plastic.

Degree of protection IP 65.

Ex protective category

EEx-ia (only when used in conjunction with Ex 041 isolating amplifier).

Component testing

See table on page 56.

Pressure sensor materials

Housing: 1.4104
Pressure bellows: 1.4571
All parts fully welded.

Ambient temperature

–25°C to +60°C.
At ambient temperatures at or below 0°C, ensure that condensation cannot occur in the sensor or in the switching device.

Max. temperature of medium at sensor + 60°C.

Outdoor installations

Protect the device against direct atmospheric influences. Provide a protective cover.

Max. working pressure

See Product Summary

Switching pressure setting

Adjustable with the setting spindle after removing the terminal box.



Mounting

With suitable weld-on connections and union nuts or with pressure gaugescrew union G 1/2.

Switching capacity

24 VDC, max. 100 mA. (at higher switching power the gold plating on the contact may be damaged).

Connection diagrams



Maximum pressure monitors

Sensor "of special construction", self-monitoring via safety diaphragm, type-tested according to VdTÜV Memorandum "Pressure 100/1".

Type	Setting range	Switching differential (mean values)	Max. permissible pressure
DWAM 06-576	0.1...0.6 bar	0.04 bar	5 bar
DWAM 1-576	0.2...1.6 bar	0.05 bar	5 bar
DWAM 2.5-576	0.4...2.5 bar	0.07 bar	5 bar
DWAM 6-576	1.2...6 bar	0.15 bar	10 bar
DWAM 625-576	1.2...6 bar	0.25 bar	20 bar
DWAM 16-576	3...16 bar	0.4 bar	20 bar
DWAM 32-576	6...32 bar	1.2 bar	45 bar

Versions:

ZF 577: Maximum pressure limiter (with internal interlock) Microswitch not positive opening, contacts: silver alloy. Other equipment as for DWAM...576

Ex 041 isolating amplifier, see page 61.

Maximum pressure monitors

Sensor "of special construction" through component test with **2 million operating cycles** (not self-monitoring).

Component tests:

VdTÜV Memorandum "Pressure 100/1"

DIN 3398 T.3 (for fuel gases)

DIN 3398 T.4 (for liquid fuels)

Type	Setting range	Switching differential (mean values)	Max. permissible pressure in gas	Max. permissible pressure other media
DWR 06-576	0.1...0.6 bar	0.04 bar	6 bar	6 bar
DWR 1-576	0.2...1.6 bar	0.06 bar	6 bar	6 bar
DWR 3-576	0.2...2.5 bar	0.1 bar	10 bar	16 bar
DWR 6-576	0.5...6 bar	0.2 bar	10 bar	16 bar
DWR 625-576	0.5...6 bar	0.25 bar	20 bar	25 bar
DWR 16-576	3...16 bar	0.5 bar	20 bar	25 bar
DWR 25-576	4...25 bar	1.0 bar	50 bar	63 bar
DWR 40-576	10...40 bar	1.3 bar	50 bar	63 bar

Versions:

ZF 577: Maximum pressure limiter (with internal interlock)


Microswitch not positive opening, contacts: silver alloy. Other equipment as for DWR...576

Ex 041 isolating amplifier, see page 61.

Calibration

Devices of the **DWR-576** and **DWAM-576** series are calibrated for rising pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at rising pressure. The reset point is lower by the amount of the switching differential. (See also page 30, 2. Calibration at upper switching point).

**Safety-engineered minimum pressure monitors
for maximum and minimum pressure monitoring**
Technical data
Switching element
 See table opposite.

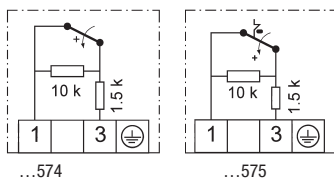Connection diagrams


The other technical data correspond to the devices for maximum pressure monitoring (page 55).

Type	Setting range	Switching differential (mean values)	Max. permissible pressure in gas	other media
DWR 06-574	0.1...0.6 bar	0.04 bar	6 bar	6 bar
DWR 1-574	0.2...1.6 bar	0.06 bar	6 bar	6 bar
DWR 3-574	0.4...2.5 bar	0.1 bar	10 bar	16 bar
DWR 6-574	0.5...6 bar	0.2 bar	10 bar	16 bar
DWR 625-574	0.5...6 bar	0.25 bar	20 bar	25 bar
DWR 16-574	3...16 bar	0.5 bar	20 bar	25 bar
DWR 25-574	4...25 bar	1.0 bar	50 bar	63 bar
DWR 40-574	10...40 bar	1.3 bar	50 bar	63 bar

Calibration

 The **DWR-574** series is calibrated for falling pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at falling pressure. The reset point is higher by the amount of the switching differential. (See also page 30, 1. Calibration at lower switching point).

Versions:
ZF 575: Minimum pressure limiter (with internal interlock)

Microswitch not positive opening,

Switching contacts: silver alloy

Other equipment as for DWR...574

Ex 041 isolating amplifier, see page 61.
**Features of safety-engineered pressure monitors
and pressure limiters**

Devices	Component testing	Features					Options	
	1 = VdTÜV Memorandum "Pressure 100/1" 2 = DIN 3398 Part 3 3 = DIN 3398 Part 4	Resistor combination for line break and short-circuit monitoring	EEExi version for intrinsically safe control circuits	Self-monitoring pressure sensor	Positive opening microswitches	Gold-plated contacts	Limiter with internal interlock (reclosing lockout)	Plastic-coated housing Chemical version
Maximum pressure monitoring								
FD 16-326	1 + 3	•	•	•	•	•		
FD 16-327	1 + 3	•	•	•	•	•	•	
DWAM...576	1	•	•	•	•	•		•
DWAM...577	1	•	•	•	•	•	•	•
DWR...576	1 + 2 + 3	•	•	•	•	•		•
DWR...577	1 + 2 + 3	•	•				•	•
Minimum pressure monitoring								
DWR...574	1 + 2 + 3	•	•	•	•	•		•
DWR...575	1 + 2 + 3	•	•	•			•	•



DGM 310 A

DGM series

Pressure monitors for fuel gases

Technical data

Pressure connection

External thread G 1/2 to DIN 16 288 and internal thread G 1/4 to ISO 228 Part 1 (permissible up to 4 bar).

Switching device

Seawater-resistant diecast aluminium
GD Al Si 12.

Degree of protection

IP 54 for vertical installation position.
IP 65 (for EEx-d version)

Pressure sensor materials

See Product Summary

Ambient temperature

–25 to +60°C.
–15 to +60°C (for EEx-d versions). At ambient temperatures below 0°C, ensure that condensation cannot occur in the sensor or in the switching device.

Maximum working pressure

See Product Summary

Mounting

Either directly on the pipe or with two 4 mm Ø screws on the wall surface.

Mounting position

Vertically upright and horizontal.
EEx-d version only vertical.

Setting

Continuously adjustable via the setting spindle with a screwdriver. The set switching pressure is visible in the scale window.

Sealing P2

On request (can be fitted later).

Switching differentials

Largely independent of the set switching pressure. Not adjustable. For values see Product Summary.

Switching capacity	250 VAC (ohm)	250 VDC (ohm)	24 VDC (ohm)
Normal	8 A	5 A	0.3 A
EEx-d	3 A	2 A	0.03 A

Switching devices in EEx-i version with gold-contacts.
Max. switching capacity: 24 VDC 100 mA.

Pressure measuring connection

Care must be taken to ensure that a pressure measuring connection is available in a suitable place on the gas appliance.

Component tested for

Testing basis

Function

Fuel gases according to DVGW Worksheet G 260

DIN 3398, Part 3, Issue 11/82, DIN EN 1854

Pressure monitor, pressure limiter

Pressure monitor (with internal or external interlock)

For maximum and minimum pressure monitoring

NG-4346 AP 1011 CE-0085 AQ 1088

Direction of action

DVGW Reg. No.

CE Ident. No.

DVGW



(according to
Gas Appliance
Directive
90/396/EEC)

Product Summary

Type	Setting range	Switching differential (mean values)	Max. working pressure	Materials in contact with medium	Dimen- sioned drawing
DGM 306 A	15...60 mbar	6 mbar	0.8 bar	CU + Ms	1 + 13
DGM 310 A	20...100 mbar	7 mbar	0.8 bar	CU + Ms	
DGM 325 A	40...250 mbar	10 mbar	0.8 bar	CU + Ms	
DGM 06 A	100...600 mbar	25 mbar	2 bar	CU + Ms	1 + 14
DGM 1 A	0.2...1.6 bar	40 mbar	3 bar	CU + Ms	1 + 12
DGM 506	15...60 mbar	8 mbar	5 bar	1.4104	
DGM 516	40...160 mbar	12 mbar	5 bar	1.4104	
DGM 525	100...250 mbar	20 mbar	5 bar	1.4104	

For other pressure ranges see type series DWR



-versions

Degree of protection EEx de IIC T6, housing 700

Ex-DGM 506	15...60 mbar	10 mbar	5 bar	1.4104	3 + 12
Ex-DGM 516	40...160 mbar	12 mbar	5 bar	1.4104	
Ex-DGM 525	100...250 mbar	20 mbar	5 bar	1.4104	

For other pressure ranges see type series DWR

EEx-i version (intrinsically safe)

Housing 500

DGM 306-513	15...60 mbar	6 mbar	0.8 bar	CU + Ms	2 + 13
DGM 310-513	20...100 mbar	7 mbar	0.8 bar	CU + Ms	
DGM 325-513	40...250 mbar	10 mbar	0.8 bar	CU + Ms	
DGM 06-513	100...600 mbar	25 mbar	2 bar	CU + Ms	2 + 14
DGM 1-513	0.2...1.6 bar	40 mbar	3 bar	CU + Ms	2 + 12
DGM 506-513	15...60 mbar	10 mbar	5 bar	1.4104	
DGM 516-513	40...160 mbar	12 mbar	5 bar	1.4104	
DGM 525-513	100...250 mbar	20 mbar	5 bar	1.4104	

Calibration

The **DGM** series is calibrated for rising pressure. This means that the adjustable switching pressure on the scale corresponds to the switching point at rising pressure. The reset point is lower by the amount of the switching differential. (See also page 30, 2. Calibration at upper switching point).


For other pressure ranges see type series DWR




Degree of protection:
IP 54/65

Dimensioned drawings of switch housings


1 Housing 200 (plug connection)

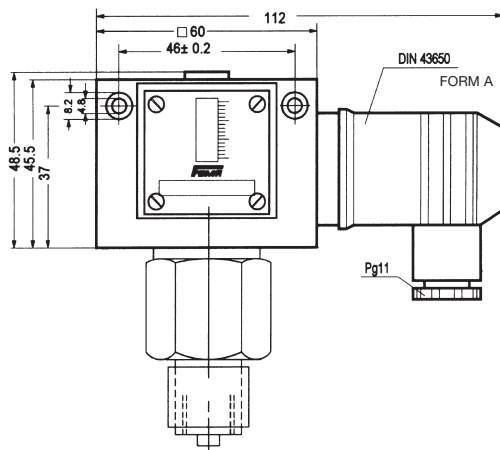

2 Housing 300 and 500 (terminal connection)

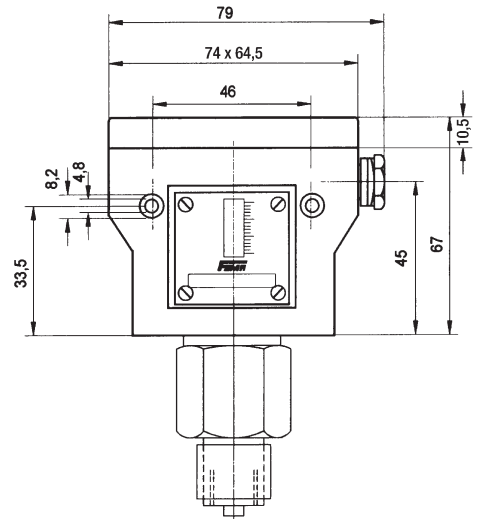


3 Housing 700 (Ex)

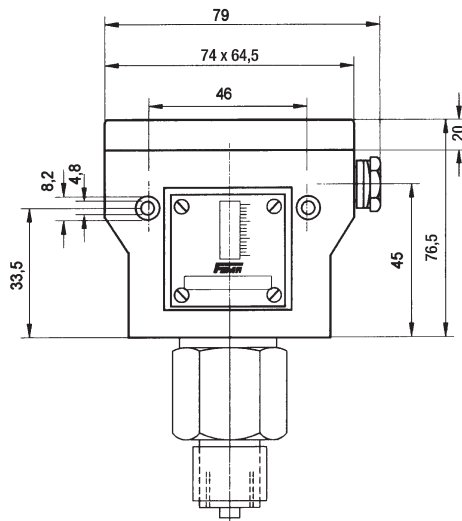


Dimensioned drawings of pressure sensors






10

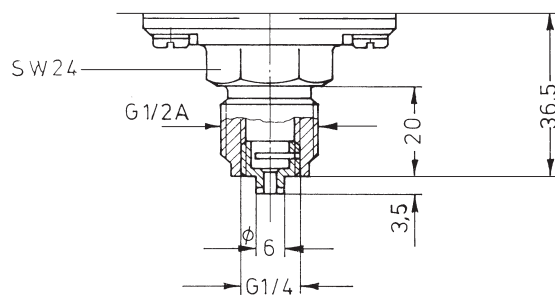



11

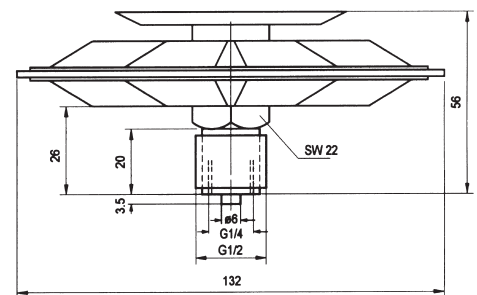

Dimensioned drawings of pressure sensors

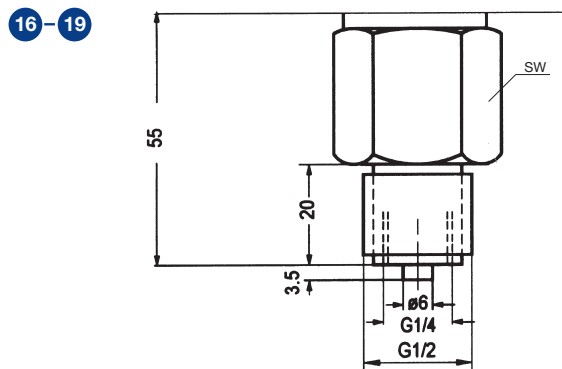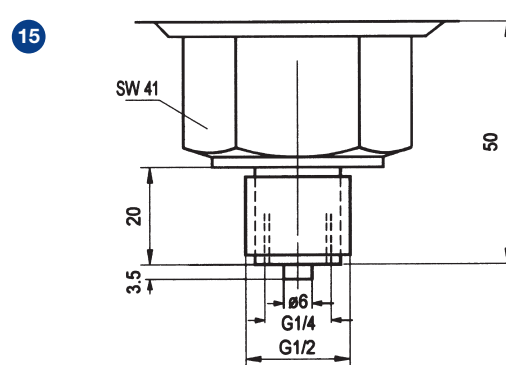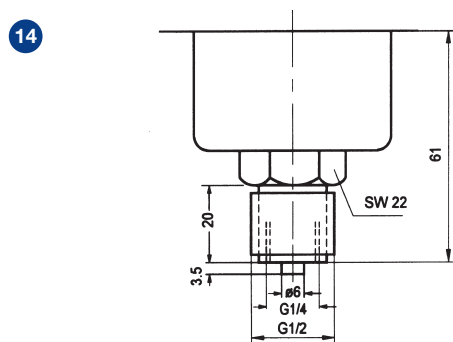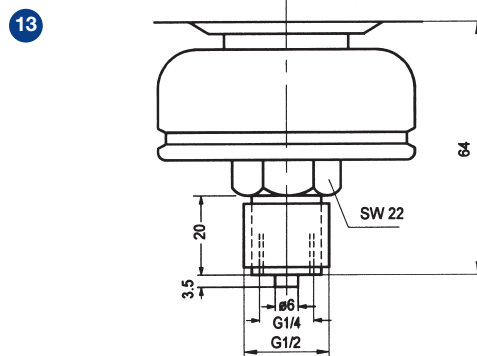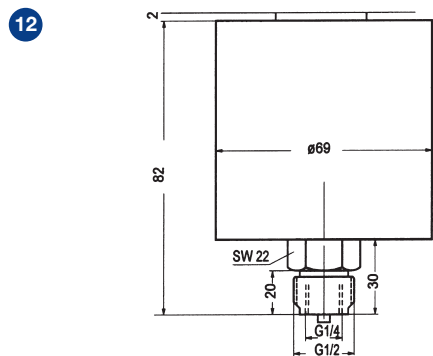

Dimensioned drawing	SW
16	22
17	24
18	30
19	32

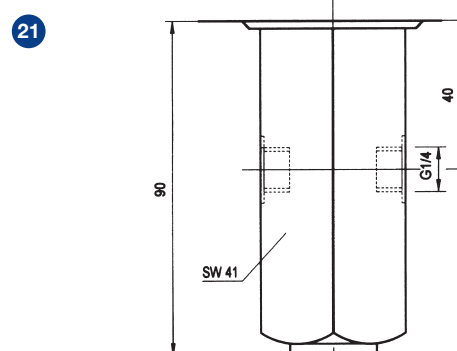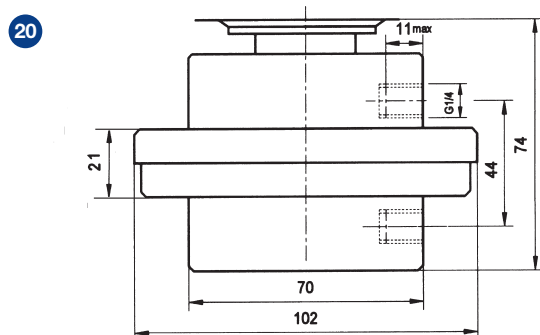



EX 011

Accessories for EX 011 series

Isolating amplifier for intrinsically safe control circuits

- 1-channel
- Control circuit EEx-ia IIC
- Reversible direction of action
- 1 signal output with 1 change-over
- EMC according to NAMUR NE 21

Application

Suitable for all pressure and temperature switches with microswitches (basic versions) and for devices with additional function ZF 513:

Technical data

Nominal voltage 230V, 45 Hz...65 Hz

Power consumption ≤ 1 W

Input (intrinsically safe) Terminals 1+, 3-

Nominal data according to DIN 19234

No-load voltage/short-circuit current
approx. 8 VDC/approx. 8 mA

Switching point 1.2 mA...2.1 mA

PTB approval PTB 00 ATEX 2081

Explosion protection EEx-ia

Outputs (not intrinsically safe)

Contact load

AC: 250V/2 A/cos. > 0.7

DC: 240V/1 A resistive load

Switching frequency ≤ 10 Hz

Electrical isolation

Input/output

according to DIN EN 50 020, safely electrically isolated.

Input/mains

according to DIN EN 50 020, safely electrically isolated.

Output/mains according to DIN EN 50 178

Ambient temperature $-20^{\circ}\text{C} \dots +60^{\circ}\text{C}$

Direction of action

The direction of action of the output can be adjusted with the slide switch S1 on the front of the housing.

LED

green = mains
yellow = relay output
red = line break

Slide switches


S1 Direction of action
S2 No function

Mounting

Standard rail 35 mm.

Dimensions

20 x 115 x 93 (W x H x D).

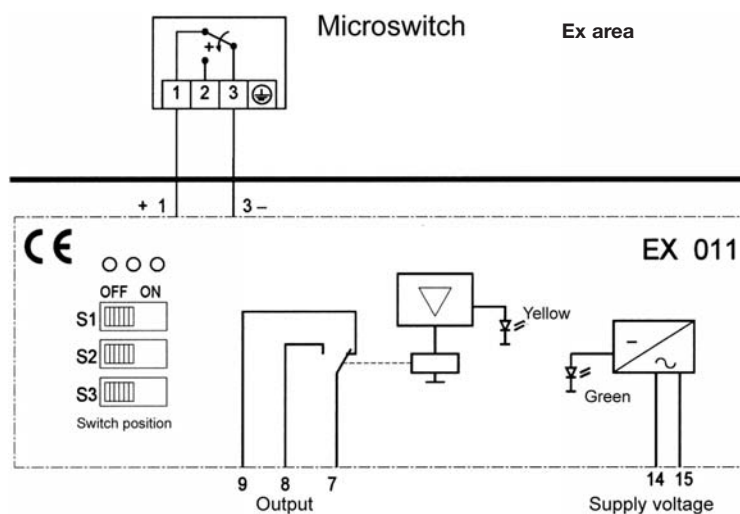

With the **type EX 011 isolating amplifier** intrinsically safe control circuit commands can be transmitted to non-intrinsically safe active circuits. The inputs are safely isolated from the outputs and from the mains in accordance with DIN EN 50 178.

Direction of action

The direction of action of the outputs can be adjusted with the slide switch S1 on the front of the housing.

Control circuit	Output relay	LED	
		yellow	red
Switching contact closed 	picked up	on	off
Switching contact open 	dropped out	off	off

The table applies to switch position S1 = OFF

Type designation	Supply voltage	Power consumption
Type		
EX 011	230V, 45...65 Hz	≤ 1 W



EX 041

Accessories for EX 041 series

for intrinsically safe control circuits with short-circuit and line break monitoring

- 1-channel
- 1 failsafe relay output according to DIN VDE 0660 Part 209 (BIA certificate no. 940 64)
- Control circuit EEx-ia IIC
- 1 progressive output with 1 normally open contact
- 1 passive electronic output, error message

Application

Suitable for all safety-engineered pressure monitors/pressure limiters, with microswitches and resistor combination
ZF 576 ZF 574 ZF 577 ZF 575, FD series

Technical data

Nominal voltage 230V, 48 Hz...62 Hz

Power consumption ≤ 3 W

Input (intrinsically safe) Terminals 10+, 12-

No-load voltage/short-circuit current
approx. 8.4 VDC/approx. 11.7 mA

Switching point

Relay dropped out $J < 2.1$ mA and $J > 5.9$ mA
Relay picked up 3.2 mA $< J < 5$ mA

Line resistance

< 50 ohm. Cable capacitances and inductance must be taken into account in the Ex area.

PTB approval PTB 00 ATEX 2043

Explosion protection, category EEx-ia

Outputs (not intrinsically safe)

Output I: (failsafe)

Relay terminals 13, 14

Output II: (not failsafe)

Relay terminals 15, 21

Contact load

AC: 250V/1 A/cos. > 0.7

DC: 24V/1 A resistive load

Output III

Error message (not failsafe)

Electronic output, passive, terminals 16+, 17-

Nominal voltage DC 10 V...30 V

Nominal current < 7 mA, short-circuit-proof

Switching frequency ≤ 5 Hz


Ambient temperature -20°C ... $+60^{\circ}\text{C}$

Installation Standard rail 35 mm.

Dimensions

40 x 115 x 93 (W x H x D).

Ex area

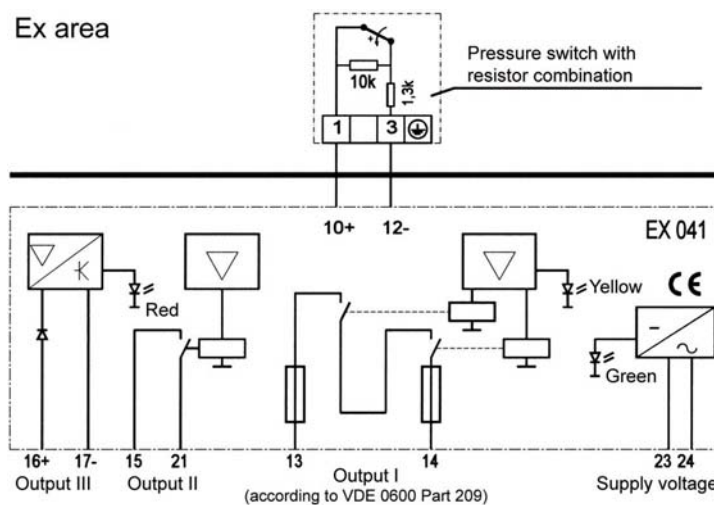

The **type EX 041 isolating amplifier** is used for the transmission of intrinsically safe control commands (e.g. from pressure switches) to non-intrinsically safe active circuits. **In the event of short-circuit or line break in the control circuit, the isolating amplifier switches to the safe side** (see "Direction of action" table). It also reacts to the safe side (output relay drops out) if internal component failures and resultant errors occur.

Output I Relay output failsafe according to VDE 0660, Part 209, terminals separately led to the outside for series connected protective interlock circuit, for example.

Output II Progressive output with relay stage (not failsafe).

Output III Alarm output potential-free (not failsafe).

Important note

The type EX 041 isolating amplifier can only be used together with pressure switches with resistor combination (additional function ZF 576, ZF 577..., see also "Application" above).

Direction of action

Control circuit	Output relay I and II	Status indicator yellow	red	Electronic output III
Switching contact closed	picked up	on	off	blocked
Switching contact open	dropped out	off	off	blocked
Line break or short-circuit in the input circuit	dropped out	off	on	switched through
Contact welding Output I	dropped out	off	on	switched through

Type designation	Supply voltage	Power consumption
EX 041	230 V, 48...62 Hz	≤ 3 W



Accessories for ZFV series

Pressure mediators attached to pressure switches

A separating diaphragm or a pressure mediator is necessary if aggressive, viscous or crystallizing media must be kept away from the actual pressure sensor. A pressure mediator is also indispensable to avoid cavities if easy cleaning of the supply lines is important. Special "milk pipe unions" according to DIN 11 851 are customary for pressure monitoring in the foodstuffs industry. Pressure mediators and evaluating devices

(pressure switches, pressure transmitters, pressure gauges) from a self-contained unit. The transmission fluid (filling medium) transmits the medium pressure from the separating membrane to the measuring element. The filling medium M 20 is food-safe and, being able to withstand temperatures from -40 to $+300^{\circ}\text{C}$, is also suitable for industrial applications.

Technical data

Material 1.4571.


Realization

Fully assembled, evacuated, filled and adjusted.

Filling medium M 20, food-safe.

Max. permissible pressure

40 bar (applies to separating diaphragm only. The max. permissible pressure of the pressure switch or pressure transmitter must be observed).

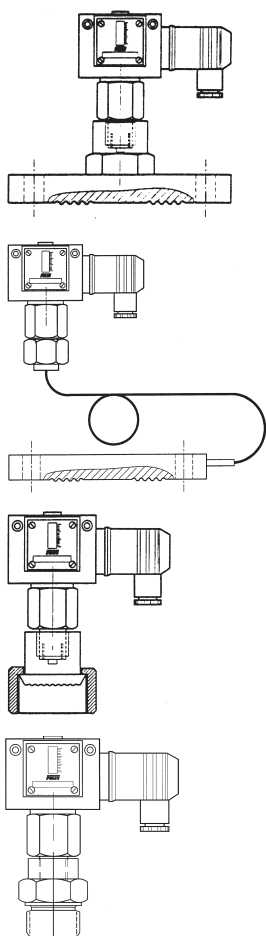

Product Summary

DN	Switching point from	Temperature range*	Type
Flanged pressure mediators made of stainless steel 1.4571, membrane flush to the front, flange to DIN 2527			
50	0.3 bar	$-40 \dots 120^{\circ}\text{C}$	ZFV 184-50
80	0.15 bar		ZFV 184-80
with Teflon coating			
50	0.3 bar	$-40 \dots 120^{\circ}\text{C}$	ZFV 184-50PTFE
80	0.15 bar	$-40 \dots 120^{\circ}\text{C}$	ZFV 184-80PTFE
Flanged pressure mediators with 1 m pipeline, flange to DIN 2527			
50	0.3 bar	$-30 \dots 300^{\circ}\text{C}$	ZFV 185-50
80	0.15 bar		ZFV 185-80
with Teflon coating			
50	0.3 bar	$-30 \dots 300^{\circ}\text{C}$	ZFV 185-50PTFE
80	0.15 bar	$-30 \dots 300^{\circ}\text{C}$	ZFV 185-80PTFE

Pipeline up to a maximum of 10 m on request

Technical information

Combinations with pressure mediators are filled and calibrated at 20°C . Very different operating temperatures can adversely affect the measurement result, particularly with long capillary pipes and large flange diameters. Furthermore, all capillary pressure mediators must be filled and adjusted at the same height as the evaluation unit. If the measuring points and the evaluation units are at different heights within the system, any pressure difference must be taken into account when setting the switching points. This effect is particularly noticeable when monitoring small system pressures.

DN	Switching point from	Temperature range*	Type
Pressure mediators for the foodstuffs industry with milk pipe connection according to DIN 11851			
50	0.4 bar	$-30 \dots 120^{\circ}\text{C}$	ZFV 162-50
with Teflon coating			
50	0.4 bar	$-30 \dots 120^{\circ}\text{C}$	ZFV 162-50PTFE
Screw-in pressure mediators flush to the front			
G 1	0.6 bar	$-30 \dots 120^{\circ}\text{C}$	ZFV 749


* Please note that the temperature at the pressure switch must not exceed 60°C for long periods.

Note:

In future, all pressure switches purchased together with ZFV must be ordered in the following way:
e.g. DCM 6-S + ZF 1970
+ ZFV 184-50

Accessories


Siphons, NPT adapters, pressure surge reducers

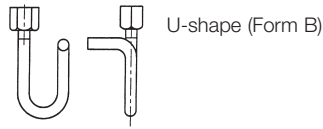


U-shape (Form B)



Circular (Form D)



NPT1



DMW-K

according to DIN 16282 made of seamless steel tube 20 mm ø

FORM B	Material	Type
Inlet: Weld-on end with weld chamfer	St 35.8-l	U 430 B
Outlet: Connection shank DIN 16 282 Form 6	1.4571	U 480 B
G 1/2" with clamping sleeve DIN 16 283 G 1/2"		

FORM D	Material	Type
Inlet: Weld-on end with weld chamfer	St 35.8-l	K 430 D
Outlet: Connection shank DIN 16 282 Form 6	1.4571	K 480 D
G 1/2" with clamping sleeve DIN 16 283 G 1/2"		

NPT adapter

The purpose of the NPT adapter is to connect pressure switches, pressure transmitters, pressure gauges etc. to NPT threaded connections. A suitable sealing washer is also supplied.


Description	Type
NPT adapter, material 1.4104 and sealing ring DIN 16 258, Form C material ITC to DIN 3754 Part 1	NPT 1

Pressure surge reducer


Medium	Material	Type
Water and gaseous media	Brass	DMW
Water and gaseous media	Brass	DMW-K

Accessories


Threaded joints and valve combinations for differential pressure




MAU 8 / Ms



MAU 8 / Nst



VKD 3

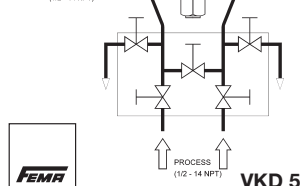

VKD 5



Threaded joint with male adapter union G 1/4"/8 mm

G 1/4" external thread with O-ring seal for connection of pipes with 8 mm external diameter for connection of:

Differential pressure switches DDCM... and other devices with G 1/4" internal thread

Product Summary

Body	O-ring	Type
Brass	NBR	MAU 8 / Ms
Stainless steel (1.4571)	FPM	MAU 8 / Nst

Max. permissible temperature: 100°C Max. permissible pressure: 100 bar

Valve combinations for differential pressure switches

The valve blocks are suitable for differential pressure switches DDCM 014 to DDCM 16 and for differential pressure transmitters FHBN...

Technical data

Pressure stage:	PN 420
Materials:	Housing 1.4404 Internal parts 1.4571
Seals:	PTFE
Process connections:	1/4-14 NPT
Included items:	Supplied complete with screw fittings and shaped pipe sections in stainless steel.

Product Summary

	Type
3-fold combination	VKD 3
5-fold combination	VKD 5

The 5-fold combination contains two additional venting valves.

Specifications

Pressure switches/isolating amplifiers

Type series Pressure switches

PST...	Electronic pressure switches for liquid and gaseous media with 2 open collector switching outputs and analogue output, power supply 14...36V DC, type of protection IP 65, switching points freely adjustable from ... to ... bar. Freely programmable analogue output 4–20 mA or 0–10 V (may also be inverted), process connection G 3/4" or G 1/2", absolute or relative pressure versions Type: PST...
PST...R	Electronic pressure switches for liquid and gaseous media with 2 open collector switching outputs, analogue output and potential-free relay output, power supply 14...36V DC, type of protection IP 65, switching points freely adjustable from ... to ... bar. Freely programmable analogue output 4–20 mA or 0–10 V (may also be inverted), process connection G 3/4" or G 1/2", absolute or relative pressure versions Type: PST...R
DCM...	Pressure switch with plug connection to DIN 43650. Switch housing made of diecast aluminium GD Al Si 12, type of protection IP 54. Range of adjustment from ... to ... bar/mbar. Switching differential adjustable / not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DCM...
DNM.../ VNM...	Pressure switch with plug connection to DIN 43650. Sensor housing made of stainless steel 1.4104. Switch housing made of diecast aluminium GD Al Si 12, type of protection IP 54. Range of adjustment from ... to ... bar/bar. Switching differential adjustable / not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DNM...
DNS.../ VNS...	Pressure switch with plug connection to DIN 43650. Sensor made entirely of stainless steel 1.4571. Switch housing made of diecast aluminium GD Al Si 12, type of protection IP 54. Range of adjustment from ... to ... bar/bar. Switching differential adjustable / not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DNS..., VNS...
DNS...351/ VNS...351	Pressure switch with terminal connection. Sensor made entirely of stainless steel 1.4571. Switch housing made of diecast aluminium GD Al Si 12, plastic-coated housing, type of protection IP 65. Range of adjustment from ... to ... bar/bar. Switching differential adjustable / not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DNS..., VNS...
DDCM 252... DDCM 6002	Differential pressure switch with plug connection to DIN 43650. Sensor made of aluminium, measuring diaphragm of Perbunan. Pressure connection G 1/4, internal, switch housing made of diecast aluminium GD Al Si 12, type of protection IP 54. Range of adjustment from ...to...bar/bar Type DDCM...
DDCM 1... DDCM 16	Differential pressure switch with plug connection to DIN 43650 Sensor made of stainless steel 1.4104 and 1.4571. Pressure connections G 1/4, internal. Switch housing made of diecast aluminium GD Al Si 12, type of protection IP 54. Range of adjustment from ...to ...bar/bar Type: DDCM...Type series
DWAM.../ DWAMV...	Pressure monitor "of special construction" for maximum pressure monitoring with self-monitoring sensor (safety sensor). Tested according to VdTÜV Memorandum "Pressure 100/1". Switch housing made of diecast aluminium GD Al Si 12, plug connection to DIN 43650, type of protection IP 54. Range of adjustment from ... to ... bar/bar. Switching differential adjustable / not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DWAM...
SDBAM...	Pressure limiter "of special construction" for maximum pressure monitoring. With internal interlock (reclosing lockout) with self-monitoring sensor (safety sensor), tested according to VdTÜV Memorandum "Pressure 100/1". Switch housing made of diecast aluminium GD Al Si 12, plug connection to DIN 43650, type of protection IP 54. Range of adjustment from ... to ... bar/mbar. Pressure connection G 1/2, external and G 1/4, internal Type: SDBAM...
DWR.../ DWR...203	Pressure monitor "of special construction" for maximum and minimum pressure monitoring. Tested according to VdTÜV Memorandum "Pressure 100/1" and DIN 3398 Part 3 and Part 4. Switch housing made of diecast aluminium GD Al Si 12, plug connection to DIN 43650, type of protection IP 54. Range of adjustment from ... to ... bar/bar. Switching differential adjustable / not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DWR...

Type series Pressure switches

DWR...205/ DWR...206	Pressure limiter "of special construction" for maximum pressure (205) or minimum pressure monitoring (206). With locking of switching state (reclosing lockout). Tested according to VdTÜV Memorandum "Pressure 100/1" and DIN 3398 Part 3 and Part 4. Switch housing made of diecast aluminium GD Al Si 12, plug connection to DIN 43650, type of protection IP 54. Range of adjustment from ... to ... bar/bar. Pressure connection G 1/2, external and G 1/4, internal Type: DWR...
DGM...	Pressure monitor for gas with plug connection to DIN 43650. DVGW-tested according to DIN 3398, Parts 1 and 3. Sensor casing of Cu/Zn/high grade steel 1.4104. Switch housing of diecast aluminium GD Al Si 12, plug connection to DIN 43650, type of protection IP 54. Range of adjustment from ... to ... bar/bar. Switching differential not adjustable. Pressure connection G 1/2, external and G 1/4, internal Type: DGM...
DWAM...576	Pressure monitor "of special construction" for maximum pressure monitoring. With self-monitoring sensor (safety sensor), positive opening contacts (gold-plated). Resistor combination for wire break and short-circuit monitoring. Tested according to VdTÜV Memorandum "Pressure 100/1". Switch housing made of diecast aluminium GD Al Si 12, type of protection IP 65. Range of adjustment from ... to ... bar/bar. Pressure connection G 1/2, external and G 1/4, internal Type: DWAM...576
FD 16 –326	Pressure monitor "of special construction" for maximum pressure monitoring in liquid gas systems with self-monitoring sensor (safety-sensor). Resistor combination for wire break and short-circuit monitoring. TÜV-tested according to VdTÜV Memorandum "Pressure 100/1" and DIN 3398, Part 4. Explosion protection: EEx-i. Switch housing made of GD Al Si 12, type of protection IP 65. Adjustable from 3 to 16 bar. Pressure connection G 1/2, external and G 1/4, internal Type: FD 16 –326
FD 16 –327	Pressure limiter "of special construction" for maximum pressure monitoring in liquid gas systems with self-monitoring sensor(safety-sensor). Switching state interlock (reclosing lockout). Resistor combination for wire break and short-circuit monitoring. TÜV-tested according to VdTÜV Memorandum "Pressure 100/1" and DIN 3398, Part 4. Explosion protection: EEx-i. Switch housing made of GD Al Si 12, type of protection IP 65. Adjustable from 3 to 16 bar. Pressure connection G 1/2, external and G 1/4, internal Type: FD 16-327

Type series Isolating amplifier

Ex 011	Isolating amplifier for intrinsically safe control circuits. Explosion protection: EEx-ia IIC. Signal output: 1 change-over, nominal voltage 230 V, 45 –60 Hz Type: Ex 011
Ex 041	Safety-engineered isolating amplifier for intrinsically safe control circuits. Explosion protection: EEx-ia IIC. Signal output: 1 failsafe relay output, nominal voltage 230 V, 45 –60 Hz, type of protection IP 65 Type: Ex 041





The specifications refer to the listed normal versions of the pressure switches. In the case of Ex versions or devices with additional functions, the texts must be supplemented or amended accordingly.

A close-up photograph of a Honeywell FEMR pressure transmitter. The device is white with a red top and a red circular button. It features a digital display showing '00000 bar' and 'OUT2'. Below the display are two indicator lights, one yellow labeled '1' and one red labeled '2'. The text 'Honeywell FEMR' is printed above the display, and 'Smart Process' is visible on the lower left. The device has a threaded metal fitting at the bottom.

Pressure transmitters



Pressure and differential pressure transmitters/ Electrical pressure switches/transmitters

Type series	Pressure ranges	Medium	Output signal	Operating mode	Remarks/ Applications	Page
F 	Vacuum up to 40 bar Differential pressure up to 10 bar Operating ranges continuously adjustable	liquid and gaseous	0–10 V 0–20 mA 4–20 mA (3-conductor system)	Mechanical-inductive	For general applications in liquid and gaseous media.	67 – 73
PST 	-1...600 bar	liquid and gaseous stainless steel sensors	0–10 V 10–0 V 4–20 mA 20–4 mA 2-channel switch	Piezoresistive	Electronic pressure switches with configurable transmitter output	6 – 17
SN 	Up to 60 bar Operating ranges continuously adjustable	liquid and gaseous (stainless steel sensors)	0–10 V / 4–20 mA (3-conductor-system) 4–20 mA (2-conductor-system)	Piezoresistive	Highly accurate Hermetically encapsulated sensor system made of stainless steel.	74 – 78
DPT 	Differential pressure -50 Pa/+50 Pa up to 0–2500 Pa	gaseous	0–10 V / 4–20 mA (3-conductor-system) 4–20 mA (2-conductor-system)	Piezoresistive	Ventilation and air-conditioning systems	79
Accessories Specifications						80 – 82 83

Type series F


Pressure transmitters, mechanical-inductive

Operating method


Pressure transmitters are used to convert over-pressure, vacuum or differential pressure into a proportional electrical signal of 0–10 V, 0–20 mA (4–20 mA). A metal bellows or diaphragm is exposed to the occurring pressure. The pressure-dependent movements of the metal bellows

are transmitted free of play to an inductive displacement sensor. The electronic system converts the position of the displacement sensor into a proportional electrical signal (voltage and injected current).

General technical information

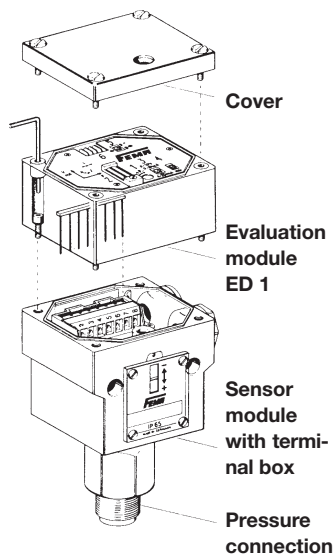

Operating principle

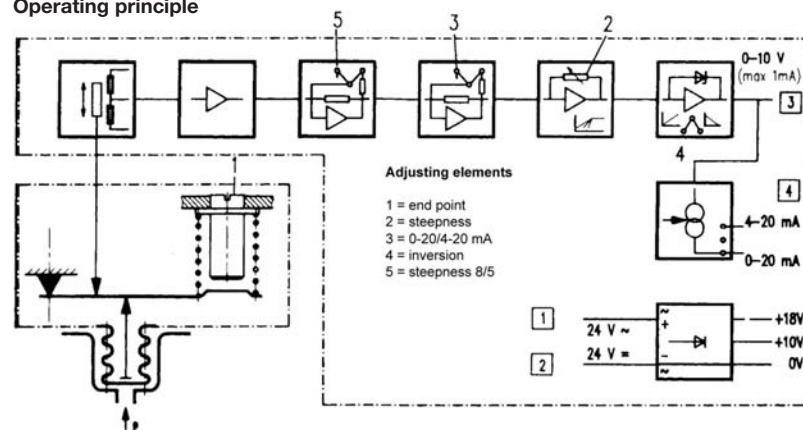

A complete transmitter consists of a sensor module with pressure and electrical connections, an evaluation module and a cover.

Additional evaluation modules can be plugged in.

Type series	F...+ ED 1	F...+ ED 3
Electrical connection	<p>Terminal connection</p> <p>Output signal 0–10 V and 0–20 mA</p>	<p>Plug connection</p> <p>Output signal 0–10 V</p>
Voltage output characteristic		
Current output characteristic		



Pressure FN... + ED 1

Differential pressure FHBN... + ED 1

Type series F... + ED 1

with terminal connection


Pressure transmitter with 3 conductors

- with 2 output signals 0–10 V and 0–20 mA
- Switchable to 2–10 V and 4–20 mA and invertible
- Plug-in display module AZ 331

Pressure transmitters of the F series produce 0–10 V / 0–20 mA. Both signals are applied to the terminal strip and can be used in parallel. A

complete transmitter consists of a sensor parts and the plug-in evaluation module ED 1. Removing the cover gives access to an operator interface for adjusting the operating range. A plug-in digital display AZ 331 is available to display the output signal in any units (voltage / current / pressure / differential pressure). For further details see Datasheet AZ.

Characteristic of a transmitter
(nominal range)



Product Summary

Operating range (nominal range) $P_0 - P_N$	Smallest adjustable operating range	Max. permissible pressure (approx. values)	Sensor material	Type
---	---	---	--------------------	------

Overpressure

0 – 50 mbar	20 mbar	2.5 bar		FN 505 + ED 1
0 – 100 mbar	25 mbar	5 bar		FN 510 + ED 1
0 – 250 mbar	65 mbar	6 bar	1.4104	FN 025 + ED 1
0 – 500 mbar	125 mbar	6 bar	+	FN 05 + ED 1
0 – 1 bar	250 mbar	6 bar	1.4571	FN 1 + ED 1
0 – 2.5 bar	0.7 bar	16 bar		FN 3 + ED 1

Vacuum

–1 to 0 bar	250 mbar	6 bar	1.4104	FVN 111 + ED 1
–1 to 1 bar	500 mbar	6 bar	+	FVN 112 + ED 1
–1 to 5 bar	1.5 mbar	25 bar	1.4571	FVN 105 + ED 1
–250 to +250 mbar	125 mbar	3 bar		FVN 125 + ED 1

Differential pressure

0 – 500 mbar	125 mbar	10 bar		FHBN 05 + ED 1
0 – 1 bar	250 mbar	15 bar	1.4305	FHBN 1 + ED 1
0 – 2.5 bar	0.7 bar	15 bar	+	FHBN 3 + ED 1
0 – 5 bar	1.25 mbar	15 bar	1.4571	FHBN 5 + ED 1
0 – 10 bar	2.5 mbar	25 bar		FHBN 10 + ED 1

+ Accessories

- Plug-in display module AZ 331
- Programmable display APV 630

For differential pressure

- Valve combination VKD 3, VKD 5
- Threaded joint with male adapter union MAU 8

i Note

- If measured values diverge due to higher static (system) pressure, observe the adjustment instructions on page 71.




Type series F...+ ED 3

with plug connection

- Openable plug connection is easy to fit and service, with a transparent front
- 0–10 V output (invertible)
- Plug-in display module AZ 331

Pressure and differential pressure transmitters of the F...+ ED 3 series (with voltage output) are almost identical to versions ...ED 1. A voltage signal is available at the connection plug. Possible settings are described on pages 71 – 72.

Characteristic ED 3



Product Summary

Operating range (nominal range) P_0 – P_N	Smallest adjustable operating range	Max. permissible pressure (approx. values)	Sensor material	Type
Overpressure				
0 – 50 mbar	20 mbar	2.5 bar		FN 505 + ED 3
0 – 100 mbar	25 mbar	5 bar	1.4104	FN 510 + ED 3
0 – 250 mbar	65 mbar	6 bar	+	FN 025 + ED 3
0 – 500 mbar	125 mbar	6 bar	1.4571	FN 05 + ED 3
0 – 1 bar	250 mbar	6 bar		FN 1 + ED 3
0 – 2.5 bar	700 mbar	16 bar		FN 3 + ED 3
Vacuum				
–1 to 0 bar	250 mbar	6 bar	1.4104	FVN 111 + ED 3
–1 to +1 bar	500 mbar	6 bar	+	FVN 112 + ED 3
–1 to 5 bar	1500 mbar	25 bar	1.4571	FVN 105 + ED 3
–250 to +250 mbar	125 mbar	3 bar		FVN 125 + ED 3
Differential pressure				
0 – 500 mbar	125 mbar	10 bar		FHBN 05 + ED 3
0 – 1 bar	250 mbar	15 bar	1.4305	FHBN 1 + ED 3
0 – 2.5 bar	0.7 bar	15 bar	+	FHBN 3 + ED 3
0 – 5 bar	1.25 bar	15 bar	1.4571	FHBN 5 + ED 3
0 – 10 bar	2.5 bar	25 bar		FHBN 10 + ED 3

+ Accessories


- Plug-in display module AZ 331

For differential pressure

- Valve combination VKD 3, VKD 5
- Threaded joint with male adapter union MAU 8

i Note


- If measured values diverge due to higher static (system) pressure, observe the adjustment instructions on page 71.

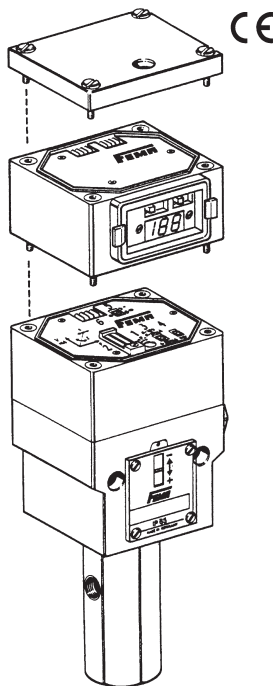


All plugged-in modules are powered via the terminal strip of the sensor module (on ED 1) or via the plug connection. The output signal is sent from each module for further evaluation via the same route. The power consumption increases by approx. 1 W for each additional module plugged in.

Connection schemes

Terminal connection

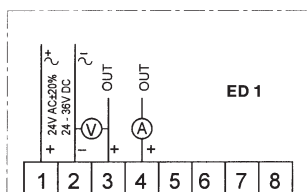

Plug connection



ED 3 output signal 0–10 V

Type series F

Technical data

Supply voltage

24 V AC $\pm 20\%$ or 24–36 V DC

Power consumption

Signal and supply voltage is connected to the sensor module.
max. 1 W

Outputs (short-circuit proof)

0–10 V, 2–10 V (± 1 mA),
0–20 mA, 4–20 mA (3-conductor system)
All outputs are invertible.

Load impedance

max. 750 Ohm.

Direction of action

Rising pressure produces a rising output signal (default setting).
Invert with slide switch 4.

Output signal

0–10 V and 0–20 mA

Voltage and current output can also be picked up and used simultaneously. Terminals 5–8 are reserved for later expansions and must not be connected as this would destroy the device.

Operating mode

mechanical, inductive

Sensor element

Pressure bellows or diaphragm

Pressure connection

G 1/2 external and G 1/4 internal.

On FH types: G 1/4 internal.

Cable entry

2 x M 16 x 1.5

Degree of protection

IP 65

Installation

Directly on the pressure line or mounted on wall with two 4 mm \varnothing screws.

Materials

see Product Summary.

Linearity

The maximum linearity error is approx. 1% of full scale.

Hysteresis

approx. 0.5% nominal range, related to full output

Long-term drift

0.2% FS / year

Repetition accuracy

approx. 0.2%

Accuracy class

1.0

Temperature drift

Range from 20–45°C approx. 0.02%/K

Range from 0–20°C approx. 0.05%/K

< = 3%/bar (see adjusting instructions, page 72)

Influence of static pressure

Vertical. With other mounting positions, the degree of protection and accuracy are different.

Mounting position

Ambient temperature

0 to 45°C

Max. medium temperature


70°C. Temperatures may reach 85°C for short periods. Higher medium temperatures are possible if the above limit values for the switching device are ensured by suitable measures (e.g. siphon).

–20 to +70°C

Storage temperature

! Important:

When connecting to control systems with a common AC supply, the ground conductor must be looped through. That is to say, on all devices in the system, the same reference potential must be present at the corresponding ground terminal (terminal 2). In the case of a DC supply, ensure correct polarity.

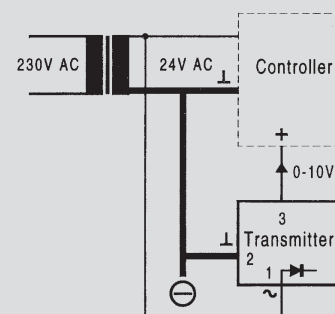

Type series F

Adjustment and operation

Operating ranges and output signals are adjustable over a wide range.


An outstanding characteristic of the pressure transmitters is the variability of the characteristic curve, which means that the pressure range and output signal can be adapted to any subsequent control system.

P_0 = starting pressure of nominal range

P_N = nominal pressure (end point of nominal range)


P_A = starting pressure of set range

P_E = end pressure of set range

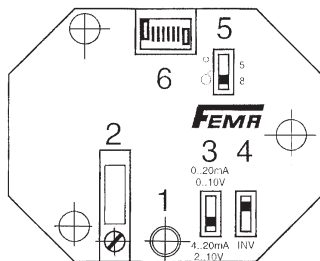

Operator interface ED 1


- 1 = Setting spindle for setting the final value P_E
- 2 = Setting potentiometer for setting the initial value P_A
- 3 = Slide switch for selecting the output signal 0–20 mA (0–10 V) or 4–20 mA (2–10 V)
- 4 = Slide switch for inverting the output signal
- 5 = Slide switch for changing the steepness of the characteristic in a ratio of 8:5.
Normal position: 8
For smaller operating ranges (< approx. 70% of the nominal range), select position 5
- 6 = Plug connector for further evaluation modules

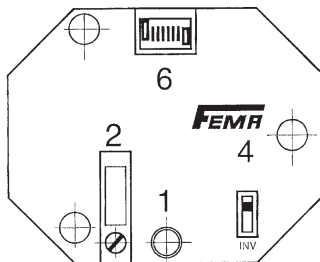

Operator interface ED 3


- 1 = Setting spindle for setting the final value P_E
- 2 = Setting potentiometer for setting the initial value P_A
- 4 = Slide switch for inverting the output signal
- 6 = Plug connector for further evaluation modules

Output signals for module ED 1




Basic setting

The factory default setting covers the nominal range P_0 (usually 0 bar) to P_N .



Altering the range


The range can easily be altered by shifting the end point and adjusting the steepness of the characteristic curve.



Inversion

The output signal can be inverted by means of a slideswitch.

Output signals for module ED 3






Range alteration and inversion as above.

The current signal can be reduced below 4 mA (down to approx. 2.5 mA). If the installation has a fault alarm system, the response threshold should be set below 2.5 mA.

Type series F

Setting and testing

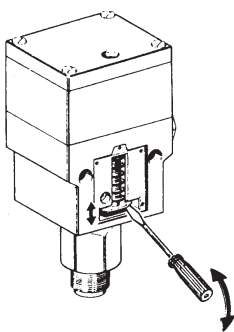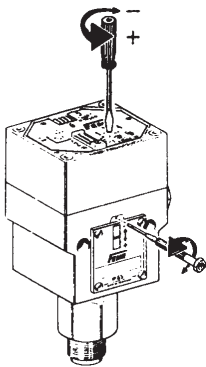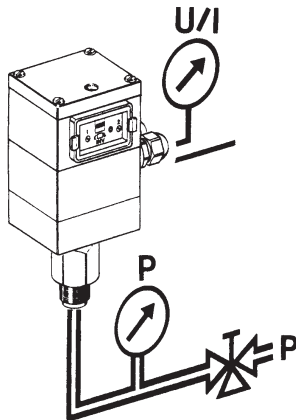

Altering the operating range

To check functioning or change the settings from outside the system, a test set-up is required which meets the following requirements:

1. It must be possible to apply pressure to the pressure transmitter up to the desired final value. The pressure must be displayed by a sufficiently accurate pressure gauge.
2. To display the output signal a voltmeter with a measuring range of 0–10 V (preferably 0–15 V) or an ammeter with a measuring range of 0–20 mA (preferably 0–25 or 0–30 mA) are required.
3. To supply power to the transmitter, a 24 V AC or 24 V DC voltage source is needed.

Setting operations must be carried out in the correct sequence

1. Remove the plastic cover
2. Set the slide switches (3) and (4) to the correct position (switch 3 is only present on ED 1)
Switch (3): Output signal 0–10 V / 0–20 mA or 4–20 mA / 2–10 V (only on ED 1)
Switch (4): Direction of action
Switch up: rising pressure = rising output signal
Switch down (INV): rising pressure = falling output signal
3. Loosen the locking screw above the cover glass (approx. 2 turns anticlockwise)
4. Apply final pressure P_E
5. Using a screwdriver, turn the setting spindle (1) to the desired output signal (depending on position of slide switches (3) and (4): 10 V, 20 mA, 0 V, 0 mA, 4 mA)
6. Apply starting pressure P_A
With the potentiometer (2), adjust the output signal to the desired value (depending on position of slide switches: 0 V, 0 mA, 10 V, 20 mA, 4 mA)
7. Check the setting again and then retighten the locking screw for the setting spindle.

Important: Always set the upper final value P_E with the setting spindle (1) first, and then the lower initial value P_A with the potentiometer (2).

Generating an output signal without pressure

It can often be very useful to generate an output signal before commissioning the system, in order to check electrical operation, the direction of action and the functioning of downstream control elements. The procedure is as follows:

1. Loosen the four screws on the scale window and remove the cover glass, scale plate and rubber seal.
2. In the lower, wide part of the cut-out in the housing, insert the tip of a small screwdriver underneath the bridge.
3. Carefully move the bridge up and down. When the supply voltage is applied, the output signal should change depending on the movements of the bridge.
4. Check the direction of action. Upward movement of bridge corresponds to rising pressure.
5. Once you have finished testing, carefully screw the parts back on again in the following order: rubber seal, scale plate, cover glass.





Caution: In the event of incorrect assembly, IP 65 protection is no longer assured.

Adjustment instructions: Correction of effect with static pressure

- The system in which the FHBN is installed must be filled and exposed to the usual static pressure.
- A differential pressure must not be active, i.e. no pump operation and no flow.
- Remove the plastic cover and check slide switches 3 + 4.
- The FHBN is supplied with the correct voltage and the output voltage is displayed.
- Loosen the spindle locking screw above the inspection window.
- Adjust setting spindle "1" with a screwdriver until the output signal is "0".
- Retighten the spindle with the spindle locking screw.

Type series F

Dimensioned drawings

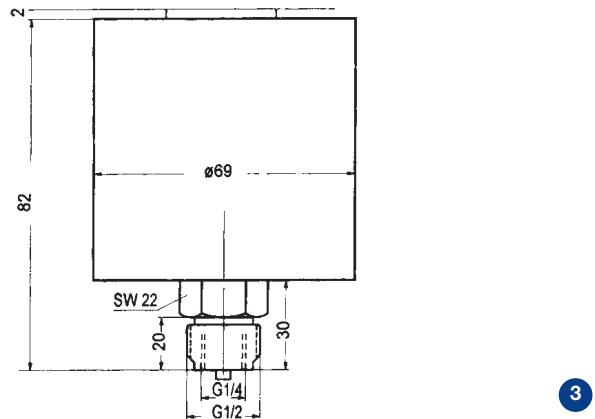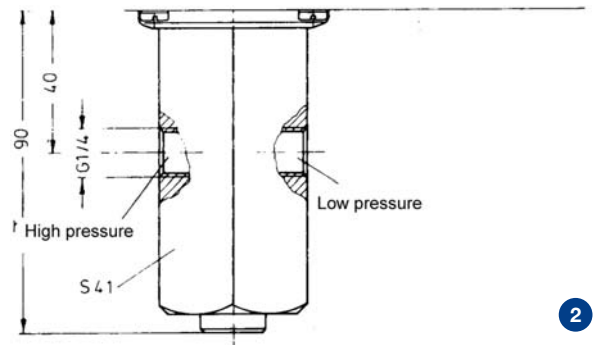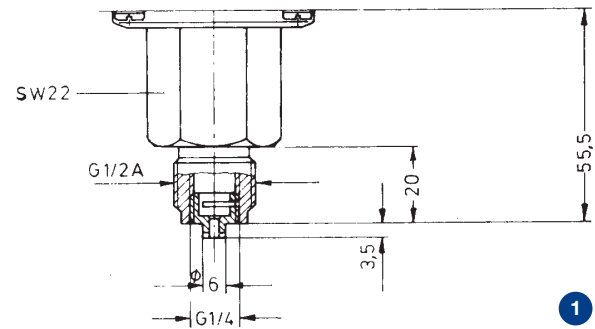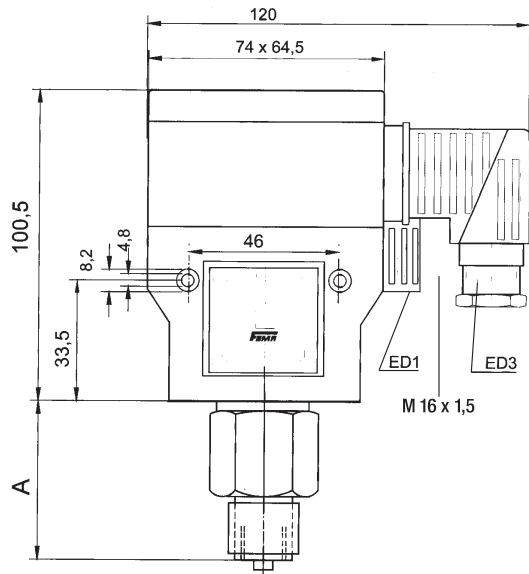

Dimensioned drawing no.	Types	A
1	FN 025-FN 3 FVN...	55,5
2	FHBN...	90
3	FN 505, FN 510	82

Height of evaluation module = 1 Module height = 34 mm.
The dimensions are for the basic device, consisting of sensor and evaluation module.
Each further plug-in module increases the overall height by one module unit = 34 mm.


Type series SN...311

 2 output signals
 0–10 V and 4–20 mA

Type series SN 3

Pressure transmitters, piezoresistive, 3-conductor system

The nominal ranges of types SN...311 mentioned in the Product Summary below can be limited by 50% of the nominal range via setting potentiometers of the evaluation electronics. The smallest settable operating range is indicated in column 2 of the Product Summary. The zero

point can likewise be shifted by 50% of the nominal range.

Inversion of output signal possible on SN...-311 and ...-395.

Technical data

Pressure connection	G 1/2 external, wrench size 27
Cable entry	2 x Pg 9
Degree of protection	IP 65
Mounting	Directly on pressure line
Materials	Sensor housing: 1.4571 Pressure diaphragm: 1.4435 Terminal housing: Makrolon
Service life	100m cycles (typical)
Dimensions	See page 73.
Operating voltage	24 V AC \pm 20% or 24 V...36 V DC
Power consumption	max. 1 W
Synchronization error of voltage and current output on SN 311	max. \pm 0.3% FS
Load impedance	0–10 V impedance $>$ 10 k Ω 4–20 mA impedance \leq 650 Ω
Linearity error	max. \pm 0.5% FS
Hysteresis	max. \pm 0.1% FS
Temperature hysteresis	max. \pm 0.5% FS
Reproducibility	max. \pm 0.1% FS
Overall accuracy	\leq 1%
Medium temperature	–30 to 100°C
Compensated range	0–100°C
Temperature drift	max. \pm 0.04% FS/K
Ambient temperature	0–50°C
Inversion of output signal	On SN...311 and SN 395
LED digital display (optional)	Powered via transmitter.
AZ 331	No separate supply needed.

Product Summary

Operating range (nominal range) (bar)	Smallest settable operating range (bar)	Max. permissible pressure (bar)	Type
---------------------------------------	---	---------------------------------	------


2 output signals 0–10 V and 4–20 mA terminal connection, range adjustable

0 – 0.25	0.125	0.75	SN 025-311
0 – 0.6	0.3	1.8	SN 06-311
0 – 1	0.5	3	SN 1-311
0 – 2.5	1.25	7.5	SN 3-311
0 – 6	3	18	SN 6-311
0 – 10	5	30	SN 10-311
0 – 25	12.5	70	SN 25-311
0 – 40	20	80	SN 40-311


Output signal 0–10 V plug connection, range adjustable via jumpers (50%, 20%)

0 – 0.25	0.05	0.75	SN 025-395
0 – 0.6	0.12	1.8	SN 06-395
0 – 1	0.2	3	SN 1-395
0 – 2.5	0.5	7.5	SN 3-395
0 – 6	1.2	18	SN 6-395
0 – 10	2	30	SN 10-395
0 – 25	5	70	SN 25-395
0 – 40	8	80	SN 40-395

Connection scheme SN...311



Connection scheme SN 395



Type series SN...395


Output signal 0–10 V
 Not adjustable, inversion **not** possible. Plug connection (digital display AZ 331)



SN 280

Type series SN...-280

The low-voltage plugs on SN transmitters can be opened up. This simplifies fitting and also means that the supply voltage and output signal can be measured directly from the opened plug.



As-delivered condition:

The transmitters are fully assembled in the factory (sensor + evaluation module + cover) and set to the nominal range. Additional modules and external modules are supplied separately.


Technical data

Electrical connection	Plug connection DIN 43650 PG 11
Supply voltage	12 V...30 V DC
Ambient temperature	0...+60°C
Material	Housing: Makrolon Sensor: 1.4571 Diaphragm: 1.4435
Degree of protection	IP 65
Included accessories	Plug DIN 43650
Pressure connection	G 1/2 external
Wrench size	27
Installation	Directly on pressure line
Linearity	≤ 1% FS
Compensated range	0–100°C
Response time	≤ 10 ms
Max. medium temperature	–30...+110°C
Measuring principle	Piezoresistive
Mounting	Directly on pressure line
Output signal	4...20 mA, imped- ance ≤ (UB–10 V) / 0.02 A
Overall accuracy	≤ 1% FS (fixed-point line)
Ambient temperature	0...60°C
Direction of action	Rising pressure pro- duces rising output signal
Accessories	Plug-in display AZG 241

Product Summary

Operating range (bar)	Operating range (kPa)	Max. pressure (bar)	Type
0 – 0.25	0 – 25	0.75	SN 025-280
0 – 0.6	0 – 60	1.8	SN 06-280
0 – 1	0 – 100	3	SN 1-280
0 – 1.6	0 – 160	6.4	SN 2-280
0 – 2.5	0 – 250	7.5	SN 3-280
0 – 4	0 – 400	16	SN 4-280
0 – 6	0 – 600	18	SN 6-280
0 – 10	0 – 1000	30	SN 10-280
0 – 16	0 – 1600	48	SN 16-280
0 – 25	0 – 2500	70	SN 25-280
0 – 40	0 – 4000	80	SN 40-280


Connection scheme SN...-280



The power supply is connected to terminals 1+ / 2–

Type series SN 3

Operator interface / operating ranges

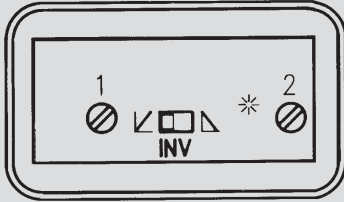

3-conductor systems (SN...-3)

Adjusting elements:

1 = zero point

2 = end point

INV = direction of action (INVERSION)


Optical indication of output signal via LED

The LED becomes brighter as the output signal increases. A zero signal can be displayed by briefly operating the INV switch. With output signal "0" and the slide switch in the "INV" position, the LED is brightly lit.

Do not forget to turn the switch back!

Operator interface

The adjusting elements are accessible after removing the cover glass on the evaluation module.

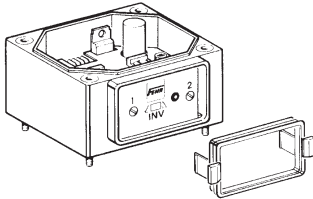

Operating ranges are adjustable over a wide range

Basic setting



The factory default setting covers the nominal range P_0 (usually 0 bar) to P_N .

P_0 = Starting pressure of nominal range

P_N = Nominal pressure (end point of nominal range)

P_A = Starting pressure of set range



P_E = End pressure of set range



Altering the range

The range can easily be altered by shifting the zero point and adjusting the steepness of the characteristic curve.


Observe the correct sequence of adjustment (see next page).



Inversion

(only on 3-conductor system)


The output signal can be inverted with the "INV" slide switch.



Inversion not possible on 2-conductor system.

Type series SN 3

Setting the operating range, testing

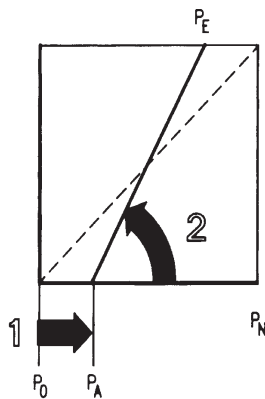

Preliminary remark: The transmitters are carefully set in the factory to the nominal range. If the operating range is changed to different values, the guaranteed accuracy no longer applies. The attainable accuracy depends, among other things, on the care taken during adjustment.

Warm up the device before making adjustments.

Accurate settings are only possible with the device at operating temperature; therefore connect the power supply approximately 10 minutes before starting to make adjustments.

Setting operations must be carried out in the correct sequence


1. Apply minimum pressure P_A to the sensor and set the output signal to 0 V or 4 mA with potentiometer 1.
2. Apply maximum pressure P_E to the sensor. Set output signals to 10 V / 20 mA with potentiometer 2.
3. Check the settings.

Important: Always set the zero point with potentiometer 1 first, then set the amplification (end of range) with potentiometer 2.

For inversion of the output signal, operate slide switch INV and repeat the setting procedure in the same way. Inversion is only possible on 3-conductor systems.

The plug-in digital display AZ facilitates accurate setting

Digital display AZ 331 (additional module) can be very useful for setting operating ranges which differ from the nominal range. The digital display (factory setting 0–10 V) plugs into the connector 6 and shows the output signal continuously during the setting process.

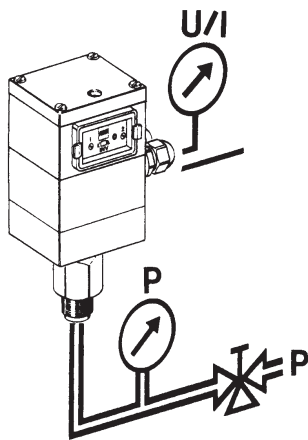


Device arrangement for calibration and testing from outside the system

To check functioning or change the settings from outside the system, a test set-up is required which meets the following requirements:


1. It must be possible to apply pressure to the pressure transmitter up to the desired final value. The pressure must be displayed by a sufficiently accurate pressure gauge.
2. To display the output signal a voltmeter with a measuring range of 0–10 (preferably 0–15 V) or an ammeter with a display range of 0–20 mA (preferably 0–25 or 0–30 mA) are required.
3. To supply power to the transmitter, a 24 VAC or 24 VDC voltage source is needed.

Type series SN

Dimensioned drawings

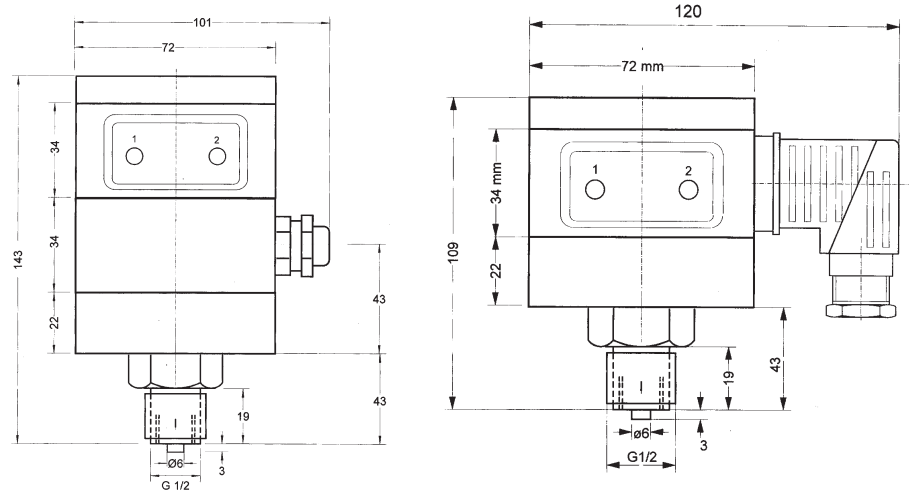


SN...311

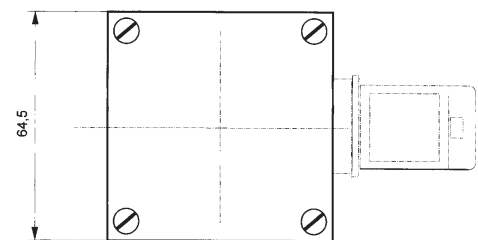

SN...-395/-280

Type series DPT (D)

Dimensioned drawings

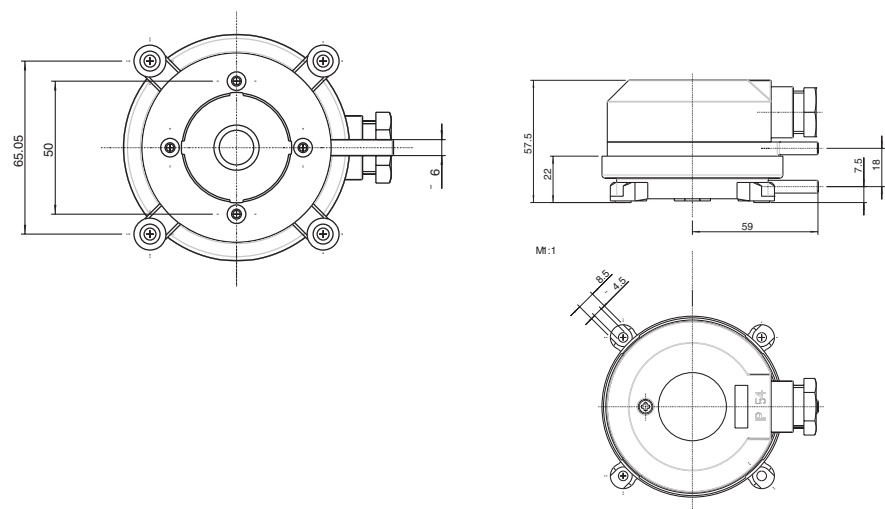



DPT 1000 D

Type series DPT (D)

Differential pressure transmitters

Applications

- Air-conditioning and ventilation systems
- Building automation
- Environmental protection
- Fan and ventilator control
- Valve and shutter control
- Filter and fan monitoring
- Liquid and level monitoring
- Controlling of air flows

Technical data

Pressure media	Air, and non-combustible and non-aggressive gases.
Pressure connection	Plastic connection piece with 6 mm external diameter for measuring hose with 5 mm internal diameter. Connector P 1 for higher pressure, P 2 for lower pressure.
Cable entry / electrical connection	M 20 x 1.5, screw terminals for wires and leads with conductor cross-section up to 1.5 mm².
Degree of protection according to DIN 40050	IP 54 with cover, IP 00 without cover
Mounting	Any mounting position possible, with screws supplied
Materials	Transmitter housing and pressure connection P2 made of ABS, light grey. Fastening element with pressure connection P1 made of POM, white.
Long-term stability in % FS/year	-50 Pa - 1000 Pa ≤ 2.5; 1000/2500 Pa ≤ 1.5
Repetition accuracy	< ± 0.2% of final value
Linearity and hysteresis factor	< ± 1% of end value
Response time	switchable 100 ms/1sec
Medium and ambient temperature	-10°C to +70°C
Permitted air humidity	0–95% non-condensing (2-conductor DC only!)
Operating voltage	18...30 V AC, 16–32 V DC (2-conductor DC only)
Max. current consumption	30 mA for AC, 20 mA for DC
Power consumption	Max. 1 W
Output signal	0–10 V, short-circuit-proof to ground 4–20 mA, short-circuit-proof ≤ 30 mA
Housing dimensions and weight	Diameter 85 mm x 58 mm, 130 g
Standards and conformity	EN 60770, EN 61326
Supplied accessories:	2 m silicone hose, 2 connection pieces with fastening screws, 2 self-tapping screws for fastening the housing
Optional accessories:	DP5L L-shaped bracket for installation turned through 90°, e.g. in ceiling area

Product Summary

Type	Default operating range in Pa	Operating range extended by jumpers in Pa	Over-pressure in kPa	Bursting pressure in kPa	Temperature pressure error
Versions with output voltage 0 - 10 V					
DPT 50	-50 ... +50	not possible	20	40	≤ ± 5% FS
DPT 110	-100 ... +100	not possible	20	40	≤ ± 5% FS
DPT 550	-500 ... +500	not possible	20	40	≤ ± 1% FS
DPT 1100	-1000 ... +1000	not possible	40	70	≤ ± 1% FS
DPT 100	0 - 100	0 - 250	20	40	≤ ± 5% FS
DPT 250	0 - 250	0 - 500	20	40	≤ ± 5% FS
DPT 500	0 - 500	0 - 1000	20	40	≤ ± 2.5% FS
DPT 1000	0 - 1000	0 - 2500	40	70	≤ ± 1% FS
Versions with output voltage 0 - 10 V and digital display					
DPT 50 D	-50 ... +50	not possible	20	40	≤ ± 5% FS
DPT 110 D	-100 ... +100	not possible	20	40	≤ ± 5% FS
DPT 550 D	-500 ... +500	not possible	20	40	≤ ± 1% FS
DPT 1100 D	-1000 ... +1000	not possible	40	70	≤ ± 1% FS
DPT 100 D	0 - 100	0 - 250	20	40	≤ ± 5% FS
DPT 250 D	0 - 250	0 - 500	20	40	≤ ± 5% FS
DPT 500 D	0 - 500	0 - 1000	20	40	≤ ± 2.5% FS
DPT 1000 D	0 - 1000	0 - 2500*	40	70	≤ ± 1% FS
Versions with current output 4 - 20 mA (3-conductor)					
DPT 53	-50 ... +50	not possible	20	40	≤ ± 5% FS
DPT 113	-100 ... +100	not possible	20	40	≤ ± 5% FS
DPT 553	-500 ... +500	not possible	20	40	≤ ± 1% FS
DPT 1103	-1000 ... +1000	not possible	40	70	≤ ± 1% FS
DPT 103	0 - 100	0 - 250	20	40	≤ ± 5% FS
DPT 253	0 - 250	0 - 500	20	40	≤ ± 5% FS
DPT 503	0 - 500	0 - 1000	20	40	≤ ± 2.5% FS
DPT 1003	0 - 1000	0 - 2500	40	70	≤ ± 1% FS
Versions with current output 4 - 20 mA (3-conductor) and digital display					
DPT 53 D	-50 ... +50	not possible	20	40	≤ ± 5% FS
DPT 113 D	-100 ... +100	not possible	20	40	≤ ± 5% FS
DPT 553 D	-500 ... +500	not possible	20	40	≤ ± 1% FS
DPT 1103 D	-1000 ... +1000	not possible	40	70	≤ ± 1% FS
DPT 103 D	0 - 100	0 - 250	20	40	≤ ± 5% FS
DPT 253 D	0 - 250	0 - 500	20	40	≤ ± 5% FS
DPT 503 D	0 - 500	0 - 1000	20	40	≤ ± 2.5% FS
DPT 1003 D	0 - 1000	0 - 2500*	40	70	≤ ± 1% FS
Versions with current output 4 - 20 mA (2-conductor)					
DPT52	-50 ... +50	not possible	20	40	≤ ± 5% FS
DPT112	-100 ... +100	not possible	20	40	≤ ± 5% FS
DPT102	0 - 100	0 - 250	20	40	≤ ± 5% FS
DPT252	0 - 250	0 - 500	20	40	≤ ± 5% FS
DPT502	0 - 500	0 - 1000	20	40	≤ ± 2.5% FS
DPT1002	0 - 1000	0 - 2500	40	70	≤ ± 1% FS

*pressure displayed in kPa



Degree of protection:
IP 54/00

Type series AZ

Digital display, plugs onto transmitter



AZ 331

AZ display modules show the output of a transmitter from the MODUFLEX system on an LED display.

On 3-conductor systems the supply and signal voltage is led from the evaluation module via ribbon cable. No additional wiring is needed.

The starting and end values of the display can be set anywhere between -50 and +1199, so that any display range can be assigned to any

pressure range. The decimal point can be moved with a slide switch.

The y-signals of the transmitter can thus be displayed in any unit, e.g. V, mA, bar, mbar, %, °C, °F, psi, m, cm (filling level), m³, cm³ (volume) etc.

Technical data

Display	3 1/2 digit LED display, 7 mm high, adjustable display range: -50 to +1999
Supply voltage	24 VAC or 24 VDC. Via ribbon cable from the basic module
Signal voltage	(input) 0–10 V. Signal input via ribbon cable from the evaluation module or from other modules. Signal input switchable with slide switch 9. Normal setting: D (output signal from evaluation module is displayed)
Decimal point	Set with slide switch
Factory setting	Input signal 0–10 V 0–10.00 ± 1 digit
Power consumption	Max. 1 W
Degree of protection	IP 65, in the installed state
Dimensions	Height: 1 module unit = 34 mm

By setting the input selector switch 9 to position E, the unit can be made to display signals generated by other modules. Furthermore, in its condition on delivery (factory setting 0–10.0), the display module can be used for accurately setting the operating range of a transmitter. All controls are accessible from the front, after removing the window. After setting, reinsert the window and press it in evenly.

Product Summary

Type	Suitable for	Display	Display range
AZ 331	3-conductor systems	3 1/2 digit	-50...+1999

Controls

Potentiometer 7

For setting lower display value (e.g. for y-signal 0%)

Potentiometer 8

For setting upper display value (e.g. for y-signal 100%)

Input selector switch 9

Position D: Output signal of the evaluation module is displayed (normal setting)


Position E: Signal of another module is displayed

Decimal point switch 10

For setting the decimal point

Decimal point switch 11


Decimal point on/off

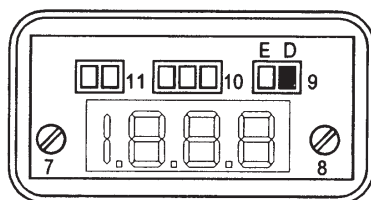

Operator interface

AZ 331 (3 1/2 digit)

See above for description of controls.

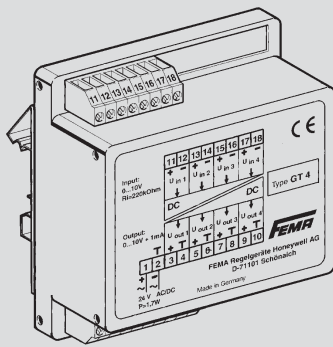

GT 4

Type series GT

Electrical isolation of analogue transmitter signals

The analogue output signals of a transmitter can be electrically isolated from the evaluation device using a signal separator. In this way, interference affecting the transmitter signal can be suppressed and influences caused by ground loops prevented.

A signal separator is absolutely essential for transmitters whose output signals have to be transmitted over long distances and for signal lines which are exposed to strong electromagnetic radiation.

Technical data

Supply voltage	24 V AC \pm 20% or 24–36 V DC.
Power consumption	1.7 W
Inputs	Voltage signals, e.g. 0–10 V, 2–10 V, 0–1 V and all voltage ranges between 0 and 10 V
Input resistor	$R_i > 220 \text{ k}\Omega$
Outputs	Voltage signals 1:1 from input signal, max. output signal current $\pm 1 \text{ mA}$
Transformation ratio	1:1
Channels	4 channels, usable in parallel
Linearity	0.1% FS
Transmission error	max. 0.1% FS
Interference suppression	Interference suppression N according to EN 50 081-1 and EN 50 082-1, class B
Degree of protection	IP 30
Protection class	II
Ambient temperature	0–50°C
Mounting	On mounting rail NS 35/7.5 to DIN 46 277

The 4-channel configuration and the limitation to voltage signals results in very good value for money. Signal separator GT 4 is designed for 4 input signals between 0 and 10 V (e.g. 0–10 V, 2–10 V, 0–5 V, 0–1 V). The input signal is conveyed to the output terminals in a ratio of 1:1. The input and output are electrically isolated.


Product Summary

Type	Channels	Transformation	Operating range
GT 4	4	1 : 1	between 0 and 10 V


All 4 channels can be used in parallel and independently of one another; however, the input and output channels are not electrically isolated from one another.

Current signals of 0–20 mA or 4–20 mA in the input circuit can likewise be processed if a 500 ohm resistor with the requisite tolerance is attached to the input terminals. A proportional voltage signal is present at the output. The accuracy achieved in the separation of current signals and conversion into voltage signals essentially depends on the accuracy of the 500 ohm resistor that is used. With a resistor value of $500 \pm 0.1\%$, a transmission accuracy of 0.3% is achieved.


Schematic diagram

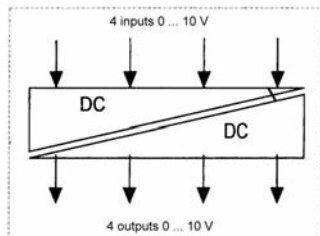

Connection scheme

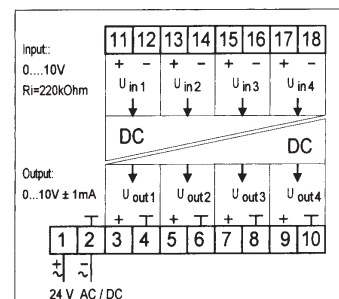

Dimensions

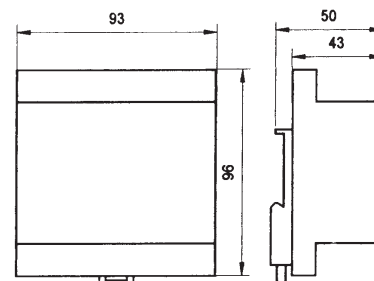



AP ...

Type series AP

with 1 or 2 limit value switches for PT100, PT1000
and voltage and current signals

Various routines for setting the following parameters are integrated into the microprocessor-controlled digital display:

- Measuring range (start and end point)
- Display range (start and end point)
- Setting of decimal point

- 2 limit values (relays) and their hysteresis
- Relay dropout or pickup delay
- Scanning of minimum and maximum measured value
- Rounding up or down of last digit
- Averaging

Technical data



Input signals	Freely selectable by setting jumpers. See Product Summary
Housing front	48 x 96 mm (DIN)
Dimension display	On APT: °C On APV: none
Display	3 1/2 digit, LED 12.5 mm, red, automatic "—" sign
Display range	See Product Summary Other ranges adjustable
Decimal point	Programmable
Measuring rate	2.5 measurements/ second
Keyboard lockable	with jumper (prevents input of commands)
Switching outputs programmable	2 x NO/NC contacts
Switching capacity of output relay	2 x 230 V, 5 A AC
Supply voltage	230 V, 50–60 Hz, 3 VA
Degree of protection (front)	IP 60, DIN 40 050
Working temperature	–10 to +50°C
Connection method	Lift terminals
Front panel cut-out	H x W: 44.5 x 90.5 mm
Max. installation depth	115 mm

All routines and parameters can be set with keys on the front. The switching status of the relays is displayed by LEDs. Setting is buffered. If the supply voltage is interrupted, the set parameters are retained. For powering transmitters, an electrically isolated 24 VDC power supply (max. 30 mA) is available.

Product Summary

Type	Input signals (programmable)	Display range (programmable)	Suitable for	Stages
APV 600	0–1 V DC	–1999	Pressure and temperature transmitters	1 switching point
APV 630	0–10 V DC 0–20 mA DC	to +1999		2 switching points
APT 600 APT 650	Pt 100 / Pt 1000	–150°C to +199.9°C –200°C to +800°C	Temperature sensors Pt 100 / Pt 1000	1 switching point 2 switching points

Dimensions

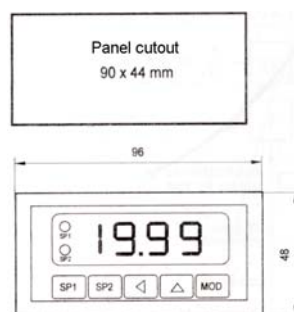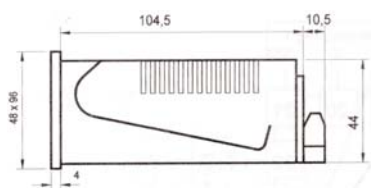

Specifications

Pressure switches/isolating amplifiers/ flow monitoring

F + ED 1

Pressure transmitter of modular design with terminal connection; operating range adjustable, supply voltage: 24 V AC/DC, nominal range ...–... mbar/bar. Smallest range ... mbar/bar
Output signal (invertible): 0–10 V and 0–20 mA
Output signal short-circuit and surge-proof up to 24 V, with plug connector for further plug-in modules (e.g. digital display); type F...+ ED 1

F + ED 3

Pressure transmitter of modular design with openable plug connection to DIN 43 650
Operating range adjustable, supply voltage: 24 V AC/DC, nominal range ...–... mbar/bar. Smallest range ... mbar/bar
Output signal (invertible): 0–10 V, output signal short-circuit and surge-proof up to 24 V, with plug connector for further plug-in modules (e.g. digital display); type F...+ ED 3

SN...311

Pressure transmitter of modular design with terminal connection; operating range adjustable via 2 potentiometers, supply voltage: 24 V AC/DC, nominal range ...–... mbar/bar. Smallest range ... mbar/bar
Output signal (invertible): 0–10 V and 0–20 mA, output signal short-circuit and surge-proof up to 24 V, with plug connector for further plug-in modules (e.g. digital display); type SN...-311

SN...395

Pressure transmitter of modular design with openable plug connection to DIN 43 650, operating range adjustable via jumpers to 100%, 50%, 20% of nominal range, supply voltage: 24 V AC/DC, range ...–... mbar/bar
Output signal: 0–10 V, output signal short-circuit and surge-proof up to 24 V, with plug connector for further plug-in modules (e.g. digital display); type SN...-395

SN...280

Pressure transmitter of modular design with openable plug connection to DIN 43 650
Supply voltage: 11–36 V DC, range ...–... mbar/bar, output signal: 4–20 mA (two-conductor)
Output signal short-circuit and surge-proof up to 24 V; type SN...-280

PST...

Electronic pressure switch/transmitter with 5-pole plug connection to DIN IEC 60947-5-2, supply voltage: 14...36 VDC
Nominal pressure range ...–... mbar/bar, output signal: 4–20 mA and 0–10 V, selectable and invertible

DPT...

Differential pressure transmitters for gaseous, non-aggressive media

Output signal: 0–10 V, short-circuit-proof to ground, 4–20 mA, short-circuit-proof \leq 30 mA, operating range...–...Pa; type DPT...

AZ...

Plug-in digital display (LED, 7 mm high), 3 1/2 digit, supply voltage and signal voltage via basic module, display range adjustable; type AZ 331

GT 4

Signal separator, 4-channel, for standard rail-mounting, for electrical isolation of analogue transmitter signals between 0 V and 10 V, transformation ratio: 1:1, supply voltage: 24 V AC/DC; type GT 4

APV 630

Programmable digital display with 2 limit value switches for panel surface mounting (standard dimensions 48 x 96 mm), 3 1/2 digit LED display, 12.5 mm, red, input signals: 0–1 VDC, 0–10 VDC, 0–20 mA DC, programmable operating range and switching point, supply voltage: 230 V AC; type APV 630

Manufactured for and on behalf of the Environmental and Combustion Controls Division of Honeywell Technologies Sàrl, Ecublens, Route du Bois 37, Switzerland by its Authorized Representative:



Fema Controls · Honeywell GmbH

上海欧逸机电工程设备有限公司

地址：上海市沪太路3777号5305室 邮编：200444

电话：021-51875816，传真：021-51875821

Http：[//www.shhfl.com](http://www.shhfl.com); E-mail：sales@shhfl.com

All technical data and illustrations are without obligation
in relation to the supplied product. Subject to change.

Printed in Germany · Identification number EN0B0562GE51 R05 06